

KZN HEALTH

# KZN Health Intranet

Search this site

- HOME
- CORPORATE INFORMATION
- COMPONENTS
- DIRECTORY
- DISTRICT OFFICES
- HEALTH FACILITIES

KZN Health > Components > Supply Chain Management

## AdvertQuote



## Quotation Advert

Opening Date: 2021-01-22

Closing Date: 2021-01-29

Closing Time: 11:00

### INSTITUTION DETAILS

Institution Name: Rietvlei hospital

Province: KwaZulu-Natal

Department or Entity: Department of Health

Division or section: Central Supply Chain Management

Place where goods / services is required: RIETVLEI HOSPITAL

Date Submitted: 2021-01-18

### ITEM CATEGORY AND DETAILS

Quotation Number: ZNQ: 239/10/2020/2021

Item Category: Services

Item Description: SERVICE OF FIRE DETECTION SYSTEM

### Quantity (if supplies)

### COMPULSORY BRIEFING SESSION / SITE VISIT

Select Type: Select...

Date:

Time:

Venue:

QUOTES CAN BE COLLECTED FROM: DOCUMENT ATTACHED ON ADVERT

QUOTES SHOULD BE DELIVERED TO: RIETVLEI SECURITY GATE

### ENQUIRIES REGARDING THE ADVERT MAY BE DIRECTED TO:

Name: MR M MBUCANE

Email: mzuvukile.mbucane@kznhealth.gov.za

Contact Number: 0736721087/0737840910

Finance Manager Name: P S BIYASE

Finance Manager Signature:

No late quotes will be considered

STANDARD QUOTE DOCUMENTATION SUPPLY CHAIN MANAGEMENT OVER R30 000.00

YOU ARE HEREBY INVITED TO QUOTE FOR REQUIREMENTS AT: RIETVLEI DISTRICT HOSPITAL

DATE ADVERTISED: 22/01/2021 CLOSING DATE: 29/01/2021 CLOSING TIME: 11:00

FACSIMILE NUMBER: 039 260 0019 E-MAIL ADDRESS: Rietvlei.Hospitalsecretary@kznhealth.gov.za

PHYSICAL ADDRESS: R56 ROAD UMZIMKHULU MUNICIPALITY MHLANGENI LOCATION STAFFODS POST 4686

ZNQ NUMBER: 239/2020/2021

DESCRIPTION: SERVICING OF FIRE DETECTIONS SYSTEM

CONTRACT PERIOD: ONCE OFF (if applicable) VALIDITY PERIOD 60 Days SARS PIN:

CENTRAL SUPPLIER DATABASE REGISTRATION (CSD) NO. [Grid]

UNIQUE REGISTRATION REFERENCE [Grid]

DEPOSITED IN THE QUOTE BOX SITUATED AT (STREET ADDRESS) AT SECURITY GATE OR FAX 039 260 0019 OR Email to Rietvlei.Hospitalsecretary@kznhealth.gov.za

Bidders should ensure that quotes are delivered timeously to the correct address. If the quote is late, it will not be accepted for consideration.

The quote box is open from 08:00 to 15:30.

ALL QUOTES MUST BE SUBMITTED ON THE OFFICIAL FORMS - (NOT TO BE RE-TYPED)

THIS QUOTE IS SUBJECT TO THE PREFERENTIAL PROCUREMENT POLICY FRAMEWORK ACT AND THE PREFERENTIAL PROCUREMENT REGULATIONS, 2011, THE GENERAL CONDITIONS OF CONTRACT (GCC) AND, IF APPLICABLE, ANY OTHER SPECIAL CONDITIONS OF CONTRACT.

THE FOLLOWING PARTICULARS MUST BE FURNISHED (FAILURE TO DO SO WILL RESULT IN YOUR QUOTE BEING DISQUALIFIED)

NAME OF BIDDER

POSTAL ADDRESS

STREET ADDRESS

TELEPHONE NUMBER CODE.....NUMBER..... FACSIMILE NUMBER CODE.....NUMBER.....

CELLPHONE NUMBER

E-MAIL ADDRESS

VAT REGISTRATION NUMBER (If VAT vendor)

HAS A B-BBEE STATUS LEVEL VERIFICATION CERTIFICATE BEEN SUBMITTED? (SBD 6.1) YES NO

[A B-BBEE STATUS LEVEL VERIFICATION CERTIFICATE/SWORN AFFIDAVIT (FOR EMEs& QSEs) MUST BE SUBMITTED IN ORDER TO QUALIFY FOR PREFERENCE POINTS FOR B-BBEE]





## SPECIAL CONTRACT CONDITIONS OF QUOTATIONS

### 1. AMENDMENT OF CONTRACT

- 1.1. Any amendment to or renunciation of the provisions of the contract shall at all times be done in writing and shall be signed by both parties.

### 2. CHANGE OF ADDRESS

- 2.1. Bidders must advise the Department of Health (institution where the offer was submitted) should their address (*domicilium citandi et executandi*) details change from the time of bidding to the expiry of the contract.

### 3. GENERAL CONDITIONS ATTACHED TO THIS QUOTATION

- 3.1. The institution is under no obligation to accept the lowest or any quote.
- 3.2. The price quoted must include VAT (if VAT vendor). However, it must be noted that the department reserves the right to evaluate all quotations excluding VAT as some bidders may not be VAT vendors.
- 3.3. The bidder must ensure the correctness & validity of quote:
- (i) *that the price(s), rate(s) & preference quoted cover all for the work/item (s) & accept that any mistakes regarding the price (s) & calculations will be at the bidder's risk*
- 3.4. The bidder must accept full responsibility for the proper execution & fulfilment of all obligations conditions devolving on under this agreement, as the Principal (s) liable for the due fulfilment of this contract.
- 3.5. This quotation will be evaluated based on the 80/20 points system, specification & correctness of information. All required documentation must be completed in full and submitted.
- 3.6. Offers must comply strictly with the specification.
- 3.7. Only offers that meet or are greater than the specification will be considered.
- 3.8. Late quotes will not be considered.
- 3.9. Expired product/s will not be accepted. All products supplied must be valid for a minimum period of six months.
- 3.10. A bidder not registered on the Central Suppliers Database or verification has failed will not be considered.
- 3.11. All delivery costs must be included in the quote price, for delivery at the prescribed destination.
- 3.12. Only firm prices will be accepted. Such prices must remain firm for the contract period. Non-firm prices (including rates of exchange variations) will not be considered.
- 3.13. In cases where different delivery points influence the pricing, a separate pricing schedule must be submitted for each delivery point.
- 3.14. In the event of a bidder having multiple quotes, only the cheapest according to specification will be considered. Furthermore a verification will be done to identify if bidders have multiple companies and are quoting (cover-quoting) for this bid. In such instances only the cheapest bid according to specification will be considered.

### 4. SPECIAL INSTRUCTIONS AND NOTICES TO BIDDERS REGARDING THE COMPLETION OF THIS QUOTATION.

- 4.1. Unless inconsistent with or expressly indicated otherwise by the context, the singular shall include the plural and vice versa and with words importing the masculine gender shall include the feminine and the neuter.
- 4.2. Under no circumstances whatsoever may the quotation/bid forms be retyped or redrafted. Photocopies of the original bid documentation may be used, but an original signature must appear on such photocopies.
- 4.3. The bidder is advised to check the number of pages and to satisfy himself that none are missing or duplicated.
- 4.4. Quotation submitted must be complete in all respects.
- 4.5. Any alteration made by the bidder must be initialled.
- 4.6. Use of correcting fluid is prohibited
- 4.7. Quotation will be opened in public as soon as practicable after the closing time of quotation.
- 4.8. Where practical, prices are made public at the time of opening quotations.
- 4.9. If it is desired to make more than one offer against any individual item, such offers should be given on a photocopy of the page in question. Clear indication thereof must be stated on the schedules attached.

### 5. SPECIAL INSTRUCTIONS REGARDING HAND DELIVERED QUOTATIONS

- 5.1. Quotation shall be lodged at the address indicated not later than the closing time specified for their receipt, and in accordance with the directives in the quotation documents.
- 5.2. Each quotation shall be addressed in accordance with the directives in the quotation documents and shall be lodged in a separate sealed envelope, with the name and address of the bidder, the quotation number and closing date indicated on the envelope. The envelope shall not contain documents relating to any quotation other than that shown on the envelope. If this provision is not complied with, such quotations/bids may be rejected as being invalid.
- 5.3. All quotations received in sealed envelopes with the relevant quotation numbers on the envelopes are kept unopened in safe custody until the closing time of the quotation/bids. Where, however, a quotation is received open, it shall be sealed. If it is received without a quotation/bid number on the envelope, it shall be opened, the quotation number ascertained, the envelope sealed and the quotation number written on the envelope.
- 5.4. A specific box is provided for the receipt of quotations, and no quotation found in any other box or elsewhere subsequent to the closing date and time of quotation will be considered.

- 5.5. No quotation/bid sent through the post will be considered if it is received after the closing date and time stipulated in the quotation documentation, and proof of posting will not be accepted as proof of delivery.
- 5.6. Quotation documents must not be included in packages containing samples. Such quotations may be rejected as being invalid.

**6. SAMPLES**

- 6.1. In the case of the quote document stipulating that samples are required, the supplier will be informed in due course when samples should be provided to the institution. (This decreases the time of safety and storage risk that may be incurred by the respective institution). The bidders sample will be retained if such bidder wins the contract.
  - (i) If a company/s who has not won the quote requires their samples, they must advise the institution in writing of such.
  - (ii) If samples are not collected within three months of close of quote the institution reserves the right to dispose of them at their discretion.
- 6.2. **Samples must be made available when requested in writing or if stipulated on the document.**
  - (i) If a Bidder fails to provide a sample of their product on offer for scrutiny against the set specification when requested, their offer will be rejected. All testing will be for the account of the bidder.

**7. COMPULSORY SITE INSPECTION / BRIEFING SESSION**

7.1. Bidders who fail to attend the compulsory meeting will be disqualified from the evaluation process.

- (i) The institution has determined that a compulsory site meeting  take place
- (ii) Date \_\_\_\_/\_\_\_\_/\_\_\_\_ Time \_\_\_\_:\_\_\_\_ Place Rietvlei Hospital

|                    |  |
|--------------------|--|
| Institution Stamp: | Institution Site Inspection / briefing session Official<br><br>Full Name: .....<br>Signature: .....<br>Date: ..... |
|--------------------|--|

**8. STATEMENT OF SUPPLIES AND SERVICES**

8.1. The contractor shall, when requested to do so, furnish particulars of supplies delivered or services executed. If he/she fails to do so, the Department may, without prejudice to any other rights which it may have, institute inquiries at the expense of the contractor to obtain the required particulars.

**9. SUBMISSION AND COMPLETION OF SBD 6.1**

9.1. Should a bidder wish to qualify for preference points they must complete a SBD 6.1 document. Failure by a bidder to provide all relevant information required, will result in such a bidder not being considered for preference point's allocation. The preferences applicable on the closing date will be utilized. Any changes after the closing date will not be considered for that particular quote.

**10. TAX COMPLIANCE REQUIREMENTS**

- 10.1. In the event that the tax compliance status has failed on CSD, *it is the suppliers' responsibility to provide a SARS pin in order for the institution to validate the tax compliance status of the supplier.*
- 10.2. In the event that the institution cannot validate the suppliers' tax clearance on SARS as well as the Central Suppliers Database, *the quote will not be considered and passed over as non-compliant according to National Treasury Instruction Note 4 (a) 2016/17.*

**11. TAX INVOICE**

11.1. A tax invoice shall be in the currency of the Republic of South Africa and shall contain the following particulars:

- (i) the name, address and registration number of the supplier;
- (ii) the name and address of the recipient;
- (iii) an individual serialized number and the date upon which the tax invoice is issued;
- (iv) a description and quantity or volume of the goods or services supplied;
- (v) the official department order number issued to the supplier;
- (vi) the value of the supply, the amount of tax charged;
- (vii) the words tax invoice in a prominent place.

**12. PATENT RIGHTS**

The supplier shall indemnify the KZN Department of Health (hereafter known as the purchaser) against all third-party claims of infringement of patent, trademark, or industrial design rights arising from use of the goods or any part thereof by the purchaser.

### 13. PENALTIES

- 13.1. If at any time during the contract period, the service provider is unable to perform in a timely manner, the service provider must notify the institution in writing/email of the cause of and the duration of the delay. Upon receipt of the notification, the institution should evaluate the circumstances and, if deemed necessary, the institution may extend the service provider's time for performance.
- 13.2. In the event of delayed performance that extends beyond the delivery period, the institution is entitled to purchase commodities of a similar quantity and quality as a substitution for the outstanding commodities, without terminating the contract, as well as return commodities delivered at a later stage at the service provider's expense.
- 13.3. Alternatively, the institution may elect to terminate the contract and procure the necessary commodities in order to complete the contract. In the event that the contract is terminated the institution may claim damages from the service provider in the form of a penalty. The service provider's performance should be captured on the service provider database in order to determine whether or not the service provider should be awarded any contracts in the future.
- 13.4. If the supplier fails to deliver any or all of the goods or to perform the services within the period(s) specified in the contract, the purchaser shall, without prejudice to its other remedies under the contract, deduct from the contract price, as a penalty, a sum calculated on the delivered price of the delayed goods or unperformed services using the current prime interest rate calculated for each day of the delay until actual delivery or performance.

### 14. TERMINATION FOR DEFAULT

- 14.1. The purchaser, without prejudice to any other remedy for breach of contract, by written notice of default sent to the supplier, may terminate this contract in whole or in part:
  - (i) if the supplier fails to deliver any or all of the goods within the period(s) specified in the contract,
  - (ii) if the supplier fails to perform any other obligation(s) under the contract; or
  - (iii) if the supplier, in the judgment of the purchaser, has engaged in corrupt or fraudulent practices in competing for or in executing the contract.
- 14.2. In the event the purchaser terminates the contract in whole or in part, the purchaser may procure, upon such terms and in such manner as it deems appropriate, goods, works or services similar to those undelivered, and the supplier shall be liable to the purchaser for any excess costs for such similar goods, works or services.
- 14.3. Where the purchaser terminates the contract in whole or in part, the purchaser may decide to impose a restriction penalty on the supplier by prohibiting such supplier from doing business with the public sector for a period not exceeding 10 years.

### 15. FAILURE TO COMPLY WITH ABOVE WILL RESULT IN YOUR QUOTE BEING PASSED OVER.

**PREFERENCE POINTS CLAIM FORM IN TERMS OF THE PREFERENTIAL PROCUREMENT REGULATIONS 2017**

This preference form must form part of all quotes invited. It contains general information and serves as a claim form for preference points for Broad-Based Black Economic Empowerment (B-BBEE) Status Level of Contribution

**NB: BEFORE COMPLETING THIS FORM, BIDDERS MUST STUDY THE GENERAL CONDITIONS, DEFINITIONS AND DIRECTIVES APPLICABLE IN RESPECT OF B-BBEE, AS PRESCRIBED IN THE PREFERENTIAL PROCUREMENT REGULATIONS, 2017.**

**1. GENERAL CONDITIONS**

1.1 The following preference point systems are applicable to all quotes:

- the 80/20 system for requirements with a Rand value of up to R50 000 000 (all applicable taxes included); and

1.2 The value of this quote is estimated to not exceed R50 000 000 (all applicable taxes included) and therefore the 80/20 preference point system shall be applicable.

1.3 Points for this quote shall be awarded for:

- (a) Price; and
- (b) B-BBEE Status Level of Contributor.

1.4 The maximum points for this quote is allocated as follows:

|  | <b>POINTS</b> |
|--|---------------|
| <b>PRICE</b>   | 80            |
| <b>B-BBEE STATUS LEVEL OF CONTRIBUTOR</b>                | 20            |
| <b>Total points for Price and B-BBEE must not exceed</b> | <b>100</b>    |

1.5 Failure on the part of a bidder to submit proof of B-BBEE Status level of contributor together with the quote, will be interpreted to mean that preference points for B-BBEE status level of contribution are not claimed.

1.6 The purchaser reserves the right to require of a bidder, either before a quote is adjudicated or at any time subsequently, to substantiate any claim in regard to preferences, in any manner required by the purchaser.

**2. DEFINITIONS**

- (a) "B-BBEE" means broad-based black economic empowerment as defined in section 1 of the Broad-Based Black Economic Empowerment Act;
- (b) "B-BBEE status level of contributor" means the B-BBEE status of an entity in terms of a code of good practice on black economic empowerment, issued in terms of section 9(1) of the Broad-Based Black Economic Empowerment Act;
- (c) "bid" means a written offer in a prescribed or stipulated form in response to an invitation by an organ of state for the provision of goods or services, through price quotations, advertised competitive bidding processes or proposals;
- (d) "Broad-Based Black Economic Empowerment Act" means the Broad-Based Black Economic Empowerment Act, 2003 (Act No. 53 of 2003);
- (e) "EME" means an Exempted Micro Enterprise in terms of a code of good practice on black economic empowerment issued in terms of section 9 (1) of the Broad-Based Black Economic Empowerment Act;
- (f) "functionality" means the ability of a tenderer to provide goods or services in accordance with specifications as set out in the tender documents.
- (g) "prices" includes all applicable taxes less all unconditional discounts;
- (h) "proof of B-BBEE status level of contributor" means:
  - 1) B-BBEE Status level certificate issued by an authorized body or person;
  - 2) A sworn affidavit as prescribed by the B-BBEE Codes of Good Practice;
  - 3) Any other requirement prescribed in terms of the B-BBEE Act;
- (i) "QSE" means a qualifying small business enterprise in terms of a code of good practice on black economic empowerment issued in terms of section 9 (1) of the Broad-Based Black Economic Empowerment Act;
- (j) "rand value" means the total estimated value of a contract in Rand, calculated at the time of bid invitation, and includes all applicable taxes;



3. POINTS AWARDED FOR PRICE

3.1 THE 80/20 PREFERENCE POINT SYSTEMS

A maximum of 80 points is allocated for price on the following basis:

$$P_s = 80 \left( 1 - \frac{P_t - P_{\min}}{P_{\min}} \right) \text{ Where}$$

- Ps = Points scored for price of bid under consideration
- Pt = Price of bid under consideration
- Pmin = Price of lowest acceptable bid

4. POINTS AWARDED FOR B-BBEE STATUS LEVEL OF CONTRIBUTOR

4.1 In terms of Regulation 6 (2) and 7 (2) of the Preferential Procurement Regulations, preference points must be awarded to a bidder for attaining the B-BBEE status level of contribution in accordance with the table below:

| B-BBEE Status Level of Contributor | Number of points (80/20 system) |
|------------------------------------|---------------------------------|
| 1                                  | 20                              |
| 2                                  | 18                              |
| 3                                  | 14                              |
| 4                                  | 12                              |
| 5                                  | 8                               |
| 6                                  | 6                               |
| 7                                  | 4                               |
| 8                                  | 2                               |
| Non-compliant contributor          | 0                               |

5. BID DECLARATION

5.1 Bidders who claim points in respect of B-BBEE Status Level of Contribution must complete the following:

6. B-BBEE STATUS LEVEL OF CONTRIBUTOR CLAIMED IN TERMS OF PARAGRAPHS 1.4 AND 4.1

6.1 B-BBEE Status Level of Contributor: = .....(maximum of 20 points)

(Points claimed in respect of paragraph 7.1 must be in accordance with the table reflected in paragraph 4.1 and must be substantiated by relevant proof of B-BBEE status level of contributor.

7. SUB-CONTRACTING

(Tick applicable box)

7.1 Will any portion of the contract be sub-contracted?

|     |                          |    |                          |
|-----|--------------------------|----|--------------------------|
| YES | <input type="checkbox"/> | NO | <input type="checkbox"/> |
|-----|--------------------------|----|--------------------------|

7.1.1 If yes, indicate:

- i) What percentage of the contract will be subcontracted.....%
- ii) The name of the sub-contractor.....
- iii) The B-BBEE status level of the sub-contractor.....

8. Whether the sub-contractor is an EME or QSE

(Tick applicable box)

iv) Specify, by ticking the appropriate box, if subcontracting with an enterprise in terms of Preferential Procurement Regulations, 2017:

|     |                          |    |                          |
|-----|--------------------------|----|--------------------------|
| YES | <input type="checkbox"/> | NO | <input type="checkbox"/> |
|-----|--------------------------|----|--------------------------|

| Designated Group: An EME or QSE which is at least 51% owned by:   | EME<br>√ | QSE<br>√ |
|---|----------|----------|
| Black people  |          |          |
| Black people who are youth  |          |          |
| Black people who are women  |          |          |
| Black people with disabilities                                    |          |          |
| Black people living in rural or underdeveloped areas or townships |          |          |
| Cooperative owned by black people                                 |          |          |
| Black people who are military veterans                            |          |          |
| OR  |          |          |
| Any EME   |          |          |
| Any QSE   |          |          |

9. DECLARATION WITH REGARD TO COMPANY/FIRM

9.1 Name of company/firm:.....

9.2 VAT registration number:.....

9.3 Company registration number:.....

9.4 TYPE OF COMPANY/ FIRM [TICK APPLICABLE BOX]

- Partnership/Joint Venture / Consortium
- One person business/sole propriety
- Close corporation
- Company
- (Pty) Limited

9.5 DESCRIBE PRINCIPAL BUSINESS ACTIVITIES

.....  
.....

9.6 COMPANY CLASSIFICATION [TICK APPLICABLE BOX]

- Manufacturer
- Supplier
- Professional service provider
- Other service providers, e.g. transporter, etc.

9.7 Total number of years the company/firm has been in business:.....

9.8 I/we, the undersigned, who is / are duly authorised to do so on behalf of the company/firm, certify that the points claimed, based on the B-BBE status level of contributor indicated in paragraphs 1.4 and 6.1 of the foregoing certificate, qualifies the company/ firm for the preference(s) shown and I / we acknowledge that:

- i) The information furnished is true and correct;
- ii) The preference points claimed are in accordance with the General Conditions as indicated in paragraph 1 of this form;
- iii) In the event of a contract being awarded as a result of points claimed as shown in paragraphs 1.4 and 6.1, the contractor may be required to furnish documentary proof to the satisfaction of the purchaser that the claims are correct;
- iv) If the B-BBEE status level of contributor has been claimed or obtained on a fraudulent basis or any of the conditions of contract have not been fulfilled, the purchaser may, in addition to any other remedy it may have –
  - (a) disqualify the person from the bidding process;
  - (b) recover costs, losses or damages it has incurred or suffered as a result of that person's conduct;
  - (c) cancel the contract and claim any damages which it has suffered as a result of having to make less favourable arrangements due to such cancellation;
  - (d) recommend that the bidder or contractor, its shareholders and directors, or only the shareholders and directors who acted on a fraudulent basis, be restricted by the National Treasury from obtaining business from any organ of state for a period not exceeding 10 years, after the *audi alteram partem* (hear the other side) rule has been applied; and
  - (e) forward the matter for criminal prosecution.

WITNESSES

1. ....

2. ....

.....

SIGNATURE(S) OF BIDDERS(S)

DATE: .....

ADDRESS.....

.....

.....

## SPECIFICATION FOR SERVICING OF FIRE DETECTION SYSTEMS

### GENERAL NOTES

1. All scope needed to be checked on site prior to submission of a quote and to any works being undertaken, discrepancies to be reported to Chief Artisan before quotation & work is done.
2. Preparation work is critical important to all works, where an unusual situation is discovered, report to Chief Artisan prior to proceeding.
3. **Ensure that documents are correctly filled and specification documents are returned signed at the bottom each and every page. Make sure that certified copies of relevant required registrations are attached.**

**NB: Only the following Service Providers are invited to quote for this service:**

- Service providers that specialize on maintenance and repairs of fire detection systems and must be registered with SAQCC and must have CIDB category EB grading. SAQCC proof of Registration as a Fire Detection authorized person under the Commissioner/ Serviceman / Designer category (for this particular job) must be attached proof of registration for the serviceman who will be doing the job. SAQCC Registration title Card must be produce on site before commence of any work.
1. **The Service provider shall also provide quotation template which shall be fully detailed as follows:**
    - 1.1. Itemized list of Materials/Spare Parts/Equipment, showing unit costs, contractors mark-up and subtotal
    - 1.2. Labour hours, Unit Rate and Sub-Total
    - 1.3. Kilometers, Unit Rate and Sub-Total (Specify number of trips)
    - 1.4. Subsistence: Number of Nights Out, Unit Rate and Sub-Total.
    - 1.5. VAT and Grand Total


### 2. Servicing

- 2.1. The service must be done according to The National Regulator for Compulsory Specifications Act (Act 5 of 2008)
- 2.2. Service according to the attached document
- 2.3. Running repairs must be done on site and signed by qualified serviceman/ qualified tradesman and other repairs required must also be filled on site.

- 2.4. Service provider must submit a detailed quotation of other repairs required using a quotation template as stated in item number one.
- 2.5. A detailed report upon completion of a maintenance visit must be provided, which will include each fire alarm system efficiency evaluation report.
- 2.6. **The attached check list must be filled accurately on site on present of our maintenance officer and returned. Payments will not be done if the check lists are not fully completed for each fire alarm system.**
- 2.7. Return all the pages and sign each and every page
- 2.8. Printer:
  - 2.8.1. Service provider must ensure that a printer/s is/are available which will be able to be connected to our panel before submitting a quotation for this job.
  - 2.8.2. Take a print out of all the sensors that are in service and state your findings.
  - 2.8.3. Generate printed reports of device analogue values and compare these values to the permitted values for each point and state your findings.
  - 2.8.4. Connect a planner to the panel and print out a complete system configuration from the panel software. Compare this to the system specification and verify that the system zoning, input-output mapping, and other settings have not been changed.
  - 2.8.5. Make sure that the printer is printing all events during the service.
- 2.9. To operate a manual call point use the Test Key. To operate a detector, use a smoke generator or heat source as appropriate to the type of detector.
- 2.10. Battery replacement: the battery should be clearly label with the date of installation and scheduled replacement date.
- 2.11. If any defects are discovered during the testing, they should be recorded in the log book and action taken to have them fixed.
- 2.12. Any servicing / corrective action that has been omitted from the check list should be noted and carried out during the service.
- 2.13. Battery operation test:
  - 2.13.1. Check that the battery is healthy. One method is to conduct an 'all-sounders on' operational test with the mains off and the system running on the batteries. This will test the batteries under full load. The battery voltage should be monitored during this test and should not fall below 24 volts.
  - 2.13.2. Remove one terminal and verify that the system reports a battery fault. Replace terminal, ensure that it is tight, and reset the panel.
  - 2.13.3. Clean the battery with damp cloth and lightly lubricate any exposed terminals with petroleum jelly if necessary.
- 2.14. Input-output configuration:
  - 2.14.1. Verify by testing that the input-output mapping operates as programmed.
  - 2.14.2. Activate an input, such as a sensor, call point or interface unite, and verify that the correct outputs operate.
  - 2.14.3. Check that outputs function correctly, for example, that they pulse, or operate continuously, that any delays operate correctly.
- 2.15. Building changes check
  - 2.15.1. Visually check that the internal structural layout of the building, including inter-office / wards partitioning, has not changed from the system specification to such an extent that it may affect the efficient operation of the fire alarm system.

- 2.16. Restore the system to normal condition:
- 2.16.1. Re-enable any disable devices, re-connect any disconnected devices, re-connect all external systems that were disconnected for the testing, and ensure that the system is left in 100% working.
- 2.16.2. Report to the chief artisan so that he can advise all staff that testing is complete, and that any alarm received now must be treated as real.
- 2.17. Issue the service certificate. **“SANS 1475 registered companies can only legally issue a certificate of compliance concerning service of equipment in terms of 1475 Parts 1 & 2.”**

ZITON ZP3 2 Loop

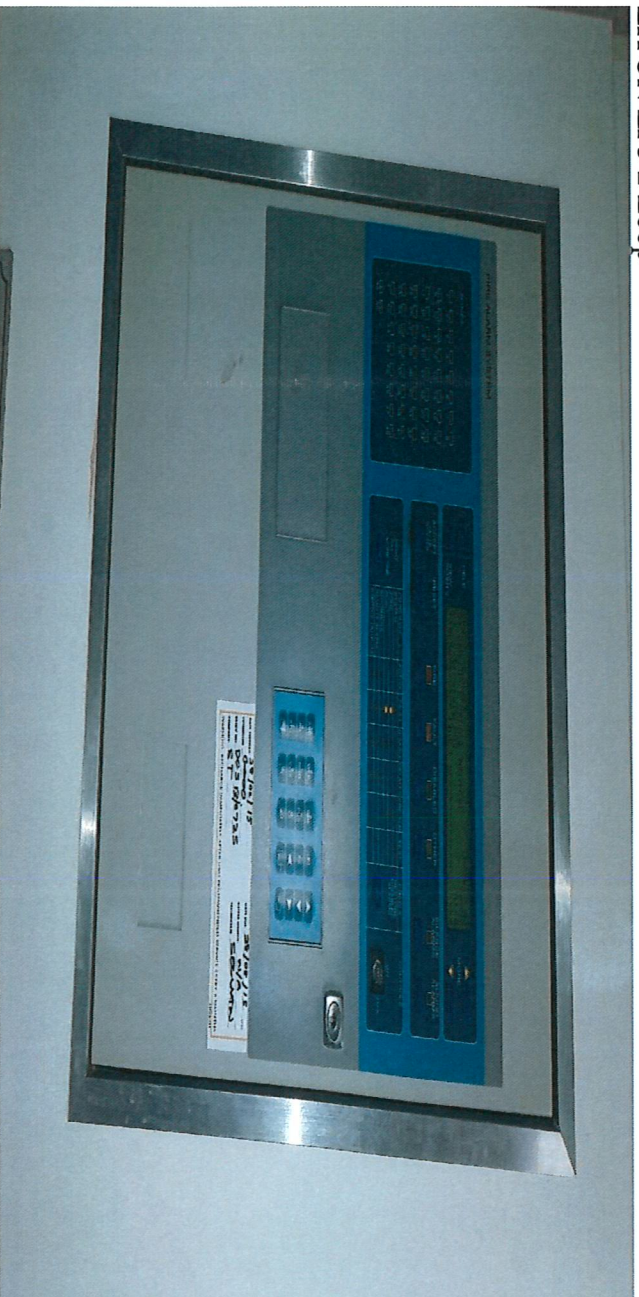



OPD/Casualty panel

## Devices and panels that must be serviced and batteries that needs to be replaced

| Panel type   | Designation             | Call point/ MCP | Relay | Smoke detector | In ceiling smoke detector | Smoke detector base | Sounder base only | Replace Batteries. Yes/No |
|--------------|-------------------------|-----------------|-------|----------------|---------------------------|---------------------|-------------------|---------------------------|
| ZITON ZP2-F2 | Res 1bed flats.         | 4               | 1     | 12             | 4                         | 12                  | 0                 | NO                        |
|              | Res 2bed flats.         | 4               | 1     | 24             | 4                         | 12                  | 0                 | NO                        |
| ZITON ZP2-F2 | Res 3bed flats.         | 6               | 1     | 54             | 12                        | 18                  | 0                 | NO                        |
| ZITON ZP2-F2 | Res 4bed flats.         | 6               | 1     | 60             | 5                         | 15                  | 0                 | NO                        |
| ZITON ZP2-F1 | Security Gatehouse      | 0               | 1     | 0              | 0                         | 0                   | 0                 | NO                        |
| ZITON ZP2-F1 | Philani /gateway clinic | 2               | 2     | 39             | 0                         | 4                   | 2                 | NO                        |
| ZITON ZP3    | Surgical ward male      | 1               | 1     | 13             | 0                         | 1                   | 0                 | NO                        |
| ZITON ZP3    | Surgical ward female    | 2               | 1     | 22             | 5                         | 2                   | 1                 | NO                        |

| Panel type         | Designation             | Call point/MCP | Relay | Smoke detector | In ceiling smoke detector | Smoke detector base | Sounder base only | Replace Batteries. Yes/No |
|--------------------|-------------------------|----------------|-------|----------------|---------------------------|---------------------|-------------------|---------------------------|
| ZITON ZP3          | Female med &Physo       | 4              | 1     | 12             | 6                         | 4                   | 0                 | NO                        |
| ZITON ZP3          | Male Med                | 2              | 1     | 13             | 5                         | 2                   | 0                 | YES                       |
| ZITON ZP3          | Maternity               | 3              | 1     | 35             | 12                        | 6                   | 1                 | YES                       |
| ZITON ZP3          | Theatre                 | 2              | 1     | 21             | 1                         | 3                   | 3                 | NO                        |
| ZITON ZP3          | Laboratory              | 2              | 1     | 12             | 2                         | 2                   | 0                 | NO                        |
| ZITON ZP3          | Main pharmacy/Ground FL | 4              | 1     | 22             | 4                         | 5                   | 0                 | NO                        |
| OPD/Casualty panel | OPD/Casualty            | 6              | 1     | 33             | 2                         | 6                   | 0                 | Yes                       |
| ZITON ZP3          | Pediatric ward          | 3              | 1     | 18             | 1                         | 1                   | 0                 | YES                       |
| ZITON ZP3          | High care               | 1              | 1     | 2              | 0                         | 1                   | 0                 | NO                        |



PROVINCE OF KWAZULU-NATAL  
PREVENTIVE MAINTENANCE CHECK LIST

TYPE OF SERVICE : FIRE DETECTING EQUIPMENT  
SCHEDULE FOR : SERVICE  
SCHEDULE FREQUENCY : annually

INSTALLATION NAME :

REF :

SERVICE PROVIDER :

ORDER No. :

| ITEM | INSTRUCTION: CHECK, ADJUST, CLEAN AS REQUIRED (F/III)   | IN ORDER | TIME TAKEN | DESCRIPTION OF SPARES & ACCESSORIES USED | OTHER REPAIRS REQUIRED<br>SUBMIT A DETAILED QUOTATION |
|------|---|----------|------------|--|---|
| 1.   | Printer test  |          |            |  |   |
| 2.   | Check that LED's are operating by carrying out a lamp test  |          |            |  |   |
| 3.   | Test every manual call point,   |          |            |  |   |
| 4.   | Test all the detectors  |          |            |  |   |
| 5.   | Confirm operation of the sounders and identify any area of poor audibility                        |          |            |  |   |
| 6.   | Confirm the operation of auxiliary items such as door closers                                     |          |            |  |   |
| 7.   | Replace battery as required and /or do the load test. Check battery operation.                    |          |            |  |   |
| 8.   | Test the function of all the control and indicating equipment by operating a device in each zone. |          |            |  |   |
| 9.   | Check and test all the ancillary functions  |          |            |  |   |

| ITEM | INSTRUCTION: CHECK, ADJUST, CLEAN AS REQUIRED (E/II)  | IN ORDER | TIME TAKEN | DESCRIPTION OF SPARES & ACCESSORIES USED | DESCRIPTION OF OTHER REPAIRS REQUIRED |
|------|---|----------|------------|--|---------------------------------------|
|      | of the fire panel.  |          |            |  |                                       |
| 10.  | Test the panel controls and check that all controls and keys functions,   |          |            |  |                                       |
| 11.  | Test and monitor earth leakage on systems with the earth leakage monitoring enabled.  |          |            |  |                                       |
| 12.  | All fault indicators and their circuits should be checked by simulation of the fault condition.   |          |            |  |                                       |
| 13   | Check connections and ensure that all terminals are tight and cables inside the panel are secured.  |          |            |  |                                       |
| 14   | Do the inspection to confirm that all cable fittings and equipment are secured, undamaged and adequately protected.   |          |            |  |                                       |
| 15   | Ensure that the fire alarm panel configuration complies with the Panel Configuration. Any changes should be verified with the Chief Artisan and the panel configuration record updated if the changes are authorized. |          |            |  |                                       |
| 16.  | Test input-output configuration.  |          |            |  |                                       |
| 17.  | Verify that the standby power is sufficient to for the system and make sure that the battery installed is sufficient to meet the system specifications.   |          |            |  |                                       |
| 18.  | Clean the panel exterior and interior   |          |            |  |                                       |
| 19.  | Set correct time and date on the panel.   |          |            |  |                                       |
| 20.  | Check building changes  |          |            |  |                                       |
| 21.  | Record any defects in the log book and report to the Chief Artisan.   |          |            |  |                                       |
| 22.  | Restore the system to normal condition  |          |            |  |                                       |



**SCHEDULE OF RATES**

**WORK TO BE DONE AND SCHEDULE OF RATES:**

| Item     | DESCRIPTION  | UNIT | QTY | R | RATE/ UNIT | c | Total Prize |
|----------|--|------|-----|---|------------|---|-------------|
|          | <b>NOTE:</b><br>1). All rates for items contained in this Schedule of Rates must be computed excluding the applicable Value Added Tax.<br>2). The Department of Health reserves the right to Negotiate rates in the Bill of Quantities.<br>3). All rubble shall be removed from site and suitably disposed of. |      |     |   |            |   |             |
|          | <b>INSTITUTION: RIETVLEI HOSPITAL</b>  |      |     |   |            |   |             |
|          | All rates quoted shall be inclusive of transport, labour and profit. All relevant mark-ups for specialist shall be included. The Bidder is advised that the institution is fully functional and Occupied and disruptions to services are to be kept to the bare minimum.                                       |      |     |   |            |   |             |
| <b>1</b> | <b>Servicing of devices and panels according to the attached specification and check list</b>  |      |     |   |            |   |             |
| 1.1      | ZITON ZP2-F2 panel   | item | 5   |   |            |   |             |



health

Department:  
Health  
PROVINCE OF KWAZULU-NATAL

Rietvllei Hospital  
Private Bag x 501, Staffords Post ,4686  
Tel: 039 2605235 Fax: 039 2600863 Email: [gift.zikalala@kznhealth.gov.za](mailto:gift.zikalala@kznhealth.gov.za)  
[www.kznhealth.gov.za](http://www.kznhealth.gov.za)

Dept.: Maintenance  
Enquires: Mr. Gift Zikalala

|      |   |                       |     |   |   |  |             |
|------|---|-----------------------|-----|---|---|--|-------------|
| 1.2  | ZITON ZP2-F2 panel  | Item                  | 8   |   |   |  |             |
| 1.3  | OPD/ Casualty panel   | Item                  | 1   |   |   |  |             |
| 1.4  | Call out points / MCP   | Item                  | 48  |   |   |  |             |
| 1.5  | Relay   | Item                  | 17  |   |   |  |             |
| 1.6  | Smoke detector  | Item                  | 380 |   |   |  |             |
| 1.7  | In ceiling smoke detector   | Item                  | 53  |   |   |  |             |
| 1.8  | Smoke detector sounder base   | Item                  | 64  |   |   |  |             |
| 1.9  | Sounder base only   | Item                  | 7   |   |   |  |             |
| Item | DESCRIPTION   | UNIT                  | QTY | R | c |  | Total Prize |
| 1.10 | Replace batteries   | item                  | 4   |   |   |  |             |
| 1.11 | 2.13. Battery operation test ( see 2.13 on the servicing specification)   | item                  | 16  |   |   |  |             |
| 2    | <b>2</b> Servicing according to the attached specification and check list |                       |     |   |   |  |             |
| 2.1  | Printer test ( see 2.8 on the servicing specification)                    | Fire detecting system | 13  |   |   |  |             |
| 2.2  | Check that LED's are operating by carrying out a lamp test                | Fire detecting system | 14  |   |   |  |             |

Signature of the bidder: \_\_\_\_\_



**health**

Department:  
Health  
PROVINCE OF KWAZULU-NATAL

Rietvllei Hospital  
Private Bag x 501, Starfords Post, 4686  
Tel: 039 2605235 Fax: 039 2600863 Email: gift.zikalala@kznhealth.gov.za  
www.kznhealth.gov.za

Dept.: Maintenance  
Enquires: Mr. Gift Zikalala

|              |  |                        |    |  |  |  |
|--------------|--|------------------------|----|--|--|--|
| <b>2.3</b>   | Check and test all the ancillary functions of the fire panel.  | Fire detecting system  | 14 |  |  |  |
| <b>2.4</b>   | Test the panel controls and check that all controls and keys functions,  | Fire protection system | 14 |  |  |  |
| <b>2.5</b>   | Test and monitor earth leakage on systems with the earth leakage monitoring enabled.   | Fire detecting system  | 14 |  |  |  |
| <b>2.6</b>   | General Servicing according to RSA standards, attached check list and specification and issuing of the certificate of compliance for the whole system. | Fire detecting system  | 14 |  |  |  |
| <b>TOTAL</b> |  |                        |    |  |  |  |

**A. Functionality evaluation Criteria. The threshold is 80% of the 100 points as follows.**

| Evaluation Criteria   | Deliverables  | Points | points | Sub criteria  | Sub points scoring  | Sub point           |
|---|---|--------|--------|---|---|---------------------|
| 1 Work Experience   | Submission of proof of similar work / jobs completed form last year to date.  | 50     | points | Submission of completion certificate, order numbers and contacts where job/s of the same magnitude was done for verification. | Proof of 5 or more jobs done<br>10 points per job of the same magnitude completed successful (maximum of 50 if 5 or more jobs done).<br>None  | 50<br>10 to 40<br>0 |
| 2 Availability of qualified and SAQCC registered servicemen | Submission of relevant and legal certificate of trade and proof of SAQCC registration.                              | 30     | points | Submission of relevant and legal certificate of trade and proof of SAQCC registration for verification.                       | Certificate of trade and proof of SAQCC Registration as an Authorised Refrigeration Practitioner under the correct category.<br>Relevant , legal qualification for the serviceman who will be doing a job<br>none | 30<br>10<br>0       |
| 3 Proof of CIDB registration and letter of good standing    | CIDB and letter of good standing from department of Labour  | 10     | points | Submission of CIDB and letter of good standing from department of Labour  | CIDB category EB<br>None<br>Letter of good standing<br>none   | 5<br>0<br>5<br>0    |
| 4 Locality  | Submission of proof of location (physical addresses of the tender's premises ) and the distance away from all sites | 10     |        | Submission of proof of location (physical addresses of the tender's premises ) and the distance away from all sites           | Distance not more than 30Km from furthest site.<br>Distance is 31km to 100km from the furthest site.<br>Distance is above 100km from the furthest site.   | 10<br>5<br>0        |

**TENDER EVALUATION CRITERIA AND SCORING PRICE AND BBBEE**

| Evaluation Criteria                            | Deliverables   | Points | Points |
|--|--|--------|--------|
| Price  | The lowest responsive and responsible priced offer shall be allocated 80 points. All other responsive and responsible offers shall be allocated a prorated point value based on the lowest responsive and responsible priced offer.                            | 80     | Points |
| Broad Based Black Economic Empowerment (BBBEE) | The points allocated to each tenderer for Broad Based Black Economic Empowerment shall be based on the Broad Based Black Economic Empowerment Scorecard. In this regard, the points score for this criteria for each tenderer, shall be determined as follows: | 20     | Points |
|  | • Level 1 Contributor  | 20     | Points |
|  | • Level 2 Contributor  | 18     | Points |
|  | • Level 3 Contributor  | 14     | Points |
|  | • Level 4 Contributor  | 12     | Points |
|  | • Level 5 Contributor  | 8      | Points |
|  | • Level 6 Contributor  | 6      | Points |
|  | • Level 7 Contributor  | 4      | Points |
|  | • Level 8 Contributor  | 2      | Points |
|  | • Non-Compliant Contributor  | 0      | Points |

Sr

Signature of the bidder: \_\_\_\_\_



- 2.4. Service provider must submit a detailed quotation of other repairs required using a quotation template as stated in item number one.
- 2.5. A detailed report upon completion of a maintenance visit must be provided, which will include each fire alarm system efficiency evaluation report.
- 2.6. **The attached check list must be filled accurately on site on present of our maintenance officer and returned. Payments will not be done if the check lists are not fully completed for each fire alarm system.**
- 2.7. Return all the pages and sign each and every page
- 2.8. Printer:
  - 2.8.1. Service provider must ensure that a printer/s is/are available which will be able to be connected to our panel before submitting a quotation for this job.
  - 2.8.2. Take a print out of all the sensors that are in service and state your findings.
  - 2.8.3. Generate printed reports of device analogue values and compare these values to the permitted values for each point and state your findings.
  - 2.8.4. Connect a planner to the panel and print out a complete system configuration from the panel software. Compare this to the system specification and verify that the system zoning, input-output mapping, and other settings have not been changed.
  - 2.8.5. Make sure that the printer is printing all events during the service.
- 2.9. To operate a manual call point use the Test Key. To operate a detector, use a smoke generator or heat source as appropriate to the type of detector.
- 2.10. Battery replacement: the battery should be clearly label with the date of installation and scheduled replacement date.
- 2.11. If any defects are discovered during the testing, they should be recorded in the log book and action taken to have them fixed.
- 2.12. Any servicing / corrective action that has been omitted from the check list should be noted and carried out during the service.
- 2.13. Battery operation test:
  - 2.13.1. Check that the battery is healthy. One method is to conduct an 'all-sounders on' operational test with the mains off and the system running on the batteries. This will test the batteries under full load. The battery voltage should be monitored during this test and should not fall below 24 volts.
  - 2.13.2. Remove one terminal and verify that the system reports a battery fault. Replace terminal, ensure that it is tight, and reset the panel.
  - 2.13.3. Clean the battery with damp cloth and lightly lubricate any exposed terminals with petroleum jelly if necessary.
- 2.14. Input-output configuration:
  - 2.14.1. Verify by testing that the input-output mapping operates as programmed.
  - 2.14.2. Activate an input, such as a sensor, call point or interface unite, and verify that the correct outputs operate.
  - 2.14.3. Check that outputs function correctly, for example, that they pulse, or operate continuously, that any delays operate correctly.
- 2.15. Building changes check
  - 2.15.1. Visually check that the internal structural layout of the building, including inter-office / wards partitioning, has not changed from the system specification to such an extent that it may affect the efficient operation of the fire alarm system.





OPD/Casualty panel

## Devices and panels that must be serviced and batteries that needs to be replaced

| Panel type   | Designation            | Call point/MCP | Relay | Smoke detector | In ceiling smoke detector | Smoke detector base | Sounder base only | Replace Batteries. Yes/No |
|--------------|------------------------|----------------|-------|----------------|---------------------------|---------------------|-------------------|---------------------------|
| ZITON ZP2-F2 | Res 1bed flats.        | 4              | 1     | 12             | 4                         | 12                  | 0                 | NO                        |
|              | Res 2bed flats.        | 4              | 1     | 24             | 4                         | 12                  | 0                 | NO                        |
| ZITON ZP2-F2 | Res 3bed flats.        | 6              | 1     | 54             | 12                        | 18                  | 0                 | NO                        |
| ZITON ZP2-F2 | Res 4bed Flats.        | 6              | 1     | 60             | 5                         | 15                  | 0                 | NO                        |
| ZITON ZP2-F1 | Security Gatehouse     | 0              | 1     | 0              | 0                         | 0                   | 0                 | NO                        |
| ZITON ZP2-F1 | Philani gateway clinic | 2              | 2     | 39             | 0                         | 4                   | 2                 | NO                        |
| ZITON ZP3    | Surgical ward male     | 1              | 1     | 13             | 0                         | 1                   | 0                 | NO                        |
| ZITON ZP3    | Surgical ward female   | 2              | 1     | 22             | 5                         | 2                   | 1                 | NO                        |



| Panel type         | Designation             | Call point/MCP | Relay | Smoke detector | In ceiling smoke detector | Smoke detector base | Sounder base only | Replace Batteries. Yes/No |
|--------------------|-------------------------|----------------|-------|----------------|---------------------------|---------------------|-------------------|---------------------------|
| ZITON ZP3          | Female med &Physio      | 4              | 1     | 12             | 6                         | 4                   | 0                 | NO                        |
| ZITON ZP3          | Male Med                | 2              | 1     | 13             | 5                         | 2                   | 0                 | YES                       |
| ZITON ZP3          | Maternity               | 3              | 1     | 35             | 12                        | 6                   | 1                 | YES                       |
| ZITON ZP3          | Theatre                 | 2              | 1     | 21             | 1                         | 3                   | 3                 | NO                        |
| ZITON ZP3          | Laboratory              | 2              | 1     | 12             | 2                         | 2                   | 0                 | NO                        |
| ZITON ZP3          | Main pharmacy/Ground FL | 4              | 1     | 22             | 4                         | 5                   | 0                 | NO                        |
| OPD/Casualty panel | OPD/Casualty            | 6              | 1     | 33             | 2                         | 6                   | 0                 | Yes                       |
| ZITON ZP3          | Pediatric ward          | 3              | 1     | 18             | 1                         | 1                   | 0                 | YES                       |
| ZITON ZP3          | High care               | 1              | 1     | 2              | 0                         | 1                   | 0                 | NO                        |

**PROVINCE OF KWAZULU-NATAL  
PREVENTIVE MAINTENANCE CHECK LIST**

**TYPE OF SERVICE** : **FIRE DECTECTING EQUIPMENT**  
**SCHEDULE FOR** : **SERVICE**  
**SCHEDULE FREQUENCY** : **annually**

**INSTALLATION NAME** : **REF** :

**SERVICE PROVIDER** : **ORDER No.** :

| <b>SERVICE</b> |   | <b>RUNNING REPAIRS</b> |                   | <b>OTHER REPAIRS REQUIRED<br/>SUBMIT A DETAILED QUOTATION</b> |  |
|----------------|---|------------------------|-------------------|---|--|
| <b>ITEM</b>    | <b>INSTRUCTION: CHECK, ADJUST, CLEAN AS REQUIRED (FILL)</b>                                       | <b>IN ORDER</b>        | <b>TIME TAKEN</b> | <b>DESCRIPTION OF SPARES &amp; ACCESSORIES USED</b>           | <b>DESCRIPTION OF OTHER REPAIRS REQUIRED</b> |
| 1.             | Printer test  |                        |                   |   |  |
| 2.             | CHECK that LED'S are operating by carrying out a lamp test  |                        |                   |   |  |
| 3.             | Test every manual call point,   |                        |                   |   |  |
| 4.             | Test all the detectors  |                        |                   |   |  |
| 5.             | Confirm operation of the sounders and identify any area of poor audibility                        |                        |                   |   |  |
| 6.             | Confirm the operation of auxiliary items such as door closers                                     |                        |                   |   |  |
| 7.             | Replace battery as required and /or do the load test. Check battery operation.                    |                        |                   |   |  |
| 8.             | Test the function of all the control and indicating equipment by operating a device in each zone. |                        |                   |   |  |
| 9.             | Check and test all the ancillary functions  |                        |                   |   |  |



| ITEM | INSTRUCTION: CHECK, ADJUST, CLEAN AS REQUIRED (F/III)   | IN ORDER | TIME TAKEN | DESCRIPTION OF SPARES & ACCESSORIES USED | DESCRIPTION OF OTHER REPAIRS REQUIRED |
|------|---|----------|------------|--|---------------------------------------|
|      | of the fire panel.  |          |            |  |                                       |
| 10.  | Test the panel controls and check that all controls and keys functions,   |          |            |  |                                       |
| 11.  | Test and monitor earth leakage on systems with the earth leakage monitoring enabled.  |          |            |  |                                       |
| 12.  | All fault indicators and their circuits should be checked by simulation of the fault condition.   |          |            |  |                                       |
| 13   | Check connections and ensure that all terminals are tight and cables inside the panel are secured.  |          |            |  |                                       |
| 14   | Do the inspection to confirm that all cable fittings and equipment are secured, undamaged and adequately protected.   |          |            |  |                                       |
| 15   | Ensure that the fire alarm panel configuration complies with the Panel Configuration. Any changes should be verified with the Chief Artisan and the panel configuration record updated if the changes are authorized. |          |            |  |                                       |
| 16.  | Test input-output configuration.  |          |            |  |                                       |
| 17.  | Verify that the standby power is sufficient to for the system and make sure that the battery installed is sufficient to meet the system specifications.   |          |            |  |                                       |
| 18.  | Clean the panel exterior and interior   |          |            |  |                                       |
| 19.  | Set correct time and date on the panel.   |          |            |  |                                       |
| 20.  | Check building changes  |          |            |  |                                       |
| 21.  | Record any defects in the log book and report to the Chief Artisan.   |          |            |  |                                       |
| 22.  | Restore the system to normal condition  |          |            |  |                                       |





Rietvlei Hospital  
Private Bag X 501, Stratford, Post. 4686  
Tel: 039 2605235 Fax: 039 2600863 Email: gift.zikalala@kznhealth.gov.za  
www.kznhealth.gov.za

Dept.: Maintenance  
Enquires: Mr. Gift Zikalala

**SCHEDULE OF RATES**

**WORK TO BE DONE AND SCHEDULE OF RATES:**

| Item       | DESCRIPTION  | UNIT | QTY | RATE/UNIT | Total Prize |
|------------|--|------|-----|-----------|-------------|
|            | <b>NOTE:</b><br>1). All rates for items contained in this Schedule of Rates must be computed excluding the applicable Value Added Tax.<br>2). The Department of Health reserves the right to Negotiate rates in the Bill of Quantities.<br>3). All rubble shall be removed from site and suitably disposed of. |      |     | R         | c           |
|            | <b>INSTITUTION: RIETVLEI HOSPITAL</b>  |      |     |           |             |
|            | All rates quoted shall be inclusive of transport, labour and profit. All relevant mark-ups for specialist shall be included. The Bidder is advised that the Institution is fully functional and Occupied and disruptions to services are to be kept to the bare minimum.                                       |      |     |           |             |
| <b>1</b>   | <b>Servicing of devices and panels according to the attached specification and check list</b>  |      |     |           |             |
| <b>1.1</b> | <b>ZITON ZP2-F2 panel</b>  | Item | 5   |           |             |



|      |   |                       |     |   |   |  |             |
|------|---|-----------------------|-----|---|---|--|-------------|
| 1.2  | ZITON ZP2-F2 panel  | Item                  | 8   |   |   |  |             |
| 1.3  | OPD/ Casualty panel   | Item                  | 1   |   |   |  |             |
| 1.4  | Call out points / MCP   | Item                  | 48  |   |   |  |             |
| 1.5  | Relay   | Item                  | 17  |   |   |  |             |
| 1.6  | Smoke detector  | Item                  | 380 |   |   |  |             |
| 1.7  | In ceiling smoke detector   | Item                  | 53  |   |   |  |             |
| 1.8  | Smoke detector sounder base   | Item                  | 64  |   |   |  |             |
| 1.9  | Sounder base only   | Item                  | 7   |   |   |  |             |
| Item | DESCRIPTION   | UNIT                  | QTY | R | c |  | Total Prize |
| 1.10 | Replace batteries   | item                  | 4   |   |   |  |             |
| 1.11 | 2.13. Battery operation test ( see 2.13 on the servicing specification)   | item                  | 16  |   |   |  |             |
| 2    | <b>2 Servicing according to the attached specification and check list</b> |                       |     |   |   |  |             |
| 2.1  | Printer test ( see 2.8 on the servicing specification)                    | Fire detecting system | 13  |   |   |  |             |
| 2.2  | Check that LED's are operating by carrying out a lamp test                | Fire detecting system | 14  |   |   |  |             |