

It is stipulated that youth workers on the EPWP receive a minimum of R 1 000 per month whilst working and R 600 per month whilst on training in ALL provinces. Should EPWP beneficiary be attending training whilst employed by the contractor, the contractor will still be responsible for payment to the EPWP beneficiary whilst at training.

SL 11 MEASUREMENTS AND PAYMENT

The number of EPWP beneficiary specified for this contract that will receive life skills training is 50 and technical training is 50

**SL 11.01 PAYMENT FOR TRAINING OF EPWP BENEFICIARY
(TARGET:- 50 EPWP BENEFICIARY)**

**SL 11.01.01 Skills development and Technical training for EPWP beneficiary for an average of 10 days
.....(Prov.Sum).....Unit: R/EPWP beneficiary**

The above item is only applicable if DoL does not fund the Technical Training PRIOR to site handover.

**SL 11.01.02 Penalty due to not meeting the target as in
SL 11.01.01.....Unit: EPWP beneficiary
LESS R 2000 per EPWP beneficiary**

SL 11.02 PAYMENT FOR TRAVELLING AND ACCOMMODATION DURING OFF-SITE TRAINING

SL 11.02.01 Life skills training for 26 days:

- 01 Travelling (based on 50 km/EPWP beneficiary)Unit: km
- 02 Accommodation.....(Prov.Sum).....Unit: R/EPWP beneficiary
- 03 Profit and attendance..... Unit: %

SL 11.02.02 Skilled development and Technical training:

- 01 Travelling (based on 50 km/EPWP beneficiary).....Unit: km
- 02 Accommodation.....(Prov.Sum).....Unit: R/EPWP beneficiary
- 03 Profit and attendance Unit: %

The units of measurement for sub items SL 11.02.01 (01) and SL 11.02.02 (01) above shall be the distance travelled in km by the EPWP beneficiary trained off site. The tendered rate shall include full compensation to safely transport the youth workers to and from the training venue/s.

The unit of measurement for sub items SL 11.02.01 (02) and SL 11.02.02 (02) above shall be the amounts in Rand expended for accommodation and daily meal allowances for the EPWP beneficiary trained off site that must be arranged by the contractor. Amounts quoted shall be corrected according to re-measurement based on actual invoices.

The tendered percentages under sub items SL 11.02.01 (03) and SL 11.02.02 (03) will be paid to the contractor on the value of each payment pertaining to the accommodation and advance meal allowances to cover his expenses in this regard.

SL 11.03 ALTERNATIVE WORKERS FOR THE PERIOD OF OFF-SITE TRAINING

SL 11.03.01 Life skills training for 26 days Unit: worker-days

**SL 11.03.02 Skilled development and Technical training for EPWP beneficiary for (.....)
days..... Unit: worker-days**

The unit of measurement shall be the number of EPWP beneficiary replaced while in training multiplied by the number of days absent from the site.

The rates tendered shall include full compensation for additional replacement labour during periods of off-site training.

SL 11.04 EMPLOYMENT OF EPWP BENEFICIARY

SL 11.04.01 Employment of EPWP beneficiary.....(Prov.Sum)¼.Unit: R/ worker-month

SL 11.04.02 Employment of EPWP beneficiary.....(Prov.Sum)¼.Unit: R/ worker-month

The unit of measurement shall be the number of EPWP beneficiary at the statutory labour rates of R multiplied by the period employed in months and the rate tendered shall include full compensation for all costs associated with the employment of EPWP beneficiary and for complying with the conditions of contract. The cost for the training shall be excluded from this item. This item is based on 6 months appointment for EPWP beneficiary.

SL 11.05 PROVISION OF EPWP DESIGNED OVERALLS TO EPWP BENEFICIARY

SL 11.05.01 Supply EPWP designed overalls to EPWP beneficiary
(Prov.Sum).....Unit: R

EPWP beneficiary overalls should be orange (top and bottom) as per EPWP specification with the exception of Correctional Services contracts where the EPWP beneficiary top would be blue and the bottom orange.

SL 11.05.02 Profit and attendance..... Unit: %

An amount has been provided in the Schedule of Quantities under sub item SL 10.05.01 for the supply of EPWP designed overalls, as per the specification provided by the EPWP unit, arranged by the Service Provider. The Engineer will have sole authority to spend the amounts or part thereof. The tendered percentage under sub items SL 10.05.02 will be paid to the contractor on the value of each payment pertaining to the supply of overalls to cover his expenses in this regard.

SL 11.06 PROVISION OF SMALL TOOLS FOR EPWP BENEFICIARY

SL 11.06.01 Provide all EPWP beneficiary with prescribed tools for their respective trades. Specification for the mentioned tools to be provided by the EPWP Service Provider. These tools will become the property of the EPWP beneficiary after the completion of the programme.....(Prov.Sum)....Unit: R 500-00 /youth worker

SL 11.06.02 Profit and attendance..... Unit: %

SL 11.07 APPOINTMENT OF EPWP BENEFICIARY TEAM LEADER/S

SL 11.07.01 Appointment of () EPWP beneficiary team leader/s for the duration of the contract.....(Prov.Sum)..... Unit: R / EPWP beneficiary team leader

The EPWP beneficiary Team Leader will act as CLO/PLO to facilitate the project work between the EPWP beneficiary and the contractor. Umsobumvu Youth Fund can assist with the sourcing of EPWP beneficiary Team Leader for employment by the contractor.

SL 11.08 LIAISON WITH SERVICE PROVIDER.....Unit: hours

The tendered rate shall include full compensation for the cost of liaising with the Service Provider and Social Facilitators on all issues regarding the works.

PAGE NO	ITEM NO	DESCRIPTION	UNIT	QUANTITY	RATE	AMOUNT
1		<u>BILL NO 2</u>				
1		<u>EMPLOYMENT AND TRAINING OF LABOUR ON THE EPWP BENEFICIARY INFRASTRUCTURE PROJECTS</u>				
1		<u>PREAMBLES</u>				
1		Tenderers are advised to study the Additional Specification SL: Employment and training of Labour on the Expanded Public Works Programme (EPWP) Infrastructure Projects as bound elsewhere in the Bills of Quantities and then price this Bill accordingly				
1		<u>TRAINING OF EPWP BENEFICIARY</u>				
1		(TARGET: 50 EPWP BENEFICIARY)				
1		Skills development and Technical training:				
1	1	Skills development and technical training for EPWP beneficiary for an average of 10 days (ref. SL11.01.01)	Item	1		
1	2	Penalty due to not meeting the target as in SL 11.01.02	Y/Work	R 2 000.00		
1		<u>TRAVELLING AND ACCOMMODATION DURING OFF SITE TRAINING:</u>				
1		Life skills training for 26 days (ref. SL 11.02.01)				
1	3	Travelling (based on 50km/EPWP beneficiary)	km	2500		
1	4	Profit and attendance on Items 1, 2 & 3	%			
1		<u>EMPLOYMENT OF EPWP BENEFICIARY</u>				
1	5	Employment of EPWP beneficiary (30 youth) (New Office Block)	Item	1		
1		The unit of measurement shall be the number of EPWP beneficiary at the statutory labour rates of R 100/day multiplied by the period employed in months and the rate tendered shall include full compensation for all costs associated with the employment of EPWP beneficiary and for complying with the conditions of contract. The cost for training shall be excluded from this item. This item is based on 6 months appointment for EPWP beneficiary				
1	6	Employment of EPWP beneficiary(40 youth) (Parking garage)	Item	1		
		TOTAL CARRIED TO SUMMARY				

		UNIT	QUANTITY	RATE	AMOUNT
2	<p>The unit of measurement shall be the number of EPWP beneficiary at the statutory labour rates of R 110/day multiplied by the period employed in months and the rate tendered shall include full compensation for all costs associated with the employment of EPWP beneficiary and for complying with the conditions of contract. The cost for training shall be excluded from this item.</p> <p>This item is based on 12 months appointment for EPWP beneficiary</p>				
2	7	Employment of EPWP beneficiary (30 youth) [Conference Centre & Canteen]	Item	1	
2	<p>The unit of measurement shall be the number of EPWP beneficiary at the statutory labour rates of R 120/day multiplied by the period employed in months and the rate tendered shall include full compensation for all costs associated with the employment of EPWP beneficiary and for complying with the conditions of contract. The cost for training shall be excluded from this item.</p> <p>This item is based on 12 months appointment for EPWP beneficiary</p>				
2	<u>PROVISION OF EPWP DESIGNED OVERALLS TO YOUTH WORKERS</u>				
2	8	Supply EPWP designed overalls to EPWP beneficiary (ref. SL 11.05.01) for 100 workers	Item	1	
2	9	Profit and attendance on Items 5 - 8 (ref. SL 11.05.02)	%	7.5	
2	<u>PROVISION OF SMALL TOOLS FOR EPWP BENEFICIARY</u>				
2	10	Supply of small tools to EPWP beneficiary. Specification to be supplied by the EPWP-NYS Serviced Provider for the respective trades (ref. SL 11.06.01) for 100 workers	Item	1	
2	11	Profit and attendance (ref. SL 11.06.02)	%	7.5	
2	<u>APPOINTMENT OF YOUTH TEAM LEADERS</u>				
2	12	Appointment of EPWP beneficiary Team Leaders for the duration of the contract (ref. SL 11.07)	Item	1	
2	13	Liaison with Service Provider (ref. SL 11.08)	Hrs	30	
2	14	Profit and attendance on Items 12 & 13	%	7.5	
FINAL TOTAL CARRIED TO PRELIMINARY AND GENERAL IN BILL OF QUANTITIES					

SCOPE OF WORKS IN RESPECT OF WORK RELATING TO THE EXTENDED PUBLIC WORKS PROGRAMME (EPWP)			
Project title:	Wentworth Hospital - Replacement of Existing Security Fence		
Project Code:	0	EPWP NO:	N/A

Introductory notes:

1. The works, or parts of the works will be constructed using labour-intensive methods only in terms of this specification. The use of plant to provide such works, other than plant specifically provided for in the scope of work, is a variation to the contract. The items marked with the letters LI are not necessarily an exhaustive list of all the activities which must be done by hand, and this clause does not over-ride any of the requirements in the generic labour intensive specification in the Scope of Works.
2. Payment for items which are designated to be constructed labour-intensively (either in this schedule or in the Scope of Works) will not be made unless they are constructed using labour-intensive methods. Any unauthorised use of plant to carry out work which was to be done labour-intensively will not be condoned and any works so constructed will not be certified for payment.

DESCRIPTION OF THE WORKS

Employer's objectives

The employer's objectives are to deliver public infrastructure using labour-intensive methods in accordance with EPWP Guidelines.

Labour-intensive works

Labour-intensive works comprise the activities described in the Labour-Intensive Specification. Labour-intensive works shall be constructed/maintained using local workers who are temporarily employed in terms of the scope of work.

LABOUR-INTENSIVE COMPETENCIES OF SUPERVISORY AND MANAGEMENT STAFF

Contractors shall only engage supervisory and management staff in labour-intensive works that have completed the skills programme including Foremen/ Supervisors at NQF level 4 "National Certificate: Supervision of Civil Engineering Construction Processes" and Site Agent/ Manager at NQF level 5 "Manage Labour-Intensive Construction Processes" or equivalent QCTO qualifications (See Appendix C), at NQF outlined in Table 1. (See GUIDELINES FOR THE IMPLEMENTATION OF LABOUR-INTENSIVE INFRASTRUCTURE PROJECTS UNDER THE EXPANDED PUBLIC WORKS PROGRAMME (EPWP) -THIRD EDITION 2015)

Emerging contractors shall have personally completed, or be registered on a skills programme for the NQF level 2 unit standard. All other site supervisory staff in the employ of emerging contractors must have completed, or be registered on a skills programme for the NQF level 2 unit standards or NQF level 4 unit standards. Table 1: Skills programme for supervisory and management staff.

Table 1: Skills programme for supervisory and management staff

Personnel	NQF level	Unit standard titles	Skills programme description
Team leader / supervisor	2	Apply Labour-Intensive Construction Systems and Techniques to Work Activities	This unit standard must be completed, and any one of these 3 unit standards
		Use Labour-Intensive Construction Methods to Construct and Maintain Roads and Storm water Drainage	
		Use Labour-Intensive Construction Methods to Construct and Maintain Water and Sanitation Services	
		Use Labour-Intensive Construction Methods to Construct, Repair and Maintain structures	

Personnel	NQF level	Unit standard titles	Skills programme description
Foreman/supervisor	4	Implement Labour-Intensive Construction Systems and Techniques	This unit standard must be completed, and any one of these 3 unit standards
		Use Labour-Intensive Construction Methods to Construct and Maintain Roads and Storm water Drainage	
		Use Labour-Intensive Construction Methods to Construct and Maintain Water an Sanitation Services	
		Use Labour-Intensive Construction Methods to Construct, Repair and Maintain structures	
Site Agent /Manager (i.e. the contractor's most senior representative that is resident on the site)	5	Manage Labour-Intensive Construction Processes	Skills Programme against this single unit standard
Details of these skills programmes may be obtained from the CETA ETQA manager (e-mail :gerard@ceta.co.za , tel: 011-265 5900)			

EMPLOYMENT OF UNSKILLED AND SEMI-SKILLED WORKERS IN LABOUR-INTENSIVE WORKS

- 1.1 Requirements for the sourcing and engagement of labour.
 - 1.1.1 Unskilled and semi-skilled labour required for the execution of all labour-intensive works shall be engaged strictly in accordance with prevailing legislation and SANS 1914-5, Participation of Targeted Labour.
 - 1.1.2 The rate of pay set for the SPWP per task or per day will be an acceptable rate determined by the Department of Labour.
 - 1.1.3 Tasks established by the contractor must be such that:
 - a) the average worker completes 5 tasks per week in 40 hours or less; and
 - b) the weakest worker completes 5 tasks per week in 55 hours or less.
 - 1.1.4 The contractor must revise the time taken to complete a task whenever it is established that the time taken to complete a weekly task is not within the requirements of 1.1.3.
 - 1.1.5 The Contractor shall, through all available community structures, inform the local community of the labour-intensive
 - a) where the head of the household has less than a primary school education;
 - b) that have less than one full time person earning an income;
 - c) where subsistence-agriculture is the source of income.
 - d) that who are not in receipt of any social security pension income
 - 1.1.6 The Contractor shall endeavour to ensure that the expenditure on the employment of unskilled and semi-skilled workers is in the following proportions:
 - a) 55% women;
 - b) 55% youth who are between the ages of 18 and 35; and
 - c) 2% on persons with disabilities.

- 1.2 Specific provisions pertaining to SANS 1914-5
- 1.2.1 Definitions
Targeted labour: Unemployed persons who are employed as local labour on the project.
- 1.2.2 Contract participation goals
- 1.2.2.1 There is no specified contract participation goal for the contract. The contract participation goal shall be measured in the performance of the contract to enable the employment provided to targeted labour to be quantified.
- 1.2.2.2 The wages and allowances used to calculate the contract participation goal shall, with respect to both time-rated and task rated workers, comprise all wages paid and any training allowance paid in respect of agreed training programmes.
- 1.2.3 Terms and conditions for the engagement of targeted labour
Further to the provisions of clause 3.3.2 of SANS 1914-5, written contracts shall be entered into with targeted labour.
- 1.2.4 Terms and conditions for the engagement of targeted labour
Further to the provisions of clause 3.3.2 of SANS 1914-5, written contracts shall be entered into with targeted labour.
- 1.2.5 Variations to SANS 1914-5
- 1.2.5.1 The definition for net amount shall be amended as follows:
Financial value of the contract upon completion, exclusive of any value added tax or sales tax which the law requires the employer to pay the contractor.
- 1.2.5.2 The schedule referred to in 5.2 shall in addition reflect the status of targeted labour as women, youth and persons with disabilities and the number of days of formal training provided to targeted labour.
- 1.3 Training of targeted labour
- 1.3.1 The contractor shall provide all the necessary on-the-job training to targeted labour to enable such labour to master the basic work techniques required to undertake the work in accordance with the requirements of the contract in a manner that does not compromise worker health and safety.
- 1.3.2 The cost of the formal training of targeted labour, will be funded by the local office of the Department of Labour. This training will take place as close to the project site as practically possible. The contractor must access this training by informing the relevant regional office of the Department of Labour in writing, within 14 days of being awarded the contract, of the likely number of persons that will undergo training and when such training is required. The Employer and the Department of Public Works (Fax: 012 3258625/ EPWP Unit, Private Bag X65, Pretoria 0001) must be furnished with a copy of this request.
- 1.3.3 The contractor shall do nothing to dissuade targeted labour from participating in training programmes and shall take all reasonable steps to ensure that each beneficiary is provided with two days of formal training for every 22 days worked.
- 1.3.4 An allowance equal to 100% of the task rate or daily rate shall be paid by the contractor to workers who attend formal training, in terms of the above.
- 1.3.5 Proof of compliance with the above requirements must be provided by the Contractor to the Employer prior to submission of the final payment certificate.

GENERIC LABOUR-INTENSIVE SPECIFICATION

1 Scope

This specification establishes general requirements for activities which are to be executed by hand involving the following:

- a) trenches having a depth of less than 1.5 metres
- b) storm water drainage
- c) low-volume roads and sidewalks

2 Precedence

Where this specification is in conflict with any other standard or specification referred to in the Scope of Works to this Contract, the requirements of this specification shall prevail.

3 Hand excavateable material

Hand excavateable material is material:

a) Granular materials:

- i) whose consistency when profiled may in terms of table 1 be classified as very loose, loose, medium dense, or dense; or
- ii) where the material is a gravel having a maximum particle size of 10mm and contains no cobbles or isolated boulders, no more than 15 blows of a dynamic cone penetrometer is required to penetrate 100mm;

b) Cohesive materials:

- i) whose consistency when profiled may in terms of table 1 be classified as very soft, soft, firm, stiff and stiff / very stiff; or
- ii) where the material is a gravel having a maximum particle size of 10mm and contains no cobbles or isolated boulders, no more than 8 blows of a dynamic cone penetrometer is required to penetrate 100mm;


Note: 1) A boulder, a cobble and gravel is material with a particle size greater than 200mm, between 60 and 200mm.

2) A dynamic cone penetrometer is an instrument used to measure the in-situ shear resistance of a soil comprising a drop weight of approximately 10 kg which falls through a height of 400mm and drives a cone having a maximum diameter of 20mm (cone angle of 60 degrees with respect to the horizontal) into the material being used.

Table 2: Consistency of materials when profiled

GRANULAR MATERIALS		COHESIVE MATERIALS	
CONSISTENCY	DESCRIPTION	CONSISTENCY	DESCRIPTION
Very loose	Crumbles very easily when scraped with a geological pick.	Very soft	Geological pick head can easily be pushed in as far as the shaft of the handle.
Loose	Small resistance to penetration by sharp end of a geological pick.	Soft	Easily dented by thumb; sharp end of a geological pick can be pushed in 30-40 mm; can be moulded by fingers with some pressure.
Medium dense	Considerable resistance to penetration by sharp end of a geological pick.	Firm	Indented by thumb with effort; sharp end of geological pick can be pushed in upto 10 mm; very difficult to mould with fingers; can just be penetrated with an ordinary hand spade.
Dense	Very high resistance to penetration by the sharp end of a geological pick; requires many blows for excavation.	stiff	Can be indented by thumb-nail; slight indentation produced by pushing geological pick point into soil; cannot be moulded by fingers.
Very dense	High resistance to repeated blows of a geological pick.	Very stiff	Indented by thumb-nail with difficulty; slight indentation produced by blow of a geological pick point.

- 4 **Trench excavation**
 All hand excavateable material in trenches having a depth of less than 1,5 metres shall be excavated by hand.
- 5 **Compaction of backfilling to trenches (areas not subject to traffic)**
 Backfilling to trenches shall be placed in layers of thickness (before compaction) not exceeding 100mm. Each layer shall be compacted using hand stampers
- to 90% Proctor density;
 - such that in excess of 5 blows of a dynamic cone penetrometer (DCP) is required to penetrate 100 mm of the backfill, provided that backfill does not comprise more than 10% gravel of size less than 10mm and contains no isolated boulders, or
 - such that the density of the compacted trench backfill is not less than that of the surrounding undisturbed soil when tested comparatively with a DCP.
- 6 **Excavation**
 All hand excavateable material including topsoil classified as hand excavateable shall be excavated by hand. Harder material may be loosened by mechanical means prior to excavation by hand.
 The excavation of any material which presents the possibility of danger or injury to workers shall not be excavated by hand.
- 7 **Clearing and grubbing**
 Grass and small bushes shall be cleared by hand.
- 8 **Shaping**
 All shaping shall be undertaken by hand.
- 9 **Loading**
 All loading shall be done by hand, regardless of the method of haulage.
- 10 **Haul**
 Excavation material shall be hauled to its point of placement by means of wheelbarrows where the haul distance is not greater than 150 m.
- 11 **Offloading**
 All material, however transported, is to be off-loaded by hand, unless tipper-trucks are utilised for haulage.
- 12 **Spreading**
 All material shall be spread by hand.
- 13 **Compaction**
 Small areas may be compacted by hand provided that the specified compaction is achieved.
- 14 **Grassing**
 All grassing shall be undertaken by sprigging, sodding, or seeding by hand.
- 15 **Stone pitching and rubble concrete masonry**
 All stone required for stone pitching and rubble concrete masonry, whether grouted or dry, must be collected, loaded, off loaded and placed by hand.
 Sand and stone shall be hauled to its point of placement by means of wheelbarrows where the haul distance is not greater than 150m.
 Grout shall be mixed and placed by hand.
- 16 **Manufactured Elements**
 Elements manufactured or designed by the Contractor, such as manhole rings and cover slabs, precast concrete planks and pipes, masonry units and edge beams shall not individually, have a mass of more than 320kg. In addition, the items shall be large enough so that four workers can conveniently and simultaneously acquire a proper handhold on them.

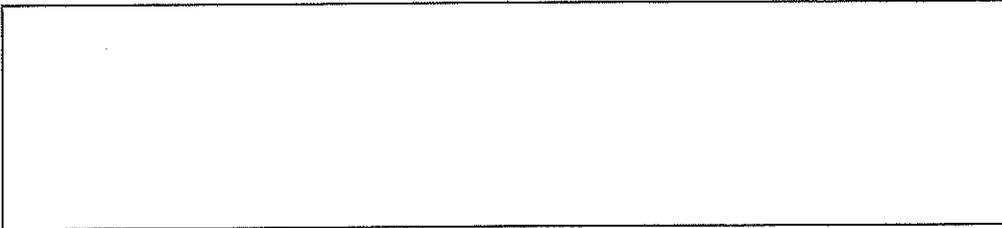

(Insert Your Company Logo)

(This shall serve as the cover page on employment contracts for local labour)

EMPLOYMENT AGREEMENT

BETWEEN

[CONTRACTOR NAME].....

AND

[WORKER NAME].....

1. PARTIES

The Parties to this Agreement are -

1.1. Contractor: _____
herein represented by: _____
duly authorised thereto

And

1.2. Mr / Me: _____
[worker's name]

2. DEFINITIONS AND INTERPRETATION

2.1. In this Agreement and any Annexure thereto, unless inconsistent with or otherwise indicated by the context-

"Agreement"	means the contents of this Agreement.
"Company"	means the company that employs the worker
"Department"	means the Department of Public Works
"Worker"	is a person that performs a specific or necessary task or who completes tasks in a certain way
"EPWP"	The Expanded Public Works Programme is a government programme aimed at the alleviation of poverty and unemployment. The programme ensures the full engagement on Labour Intensive Methods of Construction (LIC) to contractors for skills development. The EPWP focuses at reducing unemployment by increasing economic growth by means of improving skills levels through education and training and improving the enabling environment for the industry to flourish.

3. PURPOSE

The purpose of this agreement is to:-

Ensure that the agreement is binding to both the Worker and the Employer.

4. TERMS AND CONDITIONS

- The worker will have no entitlement to the benefits of a full time employee, namely;

- The worker should not have the expectation that this contract will be renewed or extended.
- The worker will be subject to all laws, rules, policies, codes and procedures applicable to the;

- The worker must meet the standards and requirements of the contractor
- The worker must render his/her services during normal working hours of minimum of forty to fifty five hours in any week; which comprise of an eight-hour working day in a five-day week.

5. REMUNERATION

The worker will receive compensation to the amount of R _____ 00 which must be paid by the 25th or on the last day of each month.

6. ROLES AND RESPONSIBILITIES

6.1 Employer / Worker

- Work for _____ in terms of the period as specified in the employment agreement contract.
- Be available for and participate in all learning and work experience required by the company.
- Comply with workplace policies and procedures.
- Complete any attendance or any written assessment tools supplied by the contractor to record relevant workplace experience.
- Demonstrate willingness to grow and learn through work experience.

Provide the following documentation to the employer,

- Certified identity document not longer than 3 months
- ID size photos
- Sign employment contract

6.2 Employer

- Employ the worker for a period specified in the agreement.
- Provide the worker with appropriate work based experience in the work environment.
- Facilitate payments of wages / stipends.
- Keep accurate records of workers.
- Where a worker/ learner is disabled, the employer will have to provide in the additional needs e.g. special materials, learning aids and in some cases physical or professional support (such aids remain the property of the employer).
- Keep up to date records of learning and discuss progress with the intern on a regular basis.
- Apply fair disciplinary, grievance and dispute resolution procedures to the worker.
- Prepare an orientation/ induction course to introduce worker/ learner to the workplace and specific workplace requirements.
- Ensure the daily attendance register is signed by the worker.

7. DURATION.

This agreement commences on: _____
and
expires on: _____

8. BREACH.

If either party commits any breach of the terms of this contract (and fails to rectify it within 30 days of receipt of a written notice calling it to do so, then) the other party shall be entitled to terminate the contract or to claim specific performance without prejudice to any of its other legal rights, including its rights to claim damages.

9. CONDITIONS OF EMPLOYMENT

9.1. Meal Breaks

9.1.1 A worker may not work for more than five hours without taking a meal break of at least thirty minutes duration.

9.1.2 An employer and worker may agree on longer meal breaks.

9.1.3 A worker may not work during a meal break. However, an employer may require a worker to perform duties during a meal break if those duties cannot be left unattended and cannot be performed by another worker. An employer must take reasonable steps to ensure that a worker is relieved of his or her duties during the meal break.

9.1.4 A worker is not entitled to payment for the period of a meal break. However, a worker who is paid on the basis of time worked must be paid if the worker is required to work or to be available for work during the meal break.

9.2. Special Conditions for Security Guards (Only applicable to security Guards)

9.2.1 A security guard may work up to 55 hours per week and up to eleven hours per day.

9.2.2 A security guard who works more than ten hours per day must have a meal break of at least one hour or two breaks of at least 30 minutes each.

9.3. Weekly Rest Period

Every worker must have two days off every week. A worker may only work on their day off to perform work which must be done without delay and cannot be performed by workers during their ordinary hours of work ("emergency work").

9.4. Work on Sundays and Public Holidays

9.4.1 A worker may only work on a Sunday or public holiday to perform emergency or security work.

9.4.2 Work on Sundays is paid at the ordinary rate of pay.

9.4.3 A task-rated worker who works on a public holiday must be paid;

- (a) the worker's daily task rate, if the worker works for less than four hours;
- (b) double the worker's daily task rate, if the worker works for more than four hours.

9.4.4 A time-rated worker who works on a public holiday must be paid

- (a) the worker's daily rate of pay, if the worker works for less than four hours on the public holiday;
- (b) double the worker's daily rate of pay, if the worker works for more than four hours on the public holiday.

9.5 Sick leave

- 9.5.1 Only workers who work more than 24 hours per month have the right to claim sick-pay in terms of this clause.
- 9.5.2 A worker who is unable to work on account of illness or injury is entitled to claim one day's paid sick leave for every full month that the worker has worked in terms of a contract.
- 9.5.3 A worker may accumulate a maximum of twelve days' sick leave in a year.
- 9.5.4 Accumulated sick-leave may not be transferred from one contract to another contract.
- 9.5.5 An employer must pay a task-rated worker the worker's daily task rate for a day's sick leave.
- 9.5.6 An employer must pay a time-rated worker the worker's daily rate of pay for a day's sick leave.
- 9.5.7 An employer must pay a worker sick pay on the worker's usual payday.
- 9.5.8 Before paying sick-pay, an employer may require a worker to produce a certificate stating that the worker was unable to work on account of sickness or injury if the worker is
- (a) absent from work for more than two consecutive days; or
 - (b) absent from work on more than two occasions in any eight-week period.
- 9.5.9 A medical certificate must be issued and signed by a medical practitioner, a qualified nurse or a clinic staff member authorised to issue medical certificates indicating the duration and reason for incapacity.
- 9.5.10 A worker is not entitled to paid sick-leave for a work-related injury or occupational disease for which the worker can claim compensation under the Compensation for Occupational Injuries and Diseases Act.

9.6 Maternity Leave

- 9.6.1 A worker may take up to four consecutive months' unpaid maternity leave.
- 9.6.2 A worker is not entitled to any payment or employment-related benefits during maternity leave.
- 9.6.3 A worker must give her employer reasonable notice of when she will start maternity leave and when she will return to work.
- 9.6.4 A worker is not required to take the full period of maternity leave. However, a worker may not work for four weeks before the expected date of birth of her child or for six weeks after the birth of her child, unless a medical practitioner, midwife or qualified nurse certifies that she is fit to do so.
- 9.6.5 A worker may begin maternity leave as follows;
- (a) four weeks before the expected date of birth; or
 - (b) on an earlier date
 - (i) if a medical practitioner, midwife or certified nurse certifies that it is necessary for the health of the worker or that of her unborn child; or
 - (ii) if agreed to between employer and worker; or
 - (c) on a later date, if a medical practitioner, midwife or certified nurse has certified that the worker is able to continue to work without endangering her health.
- 10.6 A worker who has a miscarriage during the third trimester of pregnancy or bears a stillborn child may take maternity leave for up to six weeks after the miscarriage or stillbirth.

9.7. Family responsibility leave

9.7.1 Workers, who work for at least four days per week, are entitled to three days paid family responsibility leave each year in the following circumstances;

- (a) when the employee's child is born;
- (b) when the employee's child is sick;
- (c) in the event of a death of
 - (i) the employee's spouse or life partner;
 - (ii) the employee's parent, adoptive parent, grandparent, child, adopted child, grandchild or sibling.

9.8. Keeping Records

9.8.1 Every employer must keep a written record on site for the duration of the project and three (3) year after completion records should consists of at least the following;

- (a) the worker's name and position;
- (b) copy of an acceptable worker identification
- (c) in the case of a task-rated worker the number of tasks completed by the worker;
- (d) in the case of a time-rated worker, the time worked by the worker;
- (e) payments made to each worker in a form of Proof of Payment, Payroll registers and the acknowledgement of payment receipt signed by the worker.

9.8.2 The employer must keep this record for a period of at least three years after the completion of the EPWP.

9.9. Payment

9.9.1 An employer must pay all wages at least monthly in cash or by cheque or into a bank account.

9.9.2 A worker may not be paid less than the Ministerial Determination wage rate.

9.9.3 A task-rated worker will only be paid for tasks that have been completed.

9.9.4 An employer must pay a task-rated worker within five weeks of the work being completed and the work having been approved by the manager or the contractor having submitted an invoice to the employer.

9.9.5 A time-rated worker will be paid at the end of each month.

9.9.6 Payment must be made in cash, by cheque or by direct deposit into a bank account designated by the worker.

9.9.7 Payment in cash or by cheque must take place

- (a) at the workplace or at a place agreed to by the worker;
- (b) during the worker's working hours or within fifteen minutes of the start or finish of work;
- (c) in a sealed envelope which becomes the property of the worker.

9.9.8 An employer must give a worker the following information in writing

- (a) the period for which payment is made;
- (b) the numbers of tasks completed or hours worked;
- (c) the worker's earnings;
- (d) any money deducted from the payment;
- (e) the actual amount paid to the worker.

9.9.9 If the worker is paid in cash or by cheque, this information must be recorded on the envelope and the worker must acknowledge receipt of payment by signing for it.

9.9.10 If a worker's employment is terminated, the employer must pay all monies owing to that worker within one month of the termination of employment.

9.10. Inclement weather

If no work has begun on site, and if an employee has reported for work, the employee will be paid for four hours. Should work be stopped after the first four hours, the employee will be paid for the hours worked. Where the employer has given employees notice on the previous working day that no work will be available due to inclement weather, then no payment will be made.

9.11. Deductions

- 9.11.1 An employer may not deduct money from a worker's payment unless the deduction is required in terms of a law.
- 9.11.2 An employer must deduct and pay to the SA Revenue Services any income tax that the worker is required to pay.
- 9.11.3 An employer who deducts money from a worker's pay for payment to another person must pay the money to that person within the time period and other requirements specified in the agreement of Law; court order or arbitration
- 9.11.4 It is the responsibility of the employers to arrange for all persons employed on a Project to be covered in terms of the Unemployment Insurance Fund Contributions Act, 2002 (Act No. 4 of 2002)
- 9.11.5 An employer may not require or allow a worker to
- (a) repay any payment except an overpayment previously made by the employer by mistake;
 - (b) state that the worker received a greater amount of money than the employer actually paid to the worker; or
 - (c) pay the employer or any other person for having been employed.

9.12. Health and Safety

- 9.12.1 Employers must take all reasonable steps to ensure that the working environment is healthy and safe.
- 9.12.2 A worker must;
- (a) work in a way that does not endanger his/her health and safety or that of any other person;
 - (b) obey any health and safety instruction;
 - (c) use any personal protective equipment or clothing issued by the employer;
 - (d) report any accident, near-miss incident or dangerous behaviour by another person to their employer or manager.

9.13. Compensation for Injuries and Diseases

- 9.13.1 It is the responsibility of the employers to arrange for all persons employed on a Project to be covered in terms of the Compensation for Occupational Injuries and Diseases Act, 130 of 1993 as amended by COIDA Act 61, 1997.
- 9.13.2 A worker must report any work-related injury or occupational disease to their employer or manager.
- 9.13.3 The employer must report the accident or disease to the Compensation Commissioner.
- 9.13.4 An employer must pay a worker who is unable to work because of an injury caused by an accident at work 75% of their earnings for up to three months. The employer will be refunded this amount by the Compensation Commissioner. This does NOT apply to injuries caused by accidents outside the workplace such as road accidents or accidents at home.

9.14. Termination

- 9.14.1 The employer may terminate the employment of a worker for good cause after following a fair procedure.
- 9.14.2 A worker will not receive severance pay on termination.
- 9.14.3 A worker is not required to give notice to terminate employment. However, a worker who wishes to resign should advise the employer in advance to allow the employer to find a replacement.
- 9.14.4 A worker who is absent for more than three consecutive days without informing the employer of an intention to return to work will have terminated the contract. However, the worker may be re-engaged if a position becomes available.
- 9.14.5 A worker who does not attend required training events, without good reason, will have terminated the contract. However, the worker may be re-engaged if a position becomes available.

Notice procedure is as follows;

- o One week if employed for four weeks or less
- o Two weeks if employed for more than four weeks but not more than a year
- o Four weeks if employed for one (1) year or more

9.15. Certificate of Service

9.15.1 On termination of employment, a worker is entitled to a certificate stating;

- (a) the worker's full name;
- (b) the name and address of the employer;
- (c) the Project on which the worker worked; the work performed by the worker;
- (d) any training received by the worker;
- (e) the period for which the worker worked on the Project; and
- (f) any other information agreed on by the employer and worker.

9.16. DOMICILE

The address to which notices and all legal documents may be delivered or served are as follows:

Employee Details

Name & Surname: _____

ID No: _____

Residential Address: _____

Contact No: _____

Date of Employment: _____

To be supervised by: Main Contractor:
or Sub Contractor:

Category of employment: Skilled:
Semi-skilled:
Unskilled:

For Skilled & Semi-skilled state the trade: _____

Period of employment: Fixed for until when your services are still required on site

I confirm that I have been inducted and fully understand the condition of my appointment.

Employee Signature: _____ Witness by SGB/CLO: _____

Signature by Witness: _____

Employer Details

Name & Surname: _____

Designation: _____

Contact No: _____ Signature: _____



The Attendance Register for on-site Workers

Reporting month: _____
 Surname: _____

Cell No: _____
 First Name: _____

Project Name: **Wentworth Hospital - Replacement of Existing Security Fence**

Project Code: **0**

Tender No **ZNB 9782/2021-H**

IDENTITY NUMBER: _____

Day	Date	Time In	Signature	Time Out	Signature	Report On Any Formal Training Provided In The Reporting Month
WEEK 1						
MONDAY						
TUESDAY						
WEDNESDAY						
THURSDAY						
FRIDAY						
WEEK 2						
MONDAY						
TUESDAY						
WEDNESDAY						
THURSDAY						
FRIDAY						
WEEK 3						
MONDAY						
TUESDAY						
WEDNESDAY						
THURSDAY						
FRIDAY						
WEEK 4						
MONDAY						
TUESDAY						
WEDNESDAY						
THURSDAY						
FRIDAY						
WEEK 5						
MONDAY						
TUESDAY						
WEDNESDAY						
THURSDAY						
FRIDAY						
Total Days worked						

BUSINESS PLAN

Reference No	
Profile ID	
Project Name	
Project Details	
Project Name	
Project Reference Number	
Project description	
Project Start Date	
Project End Date	
Estimated Budget	
Project Location	
Province	
District/Metro Municipality	
Local Municipality/Metro Region	
Latitude (in decimal format)	
Longitude (in decimal format)	
Public Body Details	
Public body sphere	
Reporting public body that is the project owner (and will report on the project)	
Implementing public body type	
Public body that will implement the project	
IDP reference number allocated to the project	
EPWP Details	
EPWP Sector	
EPWP Program	
EPWP Sub programme	
Budget Amount	
April 2014/March 2015	
April 2015/March 2016	
Total Budget Amount	
Wages	
UIF	
COIDA	

Training	
Administration	
Equipment and materials	
Other	
Describe other	
Outputs and Training	
Output	
Description	
Target Quantity	
Number of persons to be trained	
Contact person	
Title	
Initials	
First Name	
Surname	
Email	
Tel (Office)	
Fax Number	
Cell Number	
Physical Address 1	
Physical Address 2	
Physical Address 3	
Physical Address 4	
Postal Address 1	
Postal Address 2	
Postal Address 3	
Postal Address 4	



Worker payment capture form for LOCAL Labour

Name of Contractor: _____ Project Code: _____

Name of Project: **Wentworth Hospital - Replacement of Existing Security Fence**

Reporting month: _____


Payment Upload

No.	First Name	Initials	Surname	Identity No.	D.O.B	Job Description	Daily Wage Rate	Total Paid Days	Total Amount Paid	Total days Worked Days
1										
2										
3										
4										
5										
6										
7										
8										
9										
10										

Contractor sign: _____
 Designation: _____
 Date: _____
 Contact no: _____

DPW Official/Consultant sign: _____
 Designation: _____
 Date: _____
 Contact no: _____

EPWP Official sign: _____
 Designation: _____
 Date: _____
 Contact no: _____

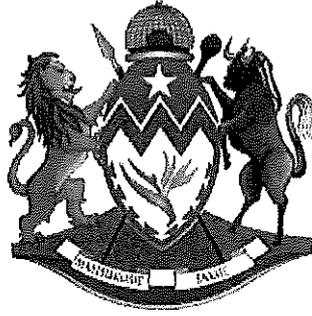

KWAZULU-NATAL
DEPARTMENT OF HEALTH

STANDARD PREAMBLES TO ALL TRADES

REV 3 – JANUARY 2009

**Compiled by:
Department of Health
Infrastructure Development
Engineering Services
Private Bag X9051
PIETERMARITZBURG
3201**

INDEX

1.	ALTERATIONS	1
	Site Visit -----	1
	Materials from the Alterations -----	1
	Asbestos Regulations 2001 -----	1
	Notice of Disconnections -----	2
	Dust -----	2
	Shoring -----	2
	Matching Existing Work -----	2
	Forming New Openings etc in Existing Walls -----	2
2.	EARTHWORKS	2
	Site Clearance -----	2
	Excavations -----	3
	Water -----	4
	Working Space -----	4
	Risk of Collapse -----	4
	Filling, etc. -----	4
	Compaction of Filling, etc -----	5
	Protection against Subterranean Wood-destroying Termites -----	5
	Re-use of Excavated Material -----	6
	Demolitions -----	6
	Grass Planting and Turfing -----	6
3.	CONCRETE, FORMWORK AND REINFORCEMENT	8
	Interpretations -----	8
	Definitions -----	8
	Materials -----	8
	Reinforcement -----	9
	Form Work -----	10
	Concrete Quality -----	12
	Transportation and Placing -----	16
	Construction Joints -----	16
	Construction Details -----	17
	Records -----	18
	Tests -----	18
	Acceptance Criteria for Strength of Concrete -----	19
	Procedure in the Event of Failure -----	19
	Non-structural Prescribed Mix Concrete -----	20
	"No Fines" Concrete -----	20
	Breeze Concrete -----	21
	Finishes to In-situ Concrete -----	21
	Unformed Finishes -----	21
	Tolerances -----	22
	Supervision -----	22
	General -----	22
4.	BRICKWORK	23
	Sand -----	23
	Cement -----	23
	Lime -----	24
	Water -----	24
	Cement Mortar -----	24
	Compo Mortar -----	24
	Strength Mortar -----	24
	Mixing of Mortar -----	24
	Testing of Strength Mortar -----	24
	Burnt Clay Common Bricks -----	24

	Bricks for Foundations -----	24
	Brickwork -----	24
	Hollow Walls -----	25
	Brick Linings to Concrete -----	25
	Reinforced Brick Lintels -----	25
	Pre-cast, Pre-stressed Concrete Lintels -----	25
	Bagging Down Brickwork -----	25
	Cramps -----	25
	Ties to Wall Plates, Rafters etc. -----	25
	Welded Mesh Brick Reinforcement -----	25
	Bitumen Emulsion Waterproofing to Brickwork -----	26
	Facing Bricks, Paving Bricks, Quarry Tiles etc. -----	26
	Faced Brickwork -----	26
	Paving Bricks and Quarry Tiles -----	26
	Fibre Cement Sills -----	26
	Rates -----	26
5.	WATERPROOFING -----	27
	General -----	27
	Workmanship -----	27
	Polyethylene Sheeting -----	27
	Mastic Asphalt Roofing -----	27
	Flexible Glass Fibre Reinforced Polyester Waterproofing -----	28
	Expansion Joint Sealants -----	28
	Rates -----	28
6.	ROOF COVERINGS -----	29
	Concrete Roofing Tiles -----	29
	Chromodek roof sheeting -----	29
	Rates -----	29
	Corrugated Iron roofing, cladding and filling -----	30
	Fluted steel roofing, cladding and filling -----	30
	Rates for roofing, cladding and filling -----	31
7.	CARPENTRY AND JOINERY -----	31
	Nomenclature of Timbers -----	31
	Timber Sizes -----	31
	Storage of Timbers -----	32
	Orders -----	32
	Pre-treatment of Timbers -----	32
	Stress Grading of Softwood Timber -----	32
	Structural Timber -----	32
	Branding and Battens -----	32
	Joinery and Shelving -----	32
	Structural Laminated Timbers -----	32
	Finger-jointed Timbers -----	32
	Jointing of Purlins, Fascias, Rails, Beams etc -----	33
	Hard Woods -----	33
	Prefabricated Timber Roof Trusses -----	33
	Fabrication and storage -----	34
	Erection and bracing -----	35
	Rates -----	35
	Insulation, Waterproofing and Dust Proofing Material for Roofs -----	35
	Gypsum Plasterboard -----	35
	Gypsum Coved Cornices -----	35
	Fibre Cement Sheets -----	35
	Fibre Cement Cellulose Sheets -----	35
	Hardboard -----	35
	Veneers -----	35

	Plywood -----	36
	Chip Board-----	36
	Batten Boarding -----	36
	Decorative Laminate Linings -----	36
	Nails and Screws -----	36
	Plugs, etc -----	36
	Shot Fixing -----	36
	Carpentry -----	36
	Ceilings -----	36
	Flush Plastered Ceilings -----	36
	Trap Doors-----	37
	Suspended Ceilings Boards-----	37
	Exposed Tee-System Suspended Ceilings-----	37
	Concealed Tee-System Suspended Ceilings-----	37
	Aluminium Trims to Ceilings -----	37
	Insulation Material for Ceilings-----	37
	Doors -----	38
	Framed, Ledged and Braced Batten Doors etc -----	38
	Entrances to Seclusion Wards -----	38
	Doors to X-Ray Units-----	38
	Joinery -----	38
	Partitions-----	39
	De-mountable Partitions -----	41
	Drywall Partitions -----	41
8.	FLOOR COVERINGS, PLASTIC LININGS, ETC -----	42
	Floor Sheetting -----	42
	Skirtings, Stair Nosings, Edging Strips etc -----	42
	Carpet Tiles and Sheetting -----	42
	Laying -----	43
	Floor Preparation-----	43
	Construction Joints-----	44
	Glazing-----	44
	Rates -----	44
9.	IRONMONGERY -----	45
10.	STRUCTURAL STEELWORK -----	46
	Generally -----	46
	Interpretations -----	46
	Definitions -----	46
	Sub-Contractors -----	46
	Materials -----	46
	Shop Details Drawings -----	46
	Substitution of Sizes etc -----	46
	Fixings -----	46
	Fabrication, Assembly and Erection -----	47
	Inspection and Testing -----	47
	Priming of Structural Steelwork -----	47
	Measurement and Payment -----	49
	Rates -----	49
11.	METALWORK -----	49
	Rates -----	49
	Welding and Brazing -----	49
	Screw Fixings -----	49
	Pipe Members -----	50
	Priming of Steelwork -----	50
	Galvanising of Steelwork -----	50

	Chromium Plating of Steelwork -----	50
	Pressed Steel Door Frames -----	50
	Stainless Steel Door Frames -----	51
	Pressed Steel Cupboard Door Frames -----	51
	Steel Windows and Doors -----	52
	Stainless Steel -----	54
	Anodised Aluminium Welded Windows and Doors -----	55
	Glazing to Dorrs / Aluminium Glazed Screens -----	57
	Strong Room Doors -----	58
	Burglar Resisting Safes -----	58
	Adjustable Louver Gear Sets -----	58
	Rates -----	58
12.	PLASTERING -----	58
	Mixing -----	58
	Materials -----	58
	Measurement of Constituent Parts of Floor Finishes, Toppings, Screeds and Plaster Finishes -----	59
	Preparation of Surfaces -----	59
	Floor Screeds etc -----	59
	Granolithic Finish to Concrete Floors etc -----	59
13.	PLASTER -----	60
	General -----	60
	Cement Plaster -----	60
	Barium Plaster -----	60
	Curing, Protection, etc -----	60
	Rates -----	60
	Generally -----	61
14.	TILING -----	61
	Materials -----	61
	Measurement of Constituent Parts of Backings, etc -----	61
	Preparation of Surfaces -----	61
	Glazed Ceramic Wall Tiles and Fittings -----	62
	Mosaics -----	62
	Unglazed Ceramic Floor Tiles and Fittings -----	62
	Rates -----	62
	Transition Trims -----	62
	Movement Joints -----	62
15.	DRAINAGE AND PLUMBING -----	62
	Generally -----	62
	Subsoil Drains -----	63
	Storm water and Soil Drain Pipes -----	63
	Concrete Beds and Encasement to Drain Pipes -----	63
	Pipe Laying -----	63
	Gulley traps -----	63
	Grease Traps -----	63
	Rodding Eyes -----	64
	Inspection Eye Blocks -----	64
	Surface Water Channels -----	64
	Cast Iron Gratings for Gulleys and Storm Water Drains and Cast Iron Surface Boxes, Manhole Covers and Frames -----	64
	Storm Water Sumps, Junction Boxes, Manholes, Inspection Chambers, Cable Inspection Chambers and Valve Chambers -----	64
	Soil Drain Manholes and Inspection Chambers -----	65
	Manhole Covers and Frame -----	65
	Soak Pits -----	65

	Septic Tanks -----	65
	Testing of Drains, Manholes and Inspection Chambers -----	66
	Defects to be Made Good -----	67
	Sheet Metalwork -----	67
	Linings to Valleys -----	67
	Linings to Secret Gutters -----	67
	Soakers -----	67
	Under-Flashings -----	67
	Cover Flashings -----	67
	Flashings Around Pipes through Roof Coverings -----	68
	Rainwater Pipes -----	68
	Generally -----	68
	Eaves Gutters -----	68
	Sanitary Plumbing and Fittings -----	69
	Sanitary Fittings -----	69
	Rates for Sanitary Ware -----	70
	Below Ground Water Reticulation -----	70
	Above Ground Water Supplies -----	71
	Water Taps and Valves -----	72
	Concrete Thrust and Anchor Blocks -----	72
	Testing of Water Mains -----	72
	Excavations for Pipe Trenches -----	72
	Backfilling -----	73
	Sizes of Pipes -----	73
	Rates for Pipes -----	73
	Rates for Chases, Holes Etc -----	73
	Fire Extinguishers -----	73
	Fire Hose Reels -----	74
	Fire Hydrants -----	74
16.	GLAZING -----	74
	Materials -----	74
	Glazing -----	75
	Rates -----	75
17.	PAINTING -----	75
	Materials -----	75
	Preparatory Work -----	76
	Application of Paints, etc -----	77
	Rates -----	77
18.	ROADWORK -----	77
	Sub-Grade -----	77
	Sub-Base -----	78
	Stabilisation -----	79
	Base Course -----	80
	Chip and Spray Surfacing -----	80
	Double Seal Coat with Black Top Surfacing -----	82
	Slurry Seal Surfacing -----	82
	Premix Tar macadam Surfacing -----	83
	Pre-cast Concrete Paving Blocks -----	84
	Kerbs -----	85
19.	FENCING AND GATES -----	85
	Generally -----	85
	Security Fencing -----	86
	Gates -----	87

20.	SUBMISSIONS FOR PREFABRICATED TIMBER ROOF TRUSSES	90
	Letter Ref TR 1-----	90
	Letter Ref TR 2-----	90
21.	SUPPLEMENTARY PREAMBLES	91
	Alterations-----	91
	Concrete, Form Work and Reinforcement-----	92
	Masonry-----	92
	Roof Coverings, etc-----	92
	Carpentry and Joinery-----	92
	Ceilings and Partitions-----	93
	Ironmongery-----	93
	Metalwork-----	94
	Plastering-----	94
	Tiling-----	95
	Plumbing and Drainage-----	95
	Glazing-----	95

TABLES

A	Removal of Formwork (Minimum Times in Days [24 hours])-----	12
B	Concrete Classes: Strength, Aggregate Size and Compaction-----	14
C	Maximum Cement / Water Ratios for Different Conditions of Exposure-----	15
D	Slump Limits-----	15
E	Prescribed Mix Concrete for Non-Structural Purposes-----	20
F	Crusher Run Base Course: Stone Specifications-----	80
G	Single coat Pre-mix Wearing Course: Specifications-----	83
H	Carpentry and Joinery: SANS Specifications-----	93

NOTE:

Only those clauses or portions of clauses in the following preambles, which refer to items in the Bills of Quantities, shall be considered as applying to the performance of this Contract.

2.
1.

ALTERATIONS

SITE VISIT: — Tenderers are advised to visit the site prior to tendering and satisfy themselves as to the nature and extent of the work to be done, also to examine the condition of all existing buildings as no claim will be entertained on the grounds of ignorance of the conditions under which the work was to be executed.

MATERIALS FROM THE ALTERATIONS: — unless otherwise stated, will become the property of the Contractor and all these materials, together with all rubbish and debris must be carried away and the site left clean and unencumbered.

Items described as "removed" shall mean removed from the site.

Credit for the value of materials from the alterations is to be allowed for on the Summary/ Final Summary page.

Items described as to be re-used or to be handed over to the Administration are to be dismantled where necessary and stacked on site where directed, and the Contractor will be responsible for their removal and storage until required, and shall make good all items missing, damaged or broken at his own expense.

Unless otherwise described, no materials from the alterations shall be re-used in any new work without the written approval of the Department.

Prior to the removal of any timbers from the site, these are to be inspected by Government Entomologists. If any of these timbers are infested by wood destroying agencies, these timbers are to be disposed of in the manner prescribed by the Government Entomologist.

In taking down and removing existing work, particular care must be taken to avoid any structural or other damage to the remaining portions of the buildings.

ASBESTOS REGULATIONS 2001:

In terms of Asbestos Regulations 2001, no individual person, contractor or agent shall remove, demolish or strip any building containing asbestos or products containing asbestos (including asbestos roof sheeting, ceilings, guttering and down pipes) unless the work is performed by a "**Registered Contractor**", registered with the Department of Labour. All asbestos work shall be carried out under the supervision of an "Approved Inspection Authority".

It is a requirement that before any work involving asbestos removal is carried out, the following procedure and documentation is followed: -

1. Prior to the commencement of any demolition work, written notification shall be given to the Assistant Manager (Inspection and Enforcement), Durban Labour Centre, Masonic Grove, Durban, stating the name, address and details of the person(s) removing or stripping the asbestos. The notification shall include the date, time and place where the proposed work is to be carried out. (Regulation 3).
2. The name and details of the Approved Inspection Authority that is to supervise and confirm that the work is being carried out according to the specific requirements of the Asbestos Regulations 2001 (as amended), including the approved "written work procedure" document. This document shall be submitted and signed at least 14 days prior to commencement of demolition work by the Approved Inspection Authority. (Regulation 21).
3. The production of valid accreditation certification of training for all employees involved in the asbestos removal work.

4. On completion of the asbestos related work a "Clearance Certificate" which includes the asbestos disposal certificate shall be forwarded to the Department by the Approved Inspection Authority.

In terms of the above regulations, it is an offence to carry out any asbestos work as defined in the above regulations without the necessary approval / requirements being met.

Individual persons or contractors found to contravene these regulations will be issued with a **PROHIBITION NOTICE** which in effect will stop all work on site and the offenders will then be liable for prosecution.

Any employer found guilty under the Asbestos Regulations 2001 may be liable to a fine and or imprisonment not exceeding 12 months.

NOTICE OF DISCONNECTIONS: — The Contractor is to give ample notice to the Department and Local Authorities regarding any disconnections necessary prior to the removal or interruption of electrical or telephone cables, water supply and sanitary services, etc.

DUST: — The Contractor is to allow in his rates for taking all precautions necessary to prevent any nuisance from dust whilst carrying out the works.

SHORING: — Rates for shoring are to include for the use and waste of all props, needles, wedges, braces, nails and screws, etc. required and for all cutting, notching, framing and fitting, maintaining in position for the required periods and removing at completion. All shoring is to be executed in a manner approved by the Department.

MATCHING EXISTING WORK: — The terms "make good" or "making good" to existing work as described in the items shall mean making good with materials to match, all joined to existing.

FORMING NEW OPENINGS, ETC. IN EXISTING WALLS: — Rates for items of forming new or altering existing openings are, unless otherwise stated, to include for the following: -

- a) Breaking out for and inserting adequate lintels over the new openings (except where stated in the items as being below an existing beam, slab or lintel), to the approval of the Department. The lintels are to be of in-situ concrete Class C, or of pre-cast pre-stressed concrete or of brickwork in 1:3 cement mortar, with a minimum bearing of 230mm at each end and suitably reinforced, and rates are to include for all necessary formwork, turning pieces, etc. and for wedging and pinning up to existing brickwork over in 1:3 cement mortar.
- b) All shoring and propping required.
- c) Facing up jambs in new brickwork in cement mortar properly bonded to existing,
- d) Building up the portions of the openings stated in the items in new brickwork in cement mortar properly bonded to existing.
- e) Formwork for concrete sills and thresholds where required.
- f) Making good only to the finishes as stated in the items. (Note: — The making good of paint finishes has been measured separately).
- g) Forming rounded angles, throats on external plastered soffits, mitres, etc. where required in all new plaster, render and granolithic finishes.

The supply, building in, fixing, etc. of all windows, doors, frames, etc. to the newly formed openings and the removal of all existing windows, doors, frames, etc. from openings to be altered, have been elsewhere measured.

2. EARTHWORKS

SITE CLEARANCE: — The item given in the Bills of Quantities for site clearance shall be deemed to include the removal from the site, or burning if permitted by the Local Authority, of shrubs and trees with trunks under 200mm girth measured at 1m above ground level,

hedges, bushes, other vegetation, rubbish and debris.
Holes left by roots are to be backfilled with earth and rammed.

EXCAVATIONS: — Rates for excavations are to include for forming and trimming to the correct levels, falls, slopes, curves, etc. for trimming sides, stepping, levelling and ramming bottoms, staging and disposing of the excavated material as described in the items. Rates for excavations to reduce levels over site are also to include for forming and trimming banks to the required batter. The Contractor is to allow in his rates for the bulking of excavated material.

The term "excavate", unless otherwise stated, shall mean excavate in "soft excavation" as defined below and for the purpose of classifying excavations the following will apply: —

- a) **Soft excavation:** — shall be excavation in material that can be efficiently removed by a back-acting excavator of flywheel power approximately 0, 10 kW per millimetre of tined-bucket width without the assistance of pneumatic tools such as paving breakers, or that can be efficiently loaded without prior ripping or stockpiling by a rubber tired front-end loader of approximately 15t mass and a flywheel power of approximately 100 kW.
- b) **Intermediate excavation:** — shall be excavation in material that requires a back-acting excavator of flywheel power exceeding 0,10kW per millimetre of tined-bucket width and the assistance of pneumatic tools prior to removal by equipment equivalent to that specified in (a) above.
- c) **Hard rock excavation:** — shall be excavation in material that cannot be efficiently removed without blasting or without wedging and splitting prior to removal.
- d) **Class A Boulder excavation:** — shall be excavation in material containing more than 40% by volume of boulders of size between 0.03m³ and 20m³ in a matrix of softer material or smaller boulders.
Note: — Excavation of solid boulders or lumps of size exceeding 20m³ will be classed as hard rock excavation. (2) Excavation of fissured or fractured rock will not be classed as boulder excavation but as hard rock or intermediate excavation according to the nature of the material.
- e) **Class B Boulder excavation:** — shall be excavation of boulders only in a material containing 40% or less by volume of boulders of size between 0.03m³ and 20m³ in a matrix of softer material or smaller boulders.
Note: — Those boulders requiring individual drilling and blasting in order to be loaded by a back-acting excavator as specified in (a) above, or by a track type front-end loader, will each be separately measured as Class B boulder excavation.
The excavation of the rest of the material will be classed as soft or intermediate excavation according to the nature of the material.

Method of Classifying: —The Contractor may use any method he chooses to excavate any class of material but his chosen method of excavation shall not determine the classification of the excavation. The Department will decide on the classification of the materials. The classification will be based on inspection of the material to be excavated and the criteria given in (a) to (e) above, as applicable. The decision of the Department shall be, subject to the relevant provisions of the contract, final and binding.

Should the Contractor consider that the excavation is other than "soft excavation" he must notify the Department immediately in order that an inspection be made and a decision arrived at by the Department as to the category of such excavation. Should the Contractor fail to give such notification, the excavation shall be deemed to be "soft excavation" and shall be measured and valued accordingly.

Blasting will only be permitted with the written authority of the Department, if and when permission is granted, it is to be executed only by persons holding the necessary Government Blasting Certificate and subject to all regulations imposed by the Department and/or Local Authority. In addition, the Contractor is to indemnify the Provincial Administration against all claims in respect of damage to persons and property resulting from such blasting operations.

Before commencing any excavations, the Contractor must satisfy himself as to the accuracy of any levels indicated on the drawings, as no claim will be entertained at a later date for any alleged inaccuracy in such levels.

Excavation shall be carried down to such depths as are necessary to obtain firm foundations, but before proceeding to greater depths than are shown on the drawings, the Department's approval must be obtained.

The Contractor will be responsible if he excavates wider or deeper than shown or required. If the excavations are deeper than shown or required such extra excavations are to be filled in with mass concrete at the Contractor's expense. If the excavations are wider than shown or required, any form-work or mass concrete filling required to the side of the concrete foundations is to be executed at the Contractor's expense and to the approval of the Department.

Depths of excavations as approved shall be checked and recorded by the a Departmental Official and the Contractor's Foreman before any concrete is laid or the excavations are otherwise covered or filled in.

Notwithstanding such approval, any excavations which become waterlogged or otherwise spoilt after approval, shall be cleaned out and reformed, at the Contractor's expense and to the satisfaction of the Department, before any concrete, etc. is laid.

WATER: — The Contractor shall keep all excavations free from water or mud by pumping, baling or otherwise.

WORKING SPACE: — The Contractor is to allow against the items of "excavate to provide working space" for excavating beyond the extent of the net excavations measured to provide the necessary working space for the carrying out of such work as is described in the items. Rates are to include, in addition to the extra excavation, for any additional risk of collapse so incurred and for filling back and compacting the excavated material.

No separate item for working space is provided or will be considered where the face of the measured excavation is 750mm or more away from the finished face of the structure. Separate items for working space for the building of brick foundation walls on ordinary concrete wall footings will not be considered.

In the case of column base and pile cap excavations, where the dimensions between the column face and the excavation face is less than 500mm, working space has been measured for the width of the column face from the commencing level of excavation to the top of the column base or pile cap only where the top of the column base or pile cap exceeds 1.5m below the commencing level of excavation.

RISK OF COLLAPSE: — The Contractor shall maintain all excavated faces affecting the safety of the works and workmen. He must either provide all necessary temporary planking, strutting or shoring to all vertical excavated faces or carry the risk of collapse of these faces with all its implications. He must assume full responsibility in this connection and must allow in his rates accordingly. In addition, all excavated faces exceeding 1.5m deep are to be maintained in accordance with Government Regulations.

Quantities reflect the total superficial areas of the vertical excavated faces and will be subject to variation only in so far as these areas may vary, notwithstanding whether any temporary supports are used or not.

FILLING, ETC.: — All backfilling and filling under floors and paving must be of selected material from the excavations, unless otherwise stated, returned and compacted in layers as later described and with the top surface dressed to the correct levels and grades, all to the approval of the Department. Under no circumstances will the Contractor be allowed to use clay, peat or other unsuitable material for filling.

Rates for all items of filling with material from the excavations are to include haulage not exceeding 100m from the perimeter of the excavations.

Any filling supplied by the Contractor is to be of suitable material approved by the Department.

COMPACTION OF FILLING ETC.: — All filling and backfilling is to be done in layers not exceeding 200mm thick before compaction, with the layers level to ensure uniform compaction. Each layer is to be thoroughly compacted over the whole of the area to a dry density not less than 90% of Mod. A.A.S.H.O. density. The surface of each compacted layer shall be uniform and tightly bonded. Care is to be taken that no damage is done to foundation walls, drains and other services.

The densities of compaction referred to are to be determined by tests carried out in accordance with A.S.T.M. Designation D 1557-58 and at an optimum moisture content of not more or less than 5% of the required Mod. A.A.S.H.O. The Contractor shall be responsible for having sufficient tests taken of the density of the compacted filling to ensure that the required compaction is being attained to the satisfaction of the Department. These tests are to be undertaken by an independent testing authority nominated by the Contractor to the approval of the Department. The costs of all tests in this connection shall be borne by the Contractor and shall be allowed for in his rates.

PROTECTION AGAINST SUBTERRANEAN WOOD-DESTROYING TERMITES: — Where protection against termites is to be provided: —

- a) Remove vegetable matter
All dead roots and other vegetable matter likely to encourage termites must be removed from the ground under, against the building and from all filling material.
- b) Treating the ground
The ground under surface beds, and below suspended wood floors, must be treated by the application of Soil Insecticides of Chlordane or Aldrin types complying with SANS Specifications 1165 and 1164 respectively, mixed with water and applied at the rate of not less than 5 litres of solution per square metre uniformly over the whole surface. The concentration of the solution must be strictly in accordance with the manufacturer's instructions and to the approval of the Department.

The Department reserves the right to take samples of the diluted solution, at any time, in order to test the concentration of the chemicals used.

Where the ground to be treated is of earth filling, the upper 50mm layer of filling must be levelled by raking, but must not be rammed until after the solution has been applied, and where of natural ground, it must be loosened to a depth of not less than 50mm and similarly levelled, in order to enable the solution to penetrate into the soil. After the solution has been applied and allowed to penetrate the surface, the soil must be well rammed and consolidated.

Before applying the solution to the ground under the floors, splay back earth for a depth and width of 75mm from the internal faces of walls enclosing the floors, against internal walls, sleeper piers, etc. and thoroughly saturate with the solution. After the solution has soaked into the earth, the splayed grooves must be filled with earth and consolidated.

The treated layer of soil under suspended wood floors must be protected with a 75mm thick layer of approved clean gravel, finished to an even surface.

The treated layer of soil under concrete surface beds must be protected with a 25mm thick layer of well-consolidated approved grit prior to laying the waterproofing membrane.

Great care must be taken when laying concrete surface beds, protective layers, etc. in order to avoid rupturing the treated layer of soil. Should the treated layer be ruptured at any

point it must be made good and the area affected re-treated with the soil insecticide.

Contractors are advised that:

- a. Special precautions must be taken to protect the workmen whilst using the soil insecticide.
- b. The treatment of filling or ground under floors shall be done as soon as practicable, so that treatment may dry out before the floors are laid.
- c. The treatment of the ground must be carried out under the supervision of the Department.
- d. The soil insecticide to be delivered to the site in sealed drums clearly labelled or stamped with the name of the product.
- e. In addition to the foregoing the application of the soil insecticide to be carried out in accordance with SANS Code of Practice 0124 — the application of Certain Soil Insecticides for the Protection of Buildings.
- f. The protective layers of gravel or grit have been measured separately.

RE-USE OF EXCAVATED MATERIAL: — Material of any kind that may be discovered on the site during the excavation shall remain the property of the Administration. Such material may, if approved, be used for aggregate. Material so used shall be valued and the value deducted from the Contract Sum.

DEMOLITIONS: — The Contractor is referred to the preambles for "Alterations" insofar as they apply and the following: —

The demolition of existing buildings is to be done in a practical and safe manner, under the continuous supervision of a competent Foreman. Rates for the demolition of existing buildings are to include for breaking up and removing all external screen walls, steps and ramps, surface water channels, rainwater sumps, gulleys, etc. and grubbing up and removing all foundation walls and footings, disconnecting and removing all services to a point not less than 1m beyond the perimeter of the buildings, plugging off ends of all remaining pipes, and for filling in all holes with clean earth and ramming up to ground level. All movable fittings and furniture, fire extinguishers and electrical and other equipment in the buildings to be demolished are to remain the property of and will be removed by the Administration prior to the commencement of the demolition.

Before commencing the demolitions, the Contractor shall comply with any Local Authority regulations in force in respect of rodent extermination, etc. and he shall obtain the required Clearance Certificate. Items to cover the cost of obtaining the certificate and the fumigation, etc. of the buildings to be demolished have been provided elsewhere in the Bills of Quantities, and the fumigation is to be carried out by a firm specialising in this type of work. The fumigation of the buildings to be demolished shall only be carried out if called for by the Local Authorities and if not required the value of the relevant items in the Bills of Quantities will be deducted from the Contract Sum.

After handing over the site to the Contractor, the risk of any loss or damage to the buildings to be demolished and the materials therein, caused by theft, vandalism, etc. shall be the responsibility of the Contractor and he shall take such precautions as he deems necessary against such loss or damage.

GRASS PLANTING AND TURFING: — Is to be "Cape Kweek" or "Umgeni" grass scientifically known as *Cynodon dactylon* or other local fine grass approved by the Department. In areas where fine grass does not grow readily, Kikuyu grass *Pennisetum clandestinum* may be substituted. The areas must be identified and the approval of the Department obtained before Kikuyu grass is to be planted.

Grass Planting To Level Areas: — The areas to receive grass are to be weeded and raked free of stones and other superfluous matter and all depressions left by the earthworks plant are to be filled in with approved topsoil. The planting of grass is to be carried out in continuous root planting in rows 200mm apart. The method of planting called "sprigging" may be used as an alternative.

Immediately after completion of each strip or square, the area thus grassed is to be thoroughly watered and lightly rolled. Any drifting or piling up of the top soil due to wind or any other cause must be prevented as far as possible and should such piling up of soil against newly planted grass occur the soil must immediately be raked level and lightly rolled.

Turfing: — Banks are to be carefully trimmed to an even surface and weeded and raked free of stones, etc. and all depressions filled in with approved topsoil as before described. Turfing of banks is to be carried out with 25mm thick maximum 500mm x 1000mm weed-free grass sods, of grass as before described, and as approved by the Department. The grass sods are to be set in position in horizontal rows to broken bond and closely fitted together and tamped flat with a timber pummel, a maximum of two sods in every square metre of area covered being staked to the bank to maintain position, with and including one sharpened wood or bamboo skewer 250mm long and with all cavities between sods filled in with approved top soil and the whole area lightly top soil dressed on completion.

Established Lawn: — The use of established lawn in pieces size approximately 500mm x 1000mm x 25mm thick in lieu of grass sods on banks will be permitted provided that the established lawn is supplied and laid by a firm experienced in this type of work and to the approval of the Department. The fitting, tamping, staking and top dressing must all be as described for turfing, except that one piece per square metre is required to be staked as described.

Fertilizer: — An approved fertilizer of the following types— Type 2:3:2 for grass planted levelled areas and Type 3:2:1 for turfed or established lawn covered banks is to be supplied and applied by the Contractor at the rate of 400 kg per hectare. In the case of grass planted levelled areas the fertilizer is to be applied either before or after grass planting and in the case of turfed or established lawn covered banks the fertilizer is to be applied after the sods or pieces have been laid.

The fertilizer above described is to in addition to any fertilizer which may have been specified to be applied during either the operation of scarifying and grading the area to be grassed or the re-spreading of top soil.

A sample of the existing topsoil or the topsoil to be re-spread is to be sent to an approved fertilizer manufacturer for testing and advice on the acid or alkaline content of the soil. The cost of this test is to be borne by the Contractor if this is not provided free by the fertilizer manufacturer.

The requisite quantities of limestone ammonium nitrate for acidic soil or ammonium sulphate for alkaline soil as determined by the soil test will be supplied to the Contractor by the Department and the cost thereof is to be included in a Provisional Sum elsewhere in the Bills of Quantities. The application of this treatment is to be undertaken by the Contractor and his rates for grassing, etc. must include for same.

Weed killer: — "Weed Master or Turf Master" or other approved weed killer is to be applied to the entire grassed or turfed areas at a rate of 4 litres mixed with 200 litres of water per hectare, this being equivalent to 40-45 millilitres mixed with 5 litres of water per fifty square metres. The solution is to be sprayed on with a suitable spraying apparatus to achieve an even distribution. Six to eight weeks later, the operation is to be repeated. The application of weed killer is not to take place during wet weather. Weather conditions should be such as to allow a minimum of two hours or absorption before the likelihood of rain.

Watering and Rolling: — The entire turfed area is to be kept clear of weeds, lightly rolled and thoroughly watered throughout the period of the Contract and or at least three months from the time of acceptance of the grounds or until the grassing or turfing is well established if that is sooner, all to the satisfaction of the Department.

In the absence of rain, the initial watering of grassed or turfed areas is to be carried out as follows: —

Grass planted levelled areas: - at least twice a week.

Established lawn areas: - at least once a week.

Turfed areas: - at least once a day for the first ten to fourteen days, thereafter at least once a week.

The Contractor must allow in his rates for providing and removing at completion all necessary temporary water piping complete with fittings, sprinklers, hoses, etc. as required for the proper watering of the grassed or turfed areas of the plateaux and banks.

Cutting of Grass: — The Contractor must commence mowing as soon as possible once turfed areas have become established and undertake regular mowing at approximately one-week intervals up to the date of final delivery, except that, during the maintenance period, the mowing of the plateaux will be undertaken by the Institution.

Note: — All stages of grass planting and turfing are to be supervised on a full time basis by a competent person with the necessary experience and knowledge.

It shall be the responsibility of the Contractor to advise the Department when the following operations are to be carried out in order that his representative may be present: —

- a) the application of fertilizer
- b) the application of weed killer.

Should the Contractor fail to do so, the Department shall have the right to instruct the Contractor to repeat the operation at his own expense.

3. **CONCRETE, FORMWORK AND REINFORCEMENT**

GENERAL: — This specification applies to concrete work formed into its final shape and position in-situ.

All concrete and formwork shall be carried out in accordance with SANS Specification 1200 G — Concrete (Structural) (a copy of which the Contractor will be required to keep on the site so that it can be referred to at all times during the Contract), with the following amplifications and amendments: —

INTERPRETATIONS: — Clauses 2.1 and 2.2 of SANS Specification 1200G refer. This preamble, together with any other supplementary preambles appearing in these Bills of Quantities shall be deemed to be the project specification and are the "Portion 2" referred to in Clause 2.2.

DEFINITIONS: — Clause 2.3 of SANS Specification 1200 G refers. All references to the Engineer shall be deemed to mean the Department.

MATERIALS

Cement: — unless otherwise specified, shall be one or more of the following and shall, in each case, comply with the requirements of the relevant standard specification: —

Portland cement and rapid-hardening cement to SANS 471 Specification

Portland blast-furnace cement to SANS Specification 626.

Portland cement 15 to SANS Specification 831.

Nevertheless, no cement other than ordinary Portland cement shall be used without the approval of the Department. Cement containing more than 15% blast-furnace slag will not be permitted in columns or in members less than 50mm thick.

In addition (for the abovementioned items) where Ordinary Portland cement is used, blast-furnace slag (from separate containers) **must not** be added in any proportion whatsoever.

No mixing of two different types of cement in the same batch will be allowed, and unless otherwise approved by the Department, the same brand and type shall be used in all exposed concrete.

Lumpy cement, broken sacks and sweepings shall not be used.

Cement supplied in sacks shall be used in the order in which it was delivered and shall not be kept in storage for longer than six (6) weeks without the approval of the Department.

Water: — Shall be clean and free from injurious amounts of acids, alkalis, sugar, organic matter and other substances that could impair the strength or durability of the concrete. If so required by the Department, the suitability of the water shall be proved by tests carried out by an approved laboratory.

Aggregates: — Unless otherwise specified both the coarse aggregate (stone) and the fine aggregate (sand) shall comply with the requirements of SANS Specification 1083. The Contractor is to prove compliance by means of either a certificate from the supplier or by grading analysis tests.

Admixtures: — i.e. materials other than cement, aggregate and water shall not be used in the concrete mix without the approval of the Department. The onus for proof of satisfaction to the Department for any admixture proposed shall be with Contractor.

Reinforcement: — for concrete shall be as specified and shall, in each case, comply with one of the following: —

- a) Type A hot rolled mild steel bars of plain round cross section to SANS Specification 920
- b) Type C Class 2 hot rolled high yield stress Grade 1 deformed bars to SANS Specification 920
- c) Type D Grade 1 cold worked deformed bars to SANS Specification 920.
- d) Welded steel fabric to SANS Specification 1024 manufactured from plain hard-drawn mild steel wire.

A sample reinforcing rod, approximately 600mm long, may be taken from each consignment of rods of similar diameter, for testing. If any sample is found unsatisfactory the whole consignment of rods from which the sample was taken will be rejected.

No substitution of the bars specified shall be made without the prior approval of the Department.

REINFORCEMENT

Bending: — Reinforcing bars shall be cut and bent according to the dimensions shown on the working drawings and in accordance with SANS Specification 82.

Except as allowed for below, all bars shall be bent cold and bending shall be done slowly, a steady even pressure being used without jerk or impact.

If approved by the Department, hot bending of bars of diameter at least 32mm shall be permitted, provided that the bars do not depend for their strength on cold working. When hot bending is approved, the bars shall be heated slowly to a cherry red heat (not above 840 C°) and after bending shall be allowed to cool slowly in air. Quenching with water shall not be permitted.

Fixing: — All steel reinforcement, at the time of placing of the concrete, must be free from loose rust, scale, oil and other agents which will reduce the bond between the steel and the concrete or initiate corrosion of the reinforcement. Reinforcement exposed to sea spray shall be washed down, and the formwork drained, just prior to concreting.

Reinforcement shall be positioned as shown on the working drawings or as directed by the Department and maintained in those positions within the tolerances given in the Specification for Tolerances. It shall be secured against displacement by tying at intersections with 1.6 or 1.25mm diameter annealed wire or by the use of suitable clips or, if permitted by the Department, by welding in accordance with SANS 1856. Welding will not

be permitted on cold worked bars. Reinforcement shall be supported in its correct position by hangers, saddles or cover blocks and aligned by chairs and spacers all of approved design and material. Where such hangers, saddles, chairs or spacers are of steel, they will be detailed on the drawings or in bending schedules.

Cover: — The minimum cover of concrete over reinforcement, excluding any applied finish, shall be as shown on the working drawings, or as directed by the Department.

Cover shall be maintained by using cover blocks, which shall be made of small aggregate concrete, not mortar, using the same cement and aggregate type and ratio as the parent concrete. Alternatively, cover blocks may be of the plastic type provided that sufficient number are used to prevent their collapse, that they are of a colour compatible with that of concrete and that the prior approval of the Department is given. Metal cover blocks shall not be used.

If the concrete face has a Class F2 smooth finish or some other special finish as is described elsewhere, hemispherical or pyramid shaped concrete cover blocks shall be used unless otherwise specifically approved by the Department.

Splicing: — or joining of reinforcing bars shall be made only as and where shown on the working drawings or as otherwise approved. The length of the overlap in a splice shall be not less than that shown on the working drawings or forty-five times the diameter of the bar if not shown.

Protection of Exposed Bars: — If left exposed for future bonding of extensions to the works, reinforcement shall be protected from corrosion as specified by the Department.

Electric Current: — Reinforcement shall not be used as a means for conducting electric current unless there is conformity with the requirements of SANS Code of Practice 03.

Inspection of Reinforcement: — Reinforcement shall be subject to inspection by the Department after the Contractor is satisfied that it has been completely and correctly fixed. The amount of notice given by the Contractor to the Department before concreting commences that reinforcement is ready for his inspection shall be agreed between the Department and the Contractor at the commencement of the Contract.

FORM WORK

Design: — Formwork shall be so designed and constructed by the Contractor that the concrete can be properly placed and compacted and that the required shapes, finishes, positions, levels and dimensions shown on the working drawings are maintained, subject to the tolerances given in the Specification for Tolerances. Unless otherwise directed by the Department, all formwork to beams and slabs shall be evenly cambered, unless otherwise specified or shown on the drawings, to the mid-point of the span of the member at the rate of 2mm per metre of span, all to the approval of the Department and the full cross section of the member shall be maintained after placing of concrete.

The formwork and joints shall be capable of resisting the dead load and pressure of the wet concrete, effect of vibration equipment, wind forces and all other superimposed loads and forces it is necessary for it to carry.

Should it be necessary to support formwork off suspended or ground bearing slabs, the manner of execution of the support shall be agreed with the Department so that overstress of, or damage to, those members is prevented.

In structures having, in whole or part, two or more reinforced concrete floors, props to the approval of the Department shall be provided under the soffits of beams and slabs of any floor which is being used to support the formwork and new concrete of the floor above. These props shall not be removed until the formwork for the new concrete has been struck.

Wedges and clamps shall be used in preference to nails. Joints in forms shall be tight enough to prevent leakage of cement paste.

Finish: — The quality of the finished surface of the concrete shall be as shown on the working drawings or as otherwise specified, and the type of formwork used shall be adequate to provide such finishes.

Ties: — The type of ties used and their position shall be such that the finish required in terms of the clause "Finish" is achieved. Tie rods are preferable to wire ties and the forms shall not be secured to the reinforcement. No corrodible tie rod or wire tie shall be allowed within the depth of concrete cover, and in the case of water-retaining or tanked structures, no removable tie rod or wire shall pass right through the concrete member.

Preparation of Formwork: — Surfaces that are to be in contact with fresh (wet) concrete shall be so treated by coating with a non-staining mineral oil or other approved material, or, in the case of timber forms, by thoroughly wetting surfaces so as to ensure easy release and non-adhesion to formwork during stripping. If any substance other than water is used, every precaution shall be taken to avoid contamination of the reinforcement.

Re-use of Formwork: — Before re-use, all formwork shall be reconditioned, and all form surfaces that are to be in contact with the concrete shall be thoroughly cleaned without unduly damaging the surfaces of the formwork.

Openings: — Where necessary for the proper placing of the concrete, temporary openings for cleaning, inspection or placing purposes shall be provided, taking cognisance of the finishes specified.

Removal of Formwork: — Formwork shall not be removed before the concrete has attained sufficient strength to support its own mass and any loads that may be imposed on it. Except where the Contractor can prove by means of cube tests, at his own expense to the satisfaction of the Department that, because of its strength development characteristics the concrete has attained sufficient strength and that shorter periods are practicable, formwork shall not be removed within shorter periods than those given in Table A. The number of cube tests required shall be equal to the number required for testing at 28 days. Where full design loads are carried, no soffit forms and props may be removed until the full design strength is attained.

In structures having, in whole or part, two or more reinforced concrete floors, props to the approval of the Department shall be provided under the soffits of beams and slabs of any floor which is being used to support the formwork and concrete of the new floor above. These props shall not be removed until the formwork for the new concrete has been struck.

All formwork props shall have been removed from under beams and slabs before the commencement of construction of brickwork thereon, unless otherwise agreed with the Department. Formwork shall be removed carefully so that shock and damage to the concrete are avoided.

TABLE A—REMOVAL OF FORMWORK (MINIMUM TIMES IN DAYS (24 hrs))

1	2	3	4	5	6	7	8	9	10
Type of structural member or formwork	Type of cement used								
	Portland cement and Portland cement 15			Rapid-hardening Portland cement* and rapid-hardening Portland cement 15			Portland blast-furnace cement		
	Weather								
	Hot or normal	Cool	Cold	Hot or normal	Cool	Cold	Hot or normal	Cool	Cold
(a) Beam sides, walls, and unloaded columns.	0,75	+	1,5	0,5	+	1	2	+	4
(b) Slabs with props left underneath	4	+	7	2	+	4	6	+	10
(c) Beam soffits with props left underneath, and ribs of a ribbed floor construction	7	+	12	3	+	5	10	+	17
(d) Slab props including cantilevers	10	+	17	5	+	9	10	+	17
(e) Beam props including cantilevers	14	+	21	7	+	12	14	+	21

* Shorter periods may be used for sections of thickness 300mm or more.

+ In cool weather, stripping times shall be determined by interpolation between the periods specified for normal and cold weather.

CONCRETE QUALITY

General: — Concrete shall comply with the requirements for “Strength Concrete” as specified. The type of aggregate and cement, and their sources of supply, shall not be altered during the currency of the Contract without the prior written agreement of or instruction from the Department.

Strength Concrete: — The Contractor shall be responsible for the design of the concrete mix and for the proportions of its constituent materials, measured as described, necessary to produce concrete that complies with the requirements specified by the Department thus:-

- a) For each section of the work, the class of concrete and position on the Works, as shown on the drawings:
- b) For each class of concrete:
 - i) the minimum compressive strength at 28 days as shown in Table B
 - ii) the maximum nominal size of coarse aggregate as shown in Table B

- iii) the slump as shown in Table D
- iv) the maximum cement/water ratios as shown in Table C.

At the earliest possible stage in the Contract, at least 35 (thirty-five) days before the first concrete is placed, or as otherwise agreed with the Department, the Contractor shall submit samples of the aggregates which he proposes to use on the works to the Department.

The Contractor, under the supervision of the Department, shall prepare trial mixes using these same aggregates, to establish his ability to achieve the strengths specified, and satisfactory workability of the concrete. The Contractor shall provide all necessary equipment for, and carry out tests of moisture content of aggregates at the time of preparation of the trial mixes, tests of the slump of the mixes and at the same time cast not less than six standard cubes from each mix for compression tests.

The target strengths to be achieved under trial mix procedure shall exceed the specified minimum compressive strengths by a factor which is acceptable to the Department.

The Contractor shall also, when required to do so, prove the concrete yield obtained per sack of cement by suitable measurement of batches after placing.

No structural concrete work shall be poured until trial mix procedure has been properly followed and satisfactory 7 (seven) day compression strengths achieved. (Equivalent 28 (twenty-eight) day strength = $\frac{4}{3} \times 7$ day strength + 5 MPA).

Thereafter, the materials, preparation of and method of manufacture of subsequent concrete shall conform accurately to those used in the trial mixes. If materials vary in the course of the Contract from the samples first submitted, the Contractor shall, on the instructions of the Department, repeat the trial mix procedure and vary the proportions to attain the specified qualities.

The costs of preparation of trial mixes, with tests associated with them, shall be borne by the Contractor and must be allowed for in the pricing of the concrete.

A valid concrete test result shall be the average obtained from the testing of three test cubes of concrete in accordance with SANS Method 863.

TABLE B—CONCRETE CLASSES: STRENGTH, AGGREGATE SIZE AND COMPACTION

Class	Minimum 28 day cube compressive strength (MPA)	Maximum nominal size of coarse aggregate (mm)	Method of Compaction
50/26 50/19	50	26,5 19,0	Mechanical (see clause "Compaction")
45/26 45/19	45	26,5 19,0	
40/26 40/19	40	26,5 19,0	
35/26 35/19	35	26,5 19,0	
30/37 30/26 30/19 30/13	30	37,5 26,5 19,0 13,2	
25/37 25/26 25/19 25/13	25	37,5 26,5 19,0 13,2	
20/37 20/26 20/19 20/13	20	37,5 26,5 19,0 13,2	
15/37 15/26 15/19	15	37,5 26,5 19,0	Non- mechanical (See clause "Compaction")
10/37 10/26 10/19	10	37,5 26,5 19,0	

The Contractor shall be deemed to have satisfied himself, before tendering, of his ability to produce concrete of the required quality with available materials conforming to the specification, and mixed in the proportions on which his tendered rates are based. Any subsequent alterations of the mix proportions to meet these requirements shall be at the Contractors expense.

If, in the opinion of the Department, the concrete proportions are likely to lead to excessive segregation, honeycombing, bleeding or shrinkage cracking, he shall have the right to order the Contractor to amend the proportions at the Contractors own cost.

TABLE C — MAXIMUM CEMENT / WATER RATIOS FOR DIFFERENT CONDITIONS OF EXPOSURE

1 Type of structure	2	3	4	5
	Exposure Conditions			
	Mild	Moderate	Severe	Very Severe
Thin sections; reinforced piles; all sections with less than 25mm cover reinforcement.	*	0.53	0.48	0.40
Moderate sections; retaining walls, piers, beams	*	*	0.53	0.43
Exterior portions of mass concrete	*	*	0.53	0.43
Concrete slabs laid on ground	*	0.53	0.48	*
Concrete protected from the weather, inside buildings, or in ground below frost level	*	*		*

* In these cases the ratio will be based on the strength for the workability desired.

Consistency and Workability: — Slump measurements taken in accordance with SANS Method 862 shall be within the limits given in Table D appropriate to the type of construction, or within such other limits as are laid down by the Department.

The concrete shall be of such workability that it can readily be compacted into the corners of the formwork and around reinforcement without segregation of the materials or excessive "bleeding" of free water at the surface.

TABLE D—SLUMP LIMITS

1	2	3	4	5
Type of construction	Slump, mm			
	Non-mechanical compaction		Mechanical compaction	
	Max.	mm.	Max.	mm.
Paving and pre-cast units	75	50	50	30
Heavy mass construction	75	25	50	20
Reinforcing foundation walls and footings	125	50	80	30
Slabs, beams, columns, and reinforced walls	125	50	80	30
Slabs and industrial floors on ground	125	75	80	50
Plain footings, caissons, and substructure walls	100	25	60	20

Ready-mixed Concrete: — This may be used subject to the approval of the Department. This approval may be withdrawn on 24 (twenty-four) hours notice to the Contractor if at any time if documents do not conform to the requirements of this Specification. Ready-mixed concrete shall also comply with the requirements of SANS Specification 878. Details of the

mix ingredients and tests thereon, the mix designs and relevant tests shall be forwarded to the Department for his approval. Ready-mixed concrete shall be cast within 3 (three) hours of placing all the ingredients in the mixing plant. Ready-mixed concrete shall be subject to the same sampling and testing at the site as that mixed on site and only the results of these tests will be regarded as valid.

TRANSPORTATION AND PLACING

Transportation: — Unless agreed with the Department, concrete shall not be pumped into its final position.

The Contractor must provide suitable runways for the distribution of concrete to the various parts of the structure and these must be solidly constructed in such a manner so as to obviate the possibility of interference with the steel reinforcement.

Placing: — Unless otherwise agreed with the Department, the Contractor shall give the Department at least 24 (twenty-four) hours notice of his intention to place concrete. No concrete shall be placed without the prior approval of the Department and without a representative of the Department being present. Concrete shall be placed within one hour of the time of its discharge from the mixer. Concrete shall not be re-tempered by the addition of water or other material. The forms to be filled shall be clean internally. All excavations and other surfaces of an absorbent nature that are to come into contact with the concrete shall be dampened with water. There shall be no free-water on the surface against which concrete is to be placed. Wherever possible, the concrete shall be deposited directly into its final position to avoid segregation and displacement of reinforcement and other items that are to be embedded. Deposited concrete shall not be so worked (whether by means of vibrators or otherwise) as to cause it to flow laterally in such a way that segregation occurs. Where possible, the concrete shall be brought up in horizontal layers of compacted thickness not exceeding 450mm and heaping shall be avoided.

Where a chute is used to convey the concrete, its slope shall be such as will not cause segregation, and a suitable spout or baffles shall be provided for the discharge of the concrete. Concrete shall not be allowed to fall freely through a height of more than 3 m, unless otherwise approved. Concrete shall not be placed during periods of heavy or prolonged rainfall.

Compaction: — The concrete shall be fully compacted by approved means during and immediately after placing. It shall be thoroughly worked against the formwork and around reinforcement and other embedded fittings without displacing them.

The concrete shall be free of honeycombing and planes of weakness. Successive layers of the same lift shall be thoroughly worked together.

The method of compaction shall be as specified. Mechanical compaction shall be undertaken by means of high frequency immersion vibrators of minimum frequency of 6000 vibrations per minute and a maximum acceleration of 4 g when under load, being capable of visibly affecting concrete over a radius of at least 500mm. Vibrators shall be inserted at about 500mm centres and withdrawn slowly to close the hole formed by the vibrator.

Non-mechanical compaction shall be undertaken by means of spading, rodding or forking.

Over-compaction resulting in segregation, surface laitance or leakage (or any combination of these) shall not be allowed.

Vibrators shall not be allowed to come within 30mm of the face of the formwork in the case of formed finishes, nor within 75mm of the face of the formwork in the case of special finishes.

Construction Joints: — Concreting shall be carried out continuously up to the construction joints shown on the working drawings or as prior approved by the Department, except that

if, because of an emergency (such as a breakdown of the mixing plant or the occurrence of unsuitable weather), concreting has to be interrupted a construction joint shall be formed at the place of stoppage in conformity with the detail shown on the drawings for construction joints generally and in the manner which will least impair the durability, appearance and proper functioning of the concrete. The Department shall approve the method adopted for forming the construction joints, one of the following methods being adopted, as relevant: —

- a) Construction joints when concrete is not more than 24h old: —The surface of the concrete shall be brushed with a steel wire brush before new mortar and concrete are placed as specified in (b) below.
- b) Construction joints when concrete is more than 24h but not more than 3 days old: — The surface of the concrete shall be sand-blasted or chipped with a light hammer, swept clean, and thoroughly wetted and covered with a 10mm thick layer of mortar composed of cement and sand mixed in the same ratio as the cement and sand in the concrete mixture. This mortar shall be freshly mixed and placed immediately before the new concrete is placed.
- c) Construction joints when concrete is more than 3 days old: — The procedure specified in (b) above shall be followed, except that the old surface shall be prepared and kept continuously wet for at least 24h before the mortar and new concrete are placed.
- d) Construction joints at tops of columns: — The procedure for brushing or cleaning specified in (a) or (b) above, as applicable, shall be followed before the steel reinforcement of the slab or floor to be cast on the columns is placed in position.

Curing and protection: — Formwork shall be retained in position for the appropriate period given in the clause "Removal of Formwork" and shall be considered as providing adequate curing on those surfaces for that period. Should this curing period still be less than that specified, alternatively, should surfaces not be cured by forms then all such concrete shall immediately be protected from contamination and loss of moisture by one or more of the following methods: —

- a) ponding the exposed surfaces by means of water, except where atmospheric temperatures are low, i.e., less than 2°C,
- b) covering the concrete with sand, or mats made of a moisture-retaining material, and keeping the covering continuously wet;
- c) continuous spraying of the exposed surfaces with water;
- d) covering with a waterproof or plastic sheeting firmly anchored at the edges,
- e) using a prior approved curing compound applied in accordance with the manufacturer's instructions, provided that in this case, the presence of the compound is not detrimental to subsequently applied finishes.

Whatever method of curing is adopted, its application shall not cause staining, contamination, or marring of the surface of the concrete.

The curing period shall be at least 5 days for concrete made with Portland cement, at least 2 days for that made with rapid-hardening Portland cement and at least 7 days if Portland blast-furnace cement is used. When atmospheric temperatures are below 5° C these minimum curing periods shall be extended by 72, 36 and 72 hours respectively.

CONSTRUCTION DETAILS

Holes, Chases and Fixing Blocks: — No holes or chases other than those shown on the working drawings or approved by the Department shall be cut or otherwise formed in the concrete. No blocks for the attachment of fixtures shall be embedded in the concrete unless approved by the Department.

Pipes and Conduits: — No pipes or conduits other than those shown on the working drawings shall be embedded in the concrete without the approval of the Department. The clear space between any such pipes and the clear distance between such-a pipe and any reinforcement shall be at least 25mm or the maximum size of the coarse aggregate plus 5mm, whichever is greater. The amount of concrete cover over pipes and fittings shall be at least 25mm.

Honeycombing and Other Defects: — After removal of the forms, if the concrete shows any defect in terms of the Specification for Finishes for that concrete, the Contractor shall, on the instructions of the Department, make good the defect at his own cost, by either removing and replacing the defective concrete, or by patching, all as approved by the Department and to the standard of finish required. No remedial work shall be carried out by the Contractor without the prior approval of the Department.

Building on Concrete Footings: — No structural load shall be imposed on concrete footings until at least three days after depositing the concrete in the case of mass concrete footings and after seven days in the case of reinforced concrete footings, or as may be directed by the Department.

RECORDS: — The Contractor shall maintain written records indicating: —

- a) the date on which each section was concreted, the time taken to place the concrete, and the position of that section in the Works and its construction joints;
- b) daily weather conditions with temperatures being recorded by maximum and minimum thermometers and
- c) the nature of samples and dates on which they were taken. In the case of cubes these shall also state the identification marks, test results and age, minimum strength required and position of parent concrete.

TESTS

Compressive Strength: — During the time in which each class of concrete, having a specified 28 day compressive strength equal to or greater than 20 MPA, is being placed, samples of the concrete shall be taken from the point of deposit at the rate of at least one sample from each 5m³ of concrete placed in columns, and from each 30 m³ or part thereof of concrete placed elsewhere, but in either case, nevertheless at least once a week. A group of at least three 150mm test cubes shall be made from each sample for testing at 28 days age. If the Contractor plans to execute further work which relies on previously completed work for support but for which the results of 28 day tests are not available, he is to prove the strength of that concrete by taking and testing at 7 days age an equal number of test cubes to that which is to be tested at 28 days age, prior to the commencement of the planned further work.

The cost of the necessary extra test cubes and testing will be for the Contractor's account. Each group of test cubes shall be deemed to represent the whole of the concrete from which sample was taken and shall be identifiable with the concrete.

The Contractor shall provide, at his own expense, sufficient moulds to keep pace with the rate of concreting. He shall also perform all tasks in respect of compressive strength testing except the actual crushing.

If ready-mixed concrete is used, site testing as specified herein shall still be undertaken, and only the results of such site testing shall be considered in determining the acceptance or otherwise of the concrete.

Grading Analysis: — If so directed by the Department, a grading analysis shall be made for each 40m³ of fine aggregate to be used and for each 75 m³ of the coarse aggregate to be used. The analysis shall be made by the method given in SANS Specification 1083.

Determination of Consistency: — When the slump test is used to measure the consistency of the concrete mix, it shall be carried out by the method given in SANS Method 862 with samples taken in accordance with SANS Method 861.

Costs of Tests: — to concrete, trial mixes, cement, aggregates, water and reinforcing steel shall be borne by the Contractor. The Contractor shall also bear the costs of any other tests (including load tests), which are required as a result of failure on the part of the Contractor to meet the requirements of the Specification.

An item against which the Contractor may allow for all costs in connection with tests on concrete cubes has been included elsewhere in these Bills of Quantities.

Testing Authority: — The crushing of cubes and testing of other samples except in the case of the clause "Determination of Consistency" shall be undertaken by an independent Authority as approved by the Department. The Contractor shall arrange with the Authority that copies of the results of all tests are sent direct to the Department.

ACCEPTANCE CRITERIA FOR STRENGTH OF CONCRETE: — Should any test result obtained from a set of three test cubes of concrete of a specific grade that have been made and tested as specified show that the strength is more than 3 MPA below the specified strength, the concrete represented by such results shall be deemed to have failed to meet the Specification. Should an examination carried out in terms of the clause "Procedure in the event of failure" satisfy the Department that the structural adequacy and durability of that part of the structure where the concrete concerned has been used, is not impaired, the concrete will be acceptable. The Contractor will however be required to review the mix design and any other factors influencing the quality to ensure that further concrete is acceptable.

Where three or more consecutive valid test results (i.e., results of sets of three test cubes that have been made and tested as specified) become available, the following criteria shall apply: —

- a) The average of any three consecutive valid test results obtained on concrete of a specific grade must exceed the specified strength by at least 2 MPA.
- b) If the criterion given in (a) above is not met but the average is at least equal to the specified strength, the concrete cast will be acceptable but the Contractor will be required to adjust the mix design and standard of control.
- c) Should the average result be less than the specified strength, an examination must be carried out in terms of the clause "Procedure in the event of failure" on that part of the structure in which concrete represented by the result has been used.

Alternatively, should a concreting operation be of such size or the testing be of such frequency that thirty or more valid test results (i.e., results of sets of three test cubes that have been made and tested as specified) become available within three months, the Contractor may choose, subject to the approval of the Department, to have the results assessed statistically. In such a case, the average of all the test results of a specific trade of concrete at *any stage* must exceed the specified strength by at least 1,7 standard deviations, failing which the Contractor will be required to adjust the mix design to ensure compliance with this criterion.

PROCEDURE IN THE EVENT OF FAILURE: — If after the evaluation of the test results in terms of the clause "Acceptance criteria for strength concrete" an examination of the concrete in the structure is necessary, one or more of the following procedures in the sequence given may be adopted at the discretion of the Department, and for the account of the Contractor, to determine the acceptability or otherwise of the concrete in that particular part of the structure: —

- a) An assessment of the stress level in the structure concerned in relation to the test result obtained.
- b) Non-destructive testing, subject to the availability of similar concrete of proven acceptable quality in comparable members in the same construction as a reference.
- c) The testing of drilled cores in accordance with the relevant SANS Standard Methods.
- d) Full scale load tests in accordance with Section 6 of SANS Code of Practice 0100: Part II.

Where load tests are, in the opinion of the Department, unsuitable or impracticable, and if an examination carried out in terms of the above does not show the concrete strength

to be acceptable, or if a tested portion of the structure fails to pass the tests, the Contractor shall, on the instructions of the Department, replace or strengthen by approved means: —

- a) each portion that failed or contains concrete that failed, as relevant, and
- b) any other portion, irrespective of strength, the functional purpose of which is affected by the portion or concrete referred to in (a) above.

NON-STRUCTURAL PRESCRIBED MIX CONCRETE: — Concrete for non-structural purposes shall be "Prescribed mix concrete" produced in accordance with the requirements indicated in the table below, and the Contractor is also referred to the foregoing Preambles insofar as they apply: —

TABLE E – PRESCRIBED MIX CONCRETE FOR NON-STRUCTURAL PURPOSES

Class of Concrete	Estimated minimum compressive strength in MPA at 28 days	Maximum nominal size of coarse aggregate in mm	Proportion of Constituents		
			Cement (Parts)	Fine Aggregate (Parts)	Coarse Aggregate (Parts)
A	1	37,5	1	4	8
B	15	19,0	1	3	5
C	20	19,0	1	2 ½	3 ½

Cement and aggregates shall be mixed by volume and the contents of a 50 kg sack of cement shall be taken to be 0.033 m³

The cement / water ratios and the maximum and minimum slumps for concrete shall be as previously listed in Tables C and D.

The Department shall have the right to vary the proportions of the constituents in any of the prescribed mixes as necessary to obtain the required compressive strength, optimum density and workability of the concrete. Any variation in the rates of the concrete will only be considered if the proportion of cement to the total volume of aggregate, in each case, is varied from that Specified.

Notwithstanding any requirements previously described, the Department may permit certain items of non-structural concrete in small quantities to be mixed by hand.

Where concrete is mixed by hand, the coarse aggregate shall be spread out on a timber, concrete or metal platform in a flat heap, the sand then spread evenly over the heap, followed by the cement also spread evenly, and the whole thoroughly mixed by shovelling from the centre to the side to form a ring, then back to the centre and again to the side. Water shall then be poured into the ring and the materials mixed into it and then back into the ring, the remainder of the water then added slowly as materials are mixed into it. Mixing shall continue until the colour is uniform and the consistency the same throughout the pile.

"NO-FINES" CONCRETE: — shall consist of one part of cement to eight parts of 19mm aggregate (1:8— 19mm stone) with a water/cement ratio of approximately 0,46. This water/cement ratio may be varied slightly to suit conditions on approval by the Department.

The quantity of water used shall be just sufficient to form a smooth grout, which shall completely coat every particle of aggregate, and also to ensure that the grout is just wet enough to form a small fillet at each point of contact between the stones. "No-fines" concrete mixed with excessive water, which results in a thin grout which drops off the aggregate, will be rejected.

"No-fines" concrete shall be placed in its final position within 20 minutes of mixing and shall be placed in continuous horizontal layers. "No-fines" concrete shall be spade worked sufficiently to ensure that it fills the forms but vibrating, tampering or ramming will not be permitted.

BREEZE CONCRETE: — shall consists of one part cement to eight parts clean dry furnace ashes, the ashes being free from all coal or other foreign matter and graded up to particles which will pass a 26. 5mm ring from a minimum which passes a 4.75mm mesh. The finer materials from the screening to be first mixed with the cement into the mortar and the ashes added afterwards and thoroughly incorporated. The breeze concrete is to be mixed in batches not exceeding 0, 1 in 3 and each batch is to be immediately placed in position. The ashes for breeze concrete are to be obtained in an unscreened state and are to be kept dry so that sufficient fine material will be obtained from the screening to make the mortar.

FINISHES TO IN-SITU CONCRETE

Formed Finishes: — are the concrete surface finishes developed using formwork and whose standard of finish in each class shall be as described.

The Department shall be informed by the Contractor of any defect in terms of this Specification, and no remedial work shall be carried out by the Contractor without the prior approval of the Department. Any defect shall be made good at the Contractor's expense by either removing and replacing the defective concrete, or, in certain instances only, by patching, all as approved by the Department and to the standard of finish required.

Class F1 Ordinary Finish: — Formwork panels shall be of such quality that upon removal, the concrete is true and even, free from fins and recesses greater than 5mm size, honeycombing, large air holes and the like. Bolt holes shall be filled if so required by the Department.

Class F2 Smooth Finish: —This class of finish requires a high standard of concrete work, formwork and technique.

Concrete placed in any one structure to give this finish shall be made from cement and aggregates from the same source, and similarly, the grading of the aggregate shall be kept constant.

Formwork shall be metal or wrot timber in a new condition designed and constructed to suit the particular job in hand and with shutter bolts and joints between panes in a pattern approved by the Department. Joints between panels shall be watertight, but the use of sealing tape, which marks the concrete, shall not be permitted.

Construction joints shall be in the position and of the detail shown upon the working drawings. Should the Contractor wish to incorporate further construction joints or amend the position of those shown to suit his own requirements or technique, this may be allowed provided that all design considerations are met, that the prior approval of the Department is obtained and that any extra costs are borne by the Contractor. In the case of horizontal construction joints, the top edge of the concrete on the Class F2 smooth finish side is to be struck true and level with a trowel.

Special care shall be taken to ensure that forms are clean of all pieces of tying wire, nails and other debris at the time of concreting.

The standard of finish shall be such that, upon removal of the formwork, no further treatment, other than treatment of bolt holes if required shall be found necessary to provide a straight, smooth and uniform finish of good quality and consistent colour and texture, free of all honeycombing and large air holes.

UNFORMED FINISHES: — are those concrete surface finishes developed without the use of formwork -

Class U1 Ordinary Finish: — Immediately after placing, the concrete shall be finished by screeding with the edge of a wooden board of straight and true line and working between guides set accurately to level. No mortar shall be added and noticeable surface

irregularities caused by the displacement of coarse aggregate shall be made good by re-screeding after removing or tamping down the offending aggregate.

Class U2 Wood Float Finish: — The concrete surface shall first be brought to the standard Class U1 ordinary finish and then floated with a wood float. Floating shall be started as soon as the screeded finish is stiffened sufficiently and the bleed water has evaporated or been removed and it shall be the minimum necessary to produce a surface free from screed marks and uniform in texture.

Class U3 Steel Trowel Finish: — The concrete surface shall first be brought to the standard of Class U2 wood float finish with floating being continued until a small amount of mortar without excess water is brought to the surface and then when the floated surface has hardened sufficiently to prevent any more excess fine material from being drawn to the surface, troweling with a steel trowel. Troweling shall be performed with firm pressure such as will flatten the sandy texture of the floated surface and produce a dense uniform surface free from blemishes and trowel marks. Gradual surface irregularities shall not exceed 5mm over any 3m. The sprinkling of sand and/or neat cement on the surface to absorb excess moisture shall not be permitted.

Class U4 Power Float Finish: — The concrete surface shall first be brought to the standard of Class U1 ordinary finish using wooden screeding boards or steel rollers. After evaporation or removal of all bleed water and immediately the concrete is stiff enough to support the machine the surface shall be closed with a mechanical power float and then finished with a mechanical power trowel. The texture of the finished surface shall be either non-slip or polished as shown on the drawings. Irregularities shall be of long wavelength not exceeding a curvature of 2mm in 600mm. Under no circumstances shall sand and/or neat cement be sprinkled over the surface either to absorb excess moisture or to fill surface blemishes or irregularities. Power floats and trowels shall be operated by skilled operators.

TOLERANCES: — Clause 6 of SANS Specification 1200G refers. Unless otherwise agreed by the Department, 'Degree of Accuracy' shall apply to all concrete work and steel reinforcing.

SUPERVISION: — The construction of all concrete work shall, at all times, be under the supervision of a competent person experienced in the production and placing of high-grade concrete. He shall personally supervise all work relating to the concrete construction and pay special regard to: —

- a) The quality, testing and mixing of materials.
- b) The finish, stability and cleanliness of formwork and excavations.
- c) The cleanliness, correct positioning and maintenance in position of steel reinforcement.
- d) The transporting, placing, compacting and curing of the concrete. The construction and stripping of formwork.
- e) The production of samples, test cubes, slump and other tests.

GENERAL

Measurement and Payment: — The provisions of Clause 8 of SANS Specification 1200G will NOT apply and the system of measurement that is adopted in these Bills of Quantities is the only system of measurement that will be recognised in this Contract.

No deductions have been made for pipes not exceeding 200mm internal diameter, reinforcement, conduits, structural steel, bolts and the like.

Rates for Concrete: — are to include for mixing, handling and depositing (by hoisting or lowering) in the forms. Rates for items of reinforced concrete are to include for thoroughly working and packing around the steel reinforcement. All reinforcement, except where otherwise described, has been measured separately.

Rates for concrete surface beds are to include for laying in suitable size panels not exceeding 20m² or as may be directed. The Contractor is to allow in his pricing of the concrete for all construction joints.

Striking off and Curing: — of concrete slabs and surface beds has been measured separately. The rates for all other items of concrete including stairs and landings and concrete bindings, are, except where otherwise described, to include for all necessary striking off of surfaces and curing.

The rates for items of striking off and curing top surfaces of concrete shall, unless otherwise described, apply to level surfaces.

Where exposed sloping surfaces of concrete do not exceed the limits of pitches laid down for the measurement of back shuttering, the striking off and curing of the sloping top surfaces has been measured in the case of concrete slabs and surface beds, and in other-cases provision has been made for dressing the concrete surfaces to splay.

Where items of striking off and curing are described as to falls or ramps this shall include cross-falls, etc.

The rates for striking off and curing of surface beds formed in panels must also include for all necessary temporary formwork in forming the panels.

Rates for Formwork: — are to be for use and waste only (except where described as "permanent") and are to include for fitting together in the required forms, propping, strutting, shoring, wedging, plumbing and fixing to true angles and surfaces, cambering formwork to slabs and beams where required, preparation and treatment of surfaces as necessary to ensure easy release during stripping, reconditioning as necessary before re-use, providing necessary temporary openings for the purpose of cleaning, inspection and placing of concrete, and for all straight cutting, splayed edges, intersections, notching and narrow widths, including waste and properly fitting at intersections, maintaining in position for periods as directed and for striking and removing.

Rates for items of formwork to soffits of slabs and to sides and soffits of beams, lintels and the like are to include for horsing exceeding 1,5m and not exceeding 4,5m high unless otherwise stated in the items.

Rates for formwork to soffits of stairs and landings are to include for all necessary horsing.

Rates for Permanent Formwork: — are to include for leaving in all formwork, props, etc. as permanent formwork shall be regarded as not being recoverable.

Rates for Steel Fabric Reinforcement: — are to include for lapping the reinforcement at all edges, as specified, for all cutting and waste, notching, etc. bending where required, wiring together at laps and for maintaining in position during placing of concrete.

Rates for Steel Bar Reinforcement: — are to include for all cutting, bending, hooked ends, wiring together at passing points, hoisting or lowering to the required levels, fixing in accordance with the detail drawings, cover blocks and maintaining in position during placing of concrete. The mass of mild and high yield stress steel bars shall be based on the values shown in Table E1 of SANS Specification 920— Appendix E (with no allowance being made for rolling margin and waste).

The mass of the binding wire required for fastening the reinforcement together is not included in the mass of the reinforcement. Provision for the cost of this wire shall be deemed to have been made by the Contractor in calculating the unit rate for the net mass (i.e. excluding the mass of binding wire) of the reinforcement.

4. **BRICKWORK**

SAND: — shall comply with the requirements of SANS Specification 1090, washed where necessary and screened through a 2360 micrometer mesh sieve.

CEMENT: — shall be Portland cement of normal setting quality complying with SANS

Specification 471 or Portland cement 15 complying with SANS specification 831. Cement containing more than 15 % blast furnace slag will not be permitted to be used.

LIME: — shall be hydrated lime complying with SANS Specification 523.

WATER: — shall be clean and free from injurious amounts of acids, alkalis, and other organic substances. If so required by the Department, the suitability of the water shall be proved by tests carried out by an approved laboratory.

CEMENT MORTAR: — unless otherwise described, shall be composed of one part by volume of cement to five parts by volume of sand.

COMPO MORTAR: — unless otherwise described, shall be composed of one part by volume of cement, one part by volume of lime to ten parts by volume of sand.

STRENGTH MORTAR: —where required, shall be of the class specified and as defined in Table C-I of SANS Code of Practice 0164—Part I.

MIXING OF MORTAR: — the materials are to be mixed dry on a non-absorbent and close jointed timber or iron platform until the mixture is of uniform colour with water added and the mixture turned over until the ingredients are thoroughly incorporated.

No cement mortar that has once commenced to set will be allowed to be used. Mixing platforms are to be cleaned and old mortar removed before any new batch of mortar is prepared for mixing. No mortar mixing by adding additional materials is permitted after 5 (five) hours.

TESTING OF STRENGTH MORTAR: — During the time brickwork is being laid samples shall be taken of the mortar being used as shall be directed by the Department. A group of three 70mm x 70mm x 70mm test cubes shall be made from each sample for testing at 28 days of age. Each group test cubes shall be deemed to represent the whole of the batch from which the sample was taken and shall be identifiable with the batch.

The testing shall be undertaken by an independent firm or institution nominated by the Contractor to the approval of the Department. An item for the testing of mortar cubes has been provided elsewhere in these Bills of Quantities.

BURNT CLAY COMMON BRICKS: — shall comply with SANS Specification 227 and are to be good quality, sound, hard, well burnt bricks, uniform in size and shape.

A sample load of bricks is to be approved by the Department and all subsequent loads are to be equal thereto.

BRICKS FOR FOUNDATIONS: — are to be as above but extra hard burnt bricks. Reject facing bricks may be used in lieu of extra hard burnt foundation bricks provided they are equal to a sample to be submitted to and approved by the Department. These bricks are also to be used for septic tank walls.

BRICKWORK: —unless otherwise described is to be in burnt clay common bricks and wherever practicable is to be in stretcher bond with the skins tied together with and including galvanized crimped wire wall ties in accordance with SANS Specification 28. The wire ties are to be of sufficient length to allow each end to be built into brickwork built into every fourth course and spaced at 450mm staggered centres (seven ties per square metre). The bricks are to be well wetted before being laid and the course of bricks laid last is to be well wetted before bedding the next course of bricks upon it. The brickwork is to have all perpends flushed up solid and each course is to be laid on a solid bed of mortar. No false headers are to be used. Whole bricks are to be used except where bats or closers are legitimately required to form bond.

Unless otherwise described one brick walls are taken at a nominal thickness of 230mm.

The joints of all walls to be plastered are to be raked out as the work proceeds to form key for plaster. All walls are to be carried up regularly so that no part is built more than 1,2m higher than the adjoining walls.

Mortar joints generally are not to exceed 10mm thickness unless otherwise indicated on the drawings. If a specific brick scale is indicated on the drawings, either drawn or written, it must be adhered to.

Solid bricks to X-Ray Room walls are to be used. If hollow core bricks are used, these are to be grouted up solid.

HOLLOW WALLS: — are to be formed of two thicknesses of brickwork as specified with cavity between, tied together, unless otherwise specified, with and including A.I.S.I. Type 304 stainless steel wire butterfly type wall ties in accordance with SANS Specification 23, of sufficient length to allow each end to be built into brickwork, built into every fourth course and spaced at 450mm staggered centres (seven ties per square metre). Cavities are to be kept clear of all rubbish, mortar droppings and projecting mortar.

BRICK LININGS TO CONCRETE: — unless otherwise described are to be tied to concrete with and including A.I.S.I. Type 304 stainless steel wire wall ties complying with SANS Specification 28 with one end embedded is to deep into concrete and other end built into the brick joints and spaced not less than seven ties per square metre.

REINFORCED BRICK LINTELS: — unless otherwise detailed are to be constructed in accordance with KZN Public Works Type Drawing.

PRE-CAST AND PRE-STRESSED CONCRETE LINTELS: — where specified, are to be of approved manufacture and the Contractor is to provide the Department with a certificate issued by the manufacturer certifying that the lintels are adequate for the purpose in terms of span, loading and number of courses and construction of brickwork above the lintel. The manufacturer is also to specify the minimum bearing required at each bearing end and the nature and period of temporary propping required. Rates or pre-cast pre-stressed concrete lintels are to include for any cement mortar filling required and for temporary propping in accordance with the manufacturer's instructions.

BAGGING DOWN BRICKWORK: — shall be carried out when the mortar in joints is still soft by rubbing over with wet rough sacking until all joints and crevices are evenly filled, including additional mortar if necessary to obtain an even surface or, when the mortar in joints is set, by rubbing over as described but including cement grout as necessary to fill up the joints and crevices.

CRAMPS: — for timber door frames shall be 1.6mm thick galvanized hoop iron 32mm wide with one end turned up 50mm and twice screwed to stile of frame and built 450mm deep into wall with other end turned up into brick joint and cranked as necessary where built into cavity wall. Cramps shall be built in approximately 330mm from top and bottom of stile and intermediately at not exceeding 825mm.

TIES TO WALL PLATES, RAFTERS, ETC.: — shall be 1.6mm thick galvanized hoop iron 32mm wide and at least 1500mm long with one end turned up and built in not less than ten courses deep into brickwork or embedded in concrete beams or slab and with end left projecting and wrapped around timber rafter and spiked to timber wall plate. Where ties are embedded to concrete beam or slab, they must be wrapped around the bottom steel bar reinforcement of the beam or slab.

WELDED MESH BRICK REINFORCEMENT: — shall be 55mm, 80mm, 155mm or 235mm wide consisting of two 3.55mm main high tensile steel wires at 50mm, 75mm, 150mm or 230mm centres respectively with 2.80mm high tensile-steel cross wires electrically welded at 300mm centres, lapped 150mm at end joints, 75mm at angles and built 110mm into connecting walls. No allowance has been made for laps.

BITUMEN EMULSION WATERPROOFING TO BRICKWORK: — The inner thickness of external superstructure walls whether hollow or solid, behind facing bricks, is to be bagged and painted with two coats of approved bitumen emulsion waterproofing compound.

FACING BRICKS. PAVING BRICKS, QUARRY TILES, ETC.: — Facing bricks shall comply with SANS specification 227. Facing bricks, paving bricks, quarry tiles, terra cotta grille blocks, etc. are to be of the types and colours specified, specially selected, free from blemishes, square on all faces, uniform in size, shape and colour and equal to a sample to be deposited with and approved by the Department.

Special care must be taken to preserve the arrases and faces of facing bricks, paving bricks, quarry tiles, etc. during transit and handling.

FACED BRICKWORK: — Facing bricks shall be sorted to ensure proper mixing of the bricks within the colour range of each type of facing bricks. Sudden changes in the general colour of faced brickwork in any one type of facing brick will not be acceptable. Sand used in mortar for faced brickwork is to be clean washed sand and sand from the same source is to be used throughout to maintain a uniform appearance. Faced brickwork is to be pointed as specified as the work proceeds. Keyed-in joints are to be formed with a round jointing tool and square recessed joints are to be approximately 6mm deep formed with a square jointing tool. All perpends are to be accurately kept. The bond is to be broken, if necessary, in the centre of panels above and below windows, above doors, between openings and in the centre of sides to piers. No broken bond will be allowed at reveals or quoins. All cutting to face bricks is to be done with a carborundum or other approved high-speed brick saw. Faced brickwork is to be protected from injury, mortar splashes, etc. and cleaned down with spirits of salts and scrubbed down with water at completion to the approval of the Department.

PAVING BRICKS AND QUARRY TILES: — unless otherwise described are to be pointed as the work proceeds with 6mm wide keyed-in joints. Paving bricks and quarry tile paving, sills, etc. are to be protected from injury, mortar splashes, etc. and cleaned down with spirits of salts and scrubbed down with water at completion to the approval of the Department.

FIBRE CEMENT SILLS: — are to be of approved manufacture without fixing lugs, even in shape, uniform in colour, free from cracks, twists and other defects, in single length between reveals and of the thickness and colour specified and equal to approved sample.

RATES

Brickwork Generally: — Rates for brickwork are to include for hacking the face, or raking out the joints, of brickwork where necessary to form key for plaster, etc. and for plumbing angles and surfaces, all square cutting, wedging and pinning against columns, beams, slabs, etc. for all waste in cutting and wire ties required in tying skins together as described.

Rates for hollow walls are to include in addition to the above for keeping the cavities clean and free of mortar droppings and for butterfly type wall ties, all as described.

Where items are described as cut and pinned, built in, bedded, wedged and pinned, etc. rates are to include for grouting in or bedding solid with 1:3 cement mortar, unless otherwise stated.

Where window units, etc. are described for building in as composite, rates are to include for assembling of units as required and, unless otherwise described, for tap screwing to coupling mullions or transoms, including holes:

Faced Brickwork, etc.: — Rates for all fair and faced brickwork, brick paving, grille block walls and the like are to include in addition to the foregoing for building or laying to true surfaces and angles, all fair square cutting and fitting and cleaning down to approval at

completion.

Rates for brick sills, copings, steps, margins, thresholds and the like shall include for fair ends and angles unless different bricks or tiles are used or special cutting is required.

Rates for items described as "Extra over ordinary brickwork" are to be for the extra cost of the facing bricks specified over common brickwork built in stretcher bond, and are to include for building in cement mortar consisting of one part cement to five parts clean washed sand and for pointing as described.

Rates for items described as "Labour and Material" are to be for the full cost of the facing bricks specified, and otherwise as above described.

Rates for all cut face brick linings are to include for cutting and bonding at ends.

Quarry Tiles: — Rates are to include for all square cutting and fitting, bedding and jointing in cement mortar consisting of one part cement to three parts clean washed sand, for pointing as described as the work proceeds and cleaning down to approval at completion.

Rates for treads, sills, copings, cappings, skirtings etc. are to include for pointing to exposed edges, ends and projecting soffits.

Air Bricks: — Rates for air bricks and air vent, gratings are to include for forming openings through the walls, for all necessary jack arches and turning pieces, for plastering all round the openings in cement mortar, and where in hollow walls, for building cavity solid all round in addition.

Fibre Cement Sills: — Rates are to include for all square cutting, waste, and fitting and for bedding in an approved epoxy adhesive.

Terra Cotta Grille Blocks: — Rates are to include for all square cutting and waste and fitting, bedding and jointing in cement mortar consisting of one part cement to three parts clean washed sand and for pointing with keyed in joints on both faces and into reveals of openings as the work proceeds.

5. WATERPROOFING

GENERAL: — All measurements are nett — no allowance being made for laps in sheet materials or for waste in cutting.

WORKMANSHIP: — All work is to be carried out to the approval of the Department by skilled and qualified workmen and in accordance with the methods prescribed in SANS Code of Practice 021 for waterproofing of buildings.

All work is to be executed in accordance with the instructions issued by the manufacturer of the material being used. Roof coverings and linings are to be laid to the falls, cross falls, etc. provided in the screeds or other surfaces to which they are to be applied.

Surfaces to be waterproofed are to be dry and cleaned of all dust, chips, etc. immediately prior to the commencement of this work and are to be free of any contaminating substances or projections that may damage the waterproofing materials being used.

POLYETHYLENE SHEETING: — is to comply with SANS Specification 952 and bear the SANS mark. The sheeting is to be laid with a minimum lap of 150mm, unless otherwise specified, at angles and junctions with laps sealed in accordance with the manufacturer's instructions.

MASTIC ASPHALT ROOFING: — is to conform to SANS Specification 297 and is to be laid hot in two or three layers, as stated, with each layer of minimum 4mm thickness and laid to break joint with the underlying layer by not less than 150mm.

Prior to the commencement of any work, the specialists who lay the mastic asphalt roofing are to satisfy themselves as to the acceptability of the surfaces upon which the mastic asphalt is to be laid, as the said specialists will be held fully responsible therefore. Mastic asphalt to surfaces not exceeding 10-degree slope is to be laid in two layers on and including one layer of approved reinforced waterproof building paper lapped 75mm at all edges. Rates are to include for all cutting and waste on building paper.

Mastic asphalt to surfaces exceeding 10 and not exceeding 20 slope is to be laid in two layers on surfaces which have been hacked, grooved or scoured to provide an adequate key. Rates are to include for the necessary preparation of the surfaces.

Mastic asphalt to vertical surfaces and surfaces exceeding 20-degree slope is to be laid in three layers on and including any necessary expanded metal lathing securely fixed to the surfaces to prevent creeping. Where vertical surfaces do not exceed 300mm in height the surfaces to receive mastic asphalt may alternatively be prime coated with a latex based bitumen emulsion primer prior to the application of the mastic asphalt.

Anile fillets to all internal angles are to be run in one operation.

Finishing coats of bituminous-based aluminium paint on mastic asphalt roofing have been measured separately.

FLEXIBLE GLASS-FIBRE REINFORCED POLYESTER WATERPROOFING: — shall be of the type specified, or other approved, supplied and laid in-situ by a specialist sub-contractor, all to the approval of the Department and shall carry a written 10 (ten) year guarantee.

The waterproofing applied in-situ shall consist of one layer of three-ply bituminous felt underlay bonded to the substrate and covered with flexible glass-fibre reinforced polyester waterproofing comprising a chopped strand glass-fibre mat having a minimum mass of 450g / m², impregnated with flexible unsaturated polyester resin and finished with two coats of abrasion-resistant flexible unsaturated polyester surface coating which shall not show any sign of the glass-fibre reinforcement. The total mass of the waterproofing (excluding the bituminous felt underlay) shall be not less than 1.8kg / m².

Chopped strand glass-fibre mat reinforcement is to comply with the requirements of SANS Specification 419.

All unsaturated polyester resins are to be suitable for their intended use and comply with SANS Specification 713 and are to be ultra-violet ray stabilised.

All flexible glass-fibre reinforced polyester waterproofing is to be finished to approved opaque colours (excluding red or orange tints), is to be properly cured, and is to be free from porosity, blisters, cracks, surface crazing or other defects which may affect its appearance or its performance, with the surface colours consistent throughout.

Samples of flexible glass-fibre reinforced polyester waterproofing are to be submitted to and approved by the Department and all work executed is to be equal to the approved samples.

EXPANSION JOINT SEALANTS: — Polysulphide sealants, where specified, are to be approved polysulphide sealants complying with SANS Specification 110 Type 2, well compacted into joint.

Rates are to include for priming joints where recommended by the manufacturer of the sealant being used with a suitable and approved primer.

All work is to be executed by the manufacturer of the material, or other specialist firm, all in accordance with the manufacturer's instructions.

RATES: — for all roofing and linings are to include for cleaning and preparing the surfaces to be waterproofed as before described, for protecting from damage and cleaning down, flood-testing if required and handing over in an acceptable and guaranteed watertight condition at completion.

Rates for sheet waterproofing materials are to include for all dressing, bending, narrow widths, angles, intersections, cutting and waste and where applicable for the extra material required for lapping and for sealing laps as described.

Rates for roofing described as laid on "flat" roofs are to include for laying to slopes not exceeding 100mm from the horizontal.

6. ROOF COVERINGS

CONCRETE ROOFING TILES: — shall conform to SANS Specification 542. The tiles are to be of pattern and colour specified and is to be even in thickness, uniform in shape and colour and free from cracks and blemishes. The tiles are to be laid to "straight bond" in accordance with SANS Code of Practice 062 with vertical joints and bottom edges of each course ranging perfectly straight.

Unless otherwise specified each tile in every third course, all tiles in eaves and ridge courses and tiles in every course on each side of hips and valleys shall be secured with copper clout headed nails driven into the battens or with approved non-corrodible tile clips and nails in accordance with the manufacturer's instructions. Where nail holes in tiles have been cut off at hips, valleys, top edges, etc. new holes are to be drilled.

All ridge and hip cappings are to be of the types specified and of colour to match the roofing tiles. The cappings are to be bedded, jointed, pointed and torched up over roofing tiles in 1:3 cement mortar tinted to match the tiles. Where cappings having butt jointed ends are specified, an approved damp proof course conforming to Type C of SANS Specification 952 is to be fixed under, laid over the roofing tiles in accordance with the manufacturer's instructions.

Barge cappings are to be of the types specified and of colour to match the roofing tiles. The barge capping tiles are, unless otherwise specified, to be bedded, jointed, pointed and touched up over roofing tiles in 1:3 cement mortar tinted to match the tiles with every tile drilled and secured with copper clout headed nails to timber barge boards or bearers (elsewhere measured).

Concrete tiles to residential units in non hail area's are permitted.

"CHROMODEK" ROOFING SHEETS: - Shall be the secret fixed type, supplied with all fittings in full-length sheets in the profile and colour as specified. Sheets shall be a minimum of .58mm and maximum of .8mm thickness. When .58 thick sheets are used, purlin spacings shall be a maximum of 1.2mtr ϕ and maximum 1.5mtr ϕ for .8 thickness. Sheets shall leave the factory in the specified colour and any scratches etc., due to handling are to be 'touched up' on site after installation. All fixings, valleys, cappings and securing clips shall be to manufacturers' recommendations and no variations shall be accepted without prior approval from the department.

0,58mm thick roof sheeting for purlins up to 1,2m spacing and 0,8mm thick roof sheeting for purlins exceeding 1,2m – 1,5m spacing.

In area's up to 30Km from the coast, metal roof sheeting to be 0,58mm thick with special corrosion protection as supplied in "Global- Duro" roofing sheets. All other area's to be 0,58mm as "Global-Tech corrosion protection. 0,58mm "Klip Lock 700 " or "Crafflock " and 0,8mm " Brownbuilt ". (0,8mm is recommended for high rainfall and snow fall area's due to deeper trough.)

RATES: — for roof coverings, are to include for all necessary half tiles at verges and for all square cutting and waste at verges, abutments, and top and bottom edges and to both sides of ridges.

Rates for cappings, etc. are to include for all short lengths, cutting, waste and fitting at intersections.

All measurements are nett. No allowances have been made for overlaps.

CORRUGATED IRON ROOFING, CLADDING AND FITTINGS: — are to be of an approved brand and are to be manufactured from galvanized steel sheets of the thickness specified after galvanising and having a galvanized coating of "Isacor Coating Designation Z275" for inland areas and 'Z600" for coastal areas as specified.

Roofing, etc. shall be lapped one and a half corrugations at sides and 30mm at ends unless otherwise specified. Roofing, etc. shall be fixed to timber purlins, rails etc. with standard galvanized drive screws 65mm long and to steel purlins, etc. with 8mm galvanized hook bolts of the lengths stated.

Each screw or bolt shall be fitted with one lead washer and one bituminous felt washer and shall be spaced not less than one screw or bolt to every alternate corrugation across the width at end laps and ends of sheets and at each intermediate purlin or rail.

Rates for roofing, cladding and fittings are to include for: —

- a) Fixing as described.
- b) Bedding washers in an approved mastic sealing compound
- c) Coating projecting ends of hook bolts and nuts with bitumen after fixing
- d) All square notches, square cutting and waste, laps, fitting and drilling. All measurements are nett. No allowance has been made for laps.

FLUTED STEEL ROOFING, CLADDING AND FITTINGS: — are to be approved galvanized fluted steel sheets and fittings manufactured from galvanized steel sheets of the thickness specified after galvanising

(a) **Galvanized steel sheets and fittings:** — are to be manufactured from galvanized steel having a galvanized coating of "Isacor Coating Designation Z275" for inland areas and of "Z600" for coastal areas as specified with the sheets having a plain galvanized finish and the fittings an embossed galvanized finish.

Roofing, etc. shall be fixed to timber purlins, rails, etc. with standard drive screws of the lengths stated and to steel purlins, rails, etc. with 8mm galvanized hook bolts of the lengths stated. Each fixing screw or bolt shall be fitted with washers as recommended by the manufacturer of the roofing

Vertical cladding shall be fixed with broad flutes externally - unless otherwise described - to timber rails with standard galvanized drive screws 50mm long and to steel rails with 6mm diameter x 25mm long galvanized sheet bolts. Each fixing screw or bolt shall be fitted with washers as recommended by the manufacturer of the cladding including drilling steel rails as necessary.

(b) **Baked enamel finished galvanized steel sheets and fittings:** — are to be manufactured from un-passivated galvanized steel having a galvanized coating of "Isacor Coating Designation Z275" and finished where described in the items, with approved factory applied baked enamel finish of colours to be selected by the Department.

Roofing, etc. shall be fixed to timber purlins, rails, etc. with sherardised or stainless steel drive screws of the lengths stated and to steel purlins, rails, etc. with 8mm diameter sherardised or stainless steel hook bolts of the lengths stated. Each fixing screw or bolt shall be fitted with washers as recommended by the manufacturer of the roofing.

Vertical cladding shall be fixed with broad flutes externally, unless otherwise described, to timber rails with sherardised or stainless steel drive screws 50mm long and to steel rails with 6mm diameter x 25mm long sherardised or stainless steel sheet

bolts. Each fixing screw or bolt shall be fitted with washers as recommended by the manufacturer of the cladding including drilling rails as necessary.

- (c) **Generally:** — where sheet lengths are in excess of 12m these have been measured separately.

Roofing, etc. shall be lapped one flute at sides and 230mm at ends unless otherwise specified. Fixing roofing sheets are to be spaced one every crest along purlins at top and bottom edges of roof slopes and one to every alternate crest along intermediate purlins. Fixings to vertical cladding are to be spaced one to even alternate trough to each rail.

Fittings, unless otherwise specified, are to be lapped a minimum of 150mm and where necessary are to be drilled for and fixed with the fixings securing the roofing and cladding sheets.

Rates for roofing, cladding and fittings are to include for: —

- (a) Fixing as described and in accordance with the manufacturer's instructions.
- (b) Seam bolting all side laps at not exceeding 450mm centres with 6mm diameter x 25mm long sheet bolts or with 20mm x No. 14 self-tapping screws and each screw or bolt is to be fitted with washers as recommended by the manufacturer of the roofing.
- (c) Fixing of fittings where described as fastened to roofing, cladding, etc. with approved pop rivets spaced at not more than 340mm centres.
- (d) Sealing side and end laps of sheeting and end laps of fittings with one continuous strip of approved 5mm diameter pre-formed flexible sealant strip.
- (e) Coating the exposed heads of fixings and fasteners to baked enamel finished materials and cut edges of sheets and fittings with matching touch-up compound supplied by the manufacturer of the sheeting and in accordance with his instructions.
- (f) All square notches, square cutting and waste, laps fitting and drilling. No punched holes will be permitted.
- (g) Taking special care at all times to prevent damage to the finished surfaces of the baked enamel finished materials.

All measurements are nett. No allowance has been made for laps.

7. CARPENTRY AND JOINERY

NOMENCLATURE OF TIMBERS: — Timber described as "softwood" is to be South African softwood of the relevant type, grade, etc. as specified.

The names used for imported timbers are those given in Supplement No. 1 to SANS Code of Practice 12 under "Nomenclature of Standard Trade Names of Imported Commercial Timbers used in South Africa" and the Contractor is referred thereto.

TIMBER SIZES: — Sawn and wrot timbers are to be of the full sizes stated.

Where "out of" sizes have been shown for wrot timbers on the drawings, an allowance of 4mm for each wrot face off the sizes shown has been made.

Doors, fanlight, sashes, manufactured boarding, plywood, veneers, etc. must be of the full thickness specified.

Where doors, door frames, fanlights and frames; sashes, windows and frames are measured as numbered items, the overall sizes are given to the nearest 10mm.

Tolerances in nominal dimensions for imported timber shall not exceed the following:

- a) For nominal dimensions up to 76mm the actual dimension may be 2.5mm under for each 25mm
- b) For nominal dimensions 76mm and over the actual dimension may be 1.6mm under for

each 25mm.

STORAGE OF TIMBERS: — Timber delivered to the site is to be properly stacked above ground, either on bearers or platforms under cover and protected from inclement weather.

ORDERS: — for timber, are to be placed immediately after the Contract is signed, as the Contractor will be held responsible for any delay in delivery.

PRE-TREATMENT OF TIMBERS: — All permanent timbers installed in the buildings are to be treated against borer, cryptotermes, termites, and all wood destroying agencies with an approved preventative, all in accordance with SANS Code of Practice 05.

Any surface subsequently exposed by cutting or planing must be touched up with the same preservative solution and rates are to include for all preservative required.

The Contractor is to obtain a certificate from the merchants supplying the treated timber, to the effect that the timber has been treated against wood destroying agencies. The Department has the right to remove samples of the treated timber to have tests carried out by the Division of Entomology or any other Authority.

Temporary timber on the site, e.g. shuttering props, etc. must be free from wood destroying agencies. Any timber so affected is to be immediately removed from the site.

Materials which do not comply with the above requirements or are in any way damaged or discoloured by the pre-treatment must be replaced by the Contractor at his own expense, if so directed by the Department.

STRESS GRADING OF SOFTWOOD TIMBER: —The Mechanical Stress Grading of Softwood Timber (Flexural Method) shall be in accordance with SANS Code of Practice 0149.

STRUCTURAL TIMBER: — for carpentry is to be South African softwood in accordance with SANS Specification 563 and, unless otherwise specified, of Stress Grade V4, and branded accordingly. If it is necessary to use sizes that have to be re-sawn, these shall be re-graded and stamped with the respective SANS stress grade mark. Unless this is done, timber which is re-sawn is no longer considered as complying with the specification and shall on no account be used.

BRANDERING / BATTENS: — of cross-sectional size 50 x 50mm and under shall be South African softwood in accordance with SANS Specification 653 and branded accordingly.

JOINERY AND SHELVING: — Softwood for joinery and shelving shall be South African softwood (S. A. Pine) in accordance with SANS Specification 1359 and branded accordingly. All timber for joinery is to be air or kiln-dried to a moisture content of approximately 12 %.

Shelving to linen stores to be timber slatted with wall bands or free standing units as specified.

STRUCTURAL LAMINATED TIMBERS: — are to be of the sizes detailed, wrot on all faces and are to be manufactured by an experienced fabricator to the approval of the Department. Adhesives used must meet the requirements of the current SANS 1204 for external use.

The surface appearance of members shall be Class C (Constructional) or Class S (Selected) as defined in SANS Specification 876 and as stated in the items

FINGER-JOINTED TIMBERS: — are to be manufactured in accordance with SANS Code of Practice 096— "The manufacture of finger-jointed structural timber".

Contractors wishing to use finger-jointed timber must supply a guarantee that the finger jointing complies with the above Code of Practice and that the glue is suitable for the particular member.

JOINTING OF PURLINS, FASCIAS, RAILS, BEAMS, ETC.: —shall, unless otherwise detailed, be as follows: —

Purlins, slating battens, etc. of cross-sectional size 50 x 76mm and under shall be jointed over the rafter. Larger sized purlins may be dealt with in the same way or by using some other suitable, recognised method. All purlins and battens shall be fixed to the supporting rafter by at least one nail skew driven from the direction of the ridge. Where the purlin or batten is fixed at more than 900mm centres, at least two nails shall be used at every fixing point.

Fascias shall be jointed over rafters.

Beams, rails, etc. shall be jointed over a support or at 1/5th span with a recognised joint using bolts, etc.

Roof and floor plates are to be halved at joints, angles and intersections and nailed together.

Floor joists and bearers are to have splayed heading joints nailed together and staggered to occur over bearers and sleeper piers respectively.

Sawn brandering is to be butt-jointed at heading joints and angles and where wrot, is to have splayed heading joints and mitred angles over all point of support.

HARD WOODS: — (Red Meranti and Sapele) are to be best quality, specially selected and well seasoned, free from all sapwood to the approval of the Department and are to be well kiln-dried.

Red Meranti is to be even in grain and colour, selected from "Standard and Better" grade from Malaysia. Sapele is to be *Entaindrophragma cylindrium* of F..A.S. grade.

PREFABRICATED TIMBER ROOF TRUSSES: -

Design: —The design of prefabricated roof trusses, bracing, and secondary members forming part of the total timber roof construction shall be prepared by a professional structural engineer (Truss Systems Engineer) strictly in accordance with SANS Code of Practice 0160 and the superimposed loading, unless otherwise specified, is to be taken as that for inaccessible roofs.

Analysis: — From the configuration and mechanism shown on the tender drawings the Truss System Engineer shall submit, through the Contractor, to the Department detailed calculations and working drawings showing timber sizes, connections, truss dimensions, etc.

This submission must include details of both trusses and bracing as specified below:

- a) TRUSSES: The analysis of the truss system is to include diagrams of the trusses with marked up members and nodes showing dimensions, positions of supports and positions and values of applied loads, which, if not specified in the tender documents, must be derived from an approved source of reference which shall be indicated in the analysis. Due account must be taken of any eccentricity particularly at supports.

The analysis must also indicate allowable stresses, internal axial forces, moments and resulting stresses, as well as timber sizes and grades and detailed plate sizes

- (b) BRACING: Bracing must be designed to withstand the forces specified in SANS Code of

Practice 0163 clauses 6 and 7.

If the bracing system incorporates trusses, the additional forces must be shown in the analysis of the trusses.

The drawings must give all the information necessary for the construction of the bracing.

An outline of the bracing system, including temporary bracing must be shown on a working drawing giving clear details of fixings and anchorages into the supporting structure at wall plate level. Interference of bracing with truss members must be taken into account. Moments caused by forces applied between node points of bracing trusses and the axial forces must be given in the bracing calculations, also sizes and fixings of the bracing system.

Submissions: — A copy of letter reference TR1 (attached at the end of this document) completed and signed by the Truss System Engineer must be submitted by the Contractor at the same time as the list of Sub-Contractors. Two sets of calculations and drawings with pertinent erection instructions for the whole roof construction as presented by the Truss System Engineer must be submitted to the Department for consideration and permission to proceed.

This in no way absolves the Contractor of his responsibilities.

Any modifications to design or drawings are to be arranged directly between the Truss System Engineer and the Department. It will be the Contractor's responsibility to ensure that information is presented to the Department in good time and no claims will be entertained in respect of any delays resulting from the late approval of drawings, etc.

Any difference in cost between the roof system initially submitted by the Contractor and the finally accepted system to meet the original design requirements will be for the account of the Contractor.

The Truss System Engineer will be required to inspect the roof structure and certify on letter reference TR2 (attached at the end of this document) that the construction is in conformity with his design, and any costs in this respect must be included in rates for the truss system.

If, in the opinion of the Department, further visits are necessary due to errors or omissions on the part of the Contractor or the Truss System Engineer the costs of these inspections will be for the account of the Contractor.

Fabrication and Storage: — Fabrication shall not commence until written permission has been given by the Department. The prefabricated roof trusses shall be manufactured, supplied and delivered to site by an approved manufacturer with all members accurately mitre cut, close butted and rigidly fixed together by approved galvanized metal spike connectors applied simultaneously to both sides of every joint by use of a mechanical press in accordance with SANS Code of Practice 0163.

Permissible deviations in fabrication of trusses are to be as specified in SANS Code of Practice 0155.

The following will not be permitted at joints: —

- b) knots, splits or finger joints
- c) varying member thicknesses
- d) plates not fully pressed into timber
- e) gaps between members exceeding 1.5mm average over the width of the mitred members.

Stress grade marks must be clearly visible on all members.

Relevant dimensions must be checked on site before fabrication. Trusses must be stored off the ground and under cover both at the factory and on site.

Erection and Bracing: — Unless otherwise instructed, erection must be carried out as described in “The Erection and Bracing of Timber Roof Trusses” published by the Truss Plate Association of South Africa and the National Timber Research Institute - CSIR.

Where the overall lengths of trusses exceed 13 m, complete braced bays are to be assembled on level ground and lifted into position suspended at maximum 3m intervals from a spreader bar. Alternatively, braced bays may be assembled in position on a minimum of two lines of temporary intermediate supports below node joints. Temporary supports must be removed before roof covering is placed.

The erector must be suitably qualified and must satisfy the Department that he can meet the specification.

Where the roof incorporates a hipped end, the construction is to commence with the hip, otherwise erection is to be commenced with a fully braced bay.

Temporary bracing must be installed as erection proceeds in accordance with the accepted design.

The Contractor must notify the Department in sufficient time in order that an inspection may be made before the roof covering is placed.

The trusses will be subject to the following tolerances: —

- a) maximum out of straight — length/400
- b) maximum out of vertical at any point—height/200.

Rates: — The Contractor is to allow in his rates for the roof trusses for the design, manufacture, supply, hoisting and fixing of the roof trusses and permanent bracing, any necessary temporary bracing, and for the costs of all inspections by the Truss System Engineer.

Purlins or battens for roof coverings have been measured elsewhere. Rates for roof trusses are also to include for the exposed rafters at eaves overhangs to be wrot all round and trimmed and splay cut as required.

INSULATION, WATERPROOFING AND DUST PROOFING MATERIAL FOR ROOFS: — shall be of an approved aluminium foil faced both sides laminated Kraft Paper and synthetic reinforced material fixed in accordance with the manufacturer’s instructions, lapped 150mm at all edge, unless otherwise specified.

GYP SUM PLASTERBOARD: — is to be in accordance with SANS Specification 266.

GYP SUM COVERED CORNICES: — are to be in accordance with SANS Specification 622.

FIBRE CEMENT SHEETS: — are to be in accordance with SANS Specification 685.

FIBRE CEMENT CELLULOSE SHEETS: — are to be in accordance with SANS Specification 803.

HARDBOARD: — is to be in accordance with SANS Specification 540. Tempered and un-tempered hardboard is to be conditioned in accordance with the manufacturer’s instructions before fixing in position.

VENEERS: — All decorative face veneers are to be selected kiln dried of best quality of the respective timbers, free from knots, cracks, patchwork, sapwood and other defects and bonded under heat and hydraulic pressure with water-resistant synthetic resin adhesive.

Commercial veneers are to be selected rotary cut hardwood veneers and otherwise as

described above.

PLYWOOD: — is to be long grain three or five-ply type manufactured with hardwood veneers with selected face veneers as described, bonded under heat and hydraulic pressure with water-resistant synthetic resin adhesive and sanded to a smooth finish.

CHIPBOARD: — All joinery fixtures shall be manufactured from 18mm Moisture resistant V313 Melamine Faced Chipboard (Particle Board) only with 32mm worktop as specified.

BATTEN BOARDING: — is to be long grain three-ply boarding manufactured with kiln-dried South African Meranti softwood core formed of laminations not exceeding 45mm wide and faced on both sides with selected veneers as described, bonded under heat and hydraulic pressure with water-resistant synthetic resin adhesive and sanded to a smooth finish.

DECORATIVE LAMINATE LININGS: — are to be 1.2mm thick approved general purpose quality high pressure decorative melamine laminate sheeting with satin finish and of selected colours and patterns, and rates are to include for all square cutting and waste and square notching, close cut and mitred external angle intersections where required and for bonding to the timber backings with an approved adhesive in accordance with the manufacturer's instructions.

The linings are to be cut out of single sheets in obviate joints but where joints are unavoidable, the sheets are to be butted to form a tight inconspicuous joint.

NAILS AND SCREWS: — Mild steel nails are to be in accordance with SANS Specification 820. Mild steel and brass screws are to be round headed, countersunk, etc. as appropriate and are to be in accordance with SANS Specification 1171. Nails and screws shall be of the size, length and type appropriate to their respective uses.

PLUGS, ETC.: — Where items of woodwork are described as "plugged", these may be nailed to timber plugs or slips built into the structure, and where described as "plugged and screwed" these may be screwed to timber or approved patent fixing plugs.

SHOT FIXING: — Where items of woodwork are described as "shot fixed" these are to be fixed with an approved cartridge-assisted tool, and rates are to include for all nails, spikes, blanks, washers, cartridges, accessories, etc.

CARPENTRY: — Timbers are to be the best of their respective kinds, free from sap, shakes, large, loose or dead knots, wavy edges and other defects and thoroughly seasoned. Wrot surfaces are to be finished clean, smooth and free from tool marks.

Timbers shall be in as long lengths as possible.

Rates for sawn and wrot structural timbers are to include for notching, splay and birds mouth cutting, housing, halving, scarfing, cutting timbers to the required lengths, spiking and clinching and or hoisting and fixing timber in position.

CEILINGS: — are to be of the types described, fixed to timber branderling, bearers etc. as described and with panels set out so as to give even width panels not less than half a sheet wide at edges. Branderling shall be spaced at not more than 400mm c/c and fixed at right angles to sheets.

FLUSH PLASTERED CEILINGS: — are to be formed of gypsum plaster board of the thickness stated, generally in 1200mm widths and long lengths, fixed grey side down to timber branderling, bearers, etc. as described, with butted joints between the boards covered with 65mm wide strips of galvanized wire scrim fixed along both edges, including all square notches and square cutting and waste, and the ceiling finished with two coats of approved retarded hemi hydrate gypsum plaster applied in accordance with the manufacturer's instructions to a finished thickness of not less than 6mm, including pressing into scrim over joints and finished to a smooth polished surface.

TRAP DOORS:- 900 x 600 Prefabricated hinged trap door.

SUSPENDED CEILINGS BOARDS: — are to be of the types described or as specified – normally 6mm x 600mm x 1200mm embossed fibre cement boards - and inclusive of their component parts must be of sufficient strength to perform the function for which they are to be used, manufactured from best quality materials and conform to the requirements of the Fire Master. The exposed surfaces of all ceiling panels and supporting members are to be uniform in colour and free from surface blemishes.

Hangers are to be galvanized and are to be at maximum 1, 2mtr centres to meet the requirements of the specification, each with one end fixed to the suspension grid main bearers and the other end fitted with suitable galvanized fixing straps to the roof structure. Fixing points must be agreed to by the Department before any power shot fixings are made. Hangers must not be suspended from air-conditioning ducts. Hangers to be provided at all four corners of recessed light fittings.

Component parts and fixings other than aluminium must be non-corrosive and able to withstand atmospheric pollution. Surfaces of aluminium which are in contact with other materials when fixed, particularly ferrous metals, are to be suitably insulated to prevent electrolytic corrosion.

All work is to be executed by specialists in accordance with the manufacturer's instructions, and to the approval of the Department.

Rates for ceilings are to include for hangers, suspension systems, ceiling panels, for constructing the ceilings in a manner suitable for carrying air conditioning diffusers and light fittings in the positions required, for setting out the ceilings to layouts approved by the Department, for all non-standard size panels, for modifications to standard suspension systems as necessary to work around any air-conditioning ducts or pipes or light fittings, for all necessary square cutting and waste, notching and fitting around projections, columns, etc.

EXPOSED TEE-SYSTEM SUSPENDED CEILINGS: — are to be of the type described with main tees and cross tees spaced at the required centres to suit the sizes of panels used, with the cross tees fitted between and notched to form a flush fit with main tees unless otherwise described. All suspended ceilings to be fitted with shadow line trimming to perimeters.

Main and cross tees shall be holed as necessary and provided with timber wedges or steel clips to prevent ceiling panels from lifting.

CONCEALED TEE-SYSTEM SUSPENDED CEILINGS: — are to be of the type described with main and cross tee section bearers spaced at the required centres and all properly fitted together at intersections.

ALUMINIUM TRIMS TO CEILINGS: — are to be of extruded aluminium of 6063-TF or equivalent quality and temper, of the sections described. Anodised trims are to be of the colour stated.

Rates are to include for all cutting, fitting at intersections, mitres, etc. and rates for items described as fixed with screws are to include for countersunk drilling and fixing with approved countersunk stainless steel screws.

INSULATION MATERIAL FOR CEILINGS: — shall be 75mm thick resin bonded glass wool / mineral wool thermal insulation blanket complying with SANS Specification 1381 of the thickness specified, delivered to the site in unopened rolls in its original factory wrappings over solid gypsum boards or styrene of 25mm thickness as specified glued to suspended ceiling tiles.

DOORS: —

Flush Doors: - Semi-solid and solid laminated flush doors are to be of approved manufacture complying with SANS Specification 545.

The doors are to be finished on both sides with the facing veneers specified and concealed on both stiles unless otherwise specified, with hardwood edge strips and where doors are required to receive a transparent finish, the edge strips are to match the facing veneers.

Doors with rebated meeting stiles are to have edge strips to the meeting stiles not less than 19mm thick.

Each door or leaf of double door, described as hung to swing, is to be fitted with necessary hardwood reinforcing blocks for bottom shoe and top centre of spring hinge.

Unless otherwise specified, all flush doors are to be interior quality, but, where exterior doors are specified, the glue used must comply with Type WBP of SANS 2304.

FRAMED, LEDGED AND BRACED BATTEN DOORS, ETC.: — Doors described as filled in with V-jointed boarding are to be filled in flush on one side with tongued and grooved vertical boarding, V-jointed on one or both sides and of the thickness stated. The boarding is to be in narrow widths, closely cramped up, rebated on outer edge and housed to grooves in stiles and rails and twice brass countersunk screwed at each intersection.

Ledges and braces and inner edges of the abutting stiles and rails are to be chamfered to form a V-joint at junction with the boarding. Braces to fall from lock to hinge side.

ENTRANCES TO SECLUSION WARDS: - Entrances to seclusion ward buildings shall be fitted with remote controlled full height 'Man Trap' Security Cubicles with bell pushes fitted to both entry and exit sides and remote unlocking / release operation enabled from security booth.

Doors to Seclusion Rooms: - Doors to seclusion rooms are to be steel lined solid core units with 100mm x 100mm viewing panel, glazed with 40mm bullet proof glass in a steel frame. Steel lining for doors is to be epoxy laminated to doors and around edges. Internal steel lining to be primed and finished with approved epoxy paint. External face of doors to be finished in veneer as per DOH standard details. Doors to be hung to open inward on special 6mm galvanized steel door frames with lugs pre welded to frame to fit every third course of brickwork. The complete unit is to be hot dip galvanized and built into surrounding 230mm solid brick walls. No welding to be done on site.

NOTE: - Above Anti-Bandit Security doors are solely supplied by "Chubb" and "Bitcon Industries" as a complete unit with all fittings and ironmongery.

DOORS TO X-RAY UNITS

Entrance doors to X-Ray rooms shall be top hung sliding door size 1830 x 2032 x 40mm, complete with heavy duty sliding door track – 'Henderson' or other approved -, 2.2mm lead insert between panels and four door stoppers. Door is to overlap door opening 100mm each side when closed.

JOINERY: — All timbers shall be in as long lengths as possible. Lengths for joinery shall be single where possible and where joints are unavoidable, they shall be made as inconspicuous as possible.

Timber for grounds, firrings, blocks, plugs, etc. shall be sound and free from defects.

All joinery work is to include for work in connecting by mortise and tenon, dovetailing, housing, flush pinning, etc. as may be by required and for all screws, nails and glueing

together and for sinking flush all exposed screws unless otherwise specified.

Wrot surfaces and edges are to be steel scraped and sandpapered before and if necessary, after fixing.

Edges are to be arras rounded unless specified to be angle rounded.

"Arras rounded" denotes that the sharp edges are slightly rounded off and that no mitring is required.

"Angle rounded" denotes rounded from 3mm to 10mm radius and is to include for housed and mitred joints.

Hardwood doors, frames, jamb and soffit linings, etc. are to be treated on all surfaces with one coat of approved sealer before building in, etc. and rates for these items must include for this. Batten doors with tongued and grooved battens are to have the tongues and grooves well sealed before assembling. The sealer used shall be compatible with the finishing coats to be applied.

Horns of door frames are to be checked and splayed back where frames are fixed projecting or flush with surface and built in.

Where doors, fanlights or sashes are described as hung to butts on steel or aluminium frames, rates are to include for supplying necessary steel, brass or stainless steel screws.

Panel work is to be secured to the grounds, etc. with screws concealed behind the mouldings or by sinking the screws and pelleting as directed.

Joinery is to be framed up, but not glued or wedged, immediately the order is given to commence work. Wherever possible, joinery shall not be placed or fabricated in position until the plaster has dried out. Reasonable tolerance shall be provided at all connections between the joinery and building carcass so that any irregularities, settlements or other movements shall be adequately compensated. All joinery shall be accurately scribed to fit the contour of any irregular surface. Should the joints of any joinery open or give, such defective work is to be taken down, refitted and redecorated or replaced by new joinery at the Contractor's expense.

Only brass screws may be used for hardwood joinery.

The Contractor is to allow for cross-tonguing all solid wood sections unobtainable in single widths.

No joinery is to be primed until it has been inspected and approved by the Department.

All joinery liable to injury must be protected to the satisfaction of the Department. Rates must include for this temporary protection.

Rates for timber frames, mullions, transoms, linings, standards, rails, fascias, cornices, skirtings, beads, picture rails, etc. are to include for mitres, etc.

Rates for all items of timber-are to include for fixing and planting on as may be required with necessary panel pins or nails.

PARTITIONS:

These are to be of an approved system of standard construction, with an average sound rating of not less than 30 decibels taken over the whole face area.

Framing is to be natural finish anodised aluminium comprising posts at 1200mm centres unless otherwise described, with transom rails where specified, fitted between the posts, a

rail against ceiling and an aluminium standard skirting on each side at base, all neatly and securely fixed together.

Provision is to be made at the base of the partitions and in the ceiling rails and posts for electrical wiring, which will be installed under the electrical sub-contract, and the ceiling tails and end posts are to be fitted with continuous removable access plates.

Solid panelling is to be approved solid chip core panels of the thickness specified faced on both sides as described in the items.

Glazed panels are to be glazed as required, complete with all necessary natural finish anodised aluminium glazing beads and vinyl glazing strips.

Louver panels where specified are to be approved natural finish anodised aluminium adjustable louver sets each comprising head and sill weather bars and two jamb strips each fitted with louver brackets with spring loaded clips for and fitted with and including louvers as required and complete with tilt bars and operating lever handles. Where the openings are not the correct size to suit a full number of standard width louver blades, an alternate head weather bar must be provided to suit a fixed louver blade of the required width. The louver sets are to be fitted with the jamb strips positioned horizontally so that the louvers will be fixed vertically.

Partitions are to be in 1200mm modules, unless otherwise specified, except at ends where the odd lengths are to be made up by a narrow width at one end of the partition.

Ends of partitions against walls, window frames, etc. and the top edge of partitions against ceilings are to be fitted on both sides of partition with approved vinyl scribing sections fitted between the structure and the end post or top rail of the partition.

Plain openings are to have aluminium frames similar to door openings neatly fitted into the framing.

Doors are to be solid laminated flush doors complying with SANS Specification 545. The doors are to be finished on both sides with veneer as described in the items and concealed on both stiles with matching hardwood edge strips.

Where doors are described as having observation openings, these openings are to be of the sizes stated, glazed as specified with all edges bedded in approved neoprene gaskets and fixed with 10 x 25mm wrot matching hardwood rebated glazing beads mitred round and bradded to both sides.

Rates for doors are to include for all necessary additional aluminium framing to form door openings, and for hanging the doors on and including one and a half pairs of 102mm satin chrome finish brass hinges to each door.

All locks to doors in demountable partitions are to be supplied with two keys, and are to be controlled by the same master key as the mortise locks used elsewhere in the Contract when specified.

Unless otherwise specified all veneered solid panelling and doors are to be finished as follows: —

Prepare, stop with tinted stopping, apply an approved stain as necessary to achieve uniform colour appearance, and three coats of approved clear matt polyurethane finish including burnishing with steel wool between coats.

Rates for demountable partitions are to include for supplying, assembling, erecting, finishing, glazing and fixing complete between finished surfaces of concrete floors, plastered walls and ceilings, and all in accordance with the manufacturer's instructions.

DEMOUNTABLE PARTITIONS 50MM (NATURAL ANODISED).

Extruded Aluminium Sections

Supply and fit demountable "Kappa" partition system comprising anodized aluminium U-Channel fitted to suspended ceilings. Vertical split-post (mullion) to be fitted between floor and ceiling U-Channel at 1225mm c/c with angle brackets. Once framing is fixed, fit panels into place and secure with clip-on cover plates.

All aluminium sections may be anodized or powder coated in a variety of colours.

Panels

41mm thick semi solid core panels 2032 x 1200mm. The panels are made up of two outer skins of 3.2mm hardboard cladding. Lower panels to be provided with a 150mm wide solid mid-rail 850mm from the base of the panel to the centre of the mid-rail built in as part of the construction. The panels to be prepared before applying the final finish as specified.

Construction

Right angled corners to be formed with natural anodized aluminium radiused corner post fitted from floor to ceiling. Floor fixing to be angle brackets and ceiling fixing to be hidden block. The ceiling U-Channel butts up against radiused corner post.

Door Frames

Door frames to be natural anodized aluminium pre-fitted with woolpile gaskets, clipped into H-Profile at head and clipped into combination split post and cover plate at styles. The rebate on the door frame caters for standard doors of a thickness between 40mm and 44mm.

Glazing

Glazed panes to be framed with H-Profile fitted horizontally at top and bottom, butted against side of split-post and clip on cover plate combination and fixed with angle brackets. Glazing sections pre-fitted with woolpile gaskets and set into H-profiles and into post / cover plate combinations to form a neat glazing opening. Glazing beads pre-fitted with woolpile gaskets and then clipped into glazing section.

Termination

Openings for louver frames, sliding doors and windows, serving hatches and partition ends are to be lined with the aluminium termination section.

Skirtings

76mm high aluminium skirting to be glued to panels.

DRYWALL PARTITIONS:

Studs

50mm x 33.5mm x 0.5mm thick drywall galvanised steel studs are used. The studs to receive aluminium extrusions clipped onto both sides of the stud. Framing to be securely fixed to walls, floor and ceilings where necessary. Stud connectors to be used to join horizontal studs to vertical studs.

Floor Track

52mm x 25mm x 0.6mm galvanised sheet steel track to be used.

Panels

12,7mm thick tapered edged gypsum plasterboard panels used and decorated in situ with panels secured to either side of framework.

Patient care areas to be 12mm Supa Wood panels in framework as specified.

Construction

Internal walls are constructed by fixing drywall studs to floor track @ 600mm c/c. Wall and ceiling junctions are formed by fixing 84mm x 19mm aluminium ceiling and wall channel to wall or ceiling. The floor track is then fixed into this; alternatively, these components may be fixed simultaneously. The studs are then fixed to floor.

The partitions, unless otherwise described are to be 75mm thick and covered both sides with 12,7mm thick tapered edged gypsum board in 1200mm widths to height specified.

The gypsum boards are screwed @ +/- 300mm c/c at all intersections to the floor and head wall tracks and vertical studs.

Using self-drilling, self-tapping, rust proofed countersunk screws, with screw heads and joints between boards and between abutting edges of boards flushed up with an approved jointing material.

Exposed Aluminium Framing

Door frames, glazing termination and ceiling and wall channels to be natural anodised aluminium. 25 x 25 x 1.5 aluminium angle stuck to external corners of partitioning. 80mm high aluminium skirting glued in position.

Glazing

Aluminium glazing section is clipped onto the flanged end of the stud around the glazing perimeter. The glazing section has a recess to accept a rectangular clip-in glazing bead which enables 3mm-8mm thick glass to be received in the system. The glass is retained with various sizes of PVC glazing gasket.

Termination

Openings for louver frames, sliding doors and windows, serving hatches and partition ends are to be lined with the aluminium termination section.

Skirting

The system is designed to accept recessed base, female, 60mm high aluminium skirting.

Sound Insulation

75mm Fibreglass Cavity Bat with a 35g glass tissue or 75mm Isotherm "Acoustisorb" mineral wool blanket is to be installed between studding before fixing final outer panel.

All work is to be executed by a firm specialising in this type of work and all to the approval of the Department.

8. FLOOR COVERINGS, PLASTIC LININGS, ETC.

FLOOR SHEETING: — are to be of the composition, type, size and thickness specified with colour, pattern, graining, etc, consistent throughout, all to the approval of the Department.

Thermoplastic floor tiles: — are not to be used.

Fully flexible vinyl floor sheeting: — are to comply with SANS Specification 786 and is to be 2.5 mm nominal thickness.

Recessed entrance mats with brass frame at main entrance into a health facility as "Belgotex" Grimbuster or other approved. This to be positioned outside before entering.

In patient care area's, no perforations to floor covering is to be made. Eg door stops, door barrel bolt floor keeps etc.

Where the specified sizes and/or thicknesses of floor sheeting differ from those in the SANS Specifications, such items of floor sheeting shall comply in all other respects with the relevant SANS Specifications.

SKIRTINGS, STAIR NOSINGS, EDGING STRIPS, ETC.: —are to be of the types and sizes specified and are to be of approved manufacture

CARPET TILES AND SHEETING: — are to be of the types specified and of approved colours and patterns all to approval of the Department.

LAYING: —

Vinyl Floor covering laying procedure and polishing.

Site conditions required before the layer commences an installing of a Resilient Floor covering. Some of these conditions may appear obvious, but they are not always complied with. If any of the following recommendations are ignored, it is likely that a number of problems will arise during or after installation of the flooring.

1. All building materials and equipment, e.g. sand, scaffolding, tools, etc. should be removed. (Do not allow heaps of sand, concrete, etc., to remain on the surface of the sub-floor since moisture transfer to the sub-floor takes place).
2. All resilient flooring materials require a smooth, hard, clean and level surface, not only for appearance but also for achieving a satisfactory adhesive bond and long-term durability. The Specifier and the Main Contractor shall ensure that the sub-floor is acceptable to receive the resilient flooring specified in respect of levelness, smoothness, soundness and cleanness. (The SANS Code of Practice 070/1991 as amended 1993 Section 9.3 details the requirements in this regard).
The flooring contractor shall ensure that the sub-floor is sufficiently dry prior to the installation of the flooring material. The floor should be tested by means of a Hygrometer or a Tramex. (Of the instruments available for determining moisture levels in sub-floors, the most practical and accurate is the hygrometer).

SHEETING

Ensure that the following steps are followed during the installation:

1. Trim off factory leading edge before laying sheeting.
2. Align the sheet in position that there is an opening no bigger than 1mm between adjacent sheets. For the best results, the width of a credit card is an acceptable measure.
3. Apply adhesive according to the manufacturers' specifications.
4. Roll the floor during and after installation with a 68kg roller to maximize the adhesion between the sheeting and the adhesive.
5. Complete the welding 24 hours after the installation. Groove the joins open with a suitable hand or electric groover to a width of not wider than 3mm and not deeper than 1.5mm. Weld the joins with a hot air welding gun with temperature settings of between 4-6 temperature setting and use a speed nozzle that will not burn the material or damage the coating. Use a sharp spatula and guide plate and remove the excess welding in two stages.
6. All vinyl sheeting needs to be stripped and sealed 72 hours after installation. Please ensure you use a good quality product.

2.1 HYGROMETER

When a hygrometer is positioned on a sub-floor surface, the reading of the relative humidity of the entrapped air space is obtained.

- A hygrometer reading of less than 70% indicates that the sub-floor is sufficiently dry for flooring to be laid upon it.
- If the hygrometer indicates a final reading of more than 70% when the initial reading of the atmosphere was less than 70% then the sub-floor is unacceptably damp and must be allowed to dry out before any flooring is installed.
- If the hygrometer indicates a final reading of more than 70% when the initial reading of the atmospheric humidity was also greater than 70%, as can occur in coastal areas, then the following applied:
 1. If the final reading is significantly higher than the initial reading, then the sub-floor must be considered to be unacceptably damp.
 2. If the final reading is similar to, or less than the initial reading, then the moisture content of both the atmosphere and the sub-floor are similar.

2.2 TRAMEX CONCRETE MOISTURE ENCOUNTER (C.M.E.)

Any reading on the C.M.E. of 60% or less indicates acceptable moisture content for the installation of any vinyl floor covering.

3. Floor Preparation – New and Existing (old) Screeds

3.1 Use of screed smoothing compounds should be avoided except for making minor repairs, however should a full skim be required, then the most common method in both instances is the use of a smoothing compound e.g. **Pavelite** in combination with **Pavelite Bonding Liquid**, mixed to the correct ratio and consistency. Only recommended products, mixed strictly in accordance with manufacturers instruction should be used. Do not use smoothing compound on power floated finishes. It is recommended that in new structures the screeding should be as specified by "Tal" using "Screedmaster", the pumped method. A badly undulating floor may require grinding by mechanical means to improve the overall levelness. Although smoothing compounds such as **Pavelite** will improve the sub-floor it will not achieve perfection.

3.2 In cases where old vinyl floor coverings have been uplifted, leaving a bitumen adhesive residue, it is recommended that a strict procedure relating to the "Preparation of Sub Floors with Bitumen Residue", be complied with.

(This method may not constitute good flooring practice, but has proved to be successful on many occasions. No guarantee is however given or implied).

4. Construction joints (saw cuts) and Expansion Joints

4.1 Construction joints (saw cuts) in the sub-floor should be cleaned out, and the sides of the saw cut be painted with **Pavelite Bonding Liquid** and allowed to dry. The joint should then be filled with a mixture of **Pavelite** and **Pavelite Bonding Liquid**. It is advisable to slightly overfill the joints, which when dry should be rubbed down with a carborundum stone.

4.2 Expansion joints should be filled with a suitable **Sealant** to prevent the ingress of dirt. **It is bad flooring practice to lay flooring over such a joint.** The flooring should stop at the edge of the joint and cover strips placed over the joint itself. Expansion joints and cover strips should be discussed and designed by a structural engineer.

5 Correct setting out is critical, and consideration should be given to the squareness of the area. It is safest to set out from the longest outside wall.

5.1 The recommended notching for a trowel to spread adhesive is a V notch of 1,5 x 1,5 x 1,5mm at 4,00mm centres. Consideration should however be given to the porosity of the sub-floor. Ensure the use of the recommended adhesive with the appropriate flooring. **Do not** spread the adhesive over a larger area than can be covered within the working/open time of the adhesive.

5.2 All installations must be rolled with a 68kg three sectional articulated metal floor roller on completion, within the working time of the adhesive.

5.3 Welding of sheeting is to be done only after 24 hrs after installation.

5.3. a. Trimming

While the welding rod is still warm, trim off most of the top half using a sharp spatula and spatula guide which fits over the welding rod. Carry out the final trimming using the spatula knife only, when the welding rod has cooled.

5.3.b Glazing

The trimmed welding rod will tend to soil more rapidly than the sheeting. It is therefore important to glaze the surface of the trimmed welding rod.

6. After installation the flooring should be adequately protected, preventing damage caused by other trades working on the site.

7. The completed floor should not be washed or polished for a period of 72 hours after the installation in order to allow the adhesive to cure. This period will vary from one adhesive to another.

7.1 The vinyl floor covering must be cleaned with an approved water based floor Stripper, in order to achieve an acceptable standard of cleanliness for sealing. Avoid excessive use of water at all times

7.2 Foreign matter such as paint stains, tar, etc. which may not respond to the process must be removed by other means.

7.3 Three coats of a Water Based Emulsion floor dressing, shall then be applied on completely dry surface in accordance with the manufacturer's instructions, allowing one hour drying time between the first and second application of each dressing coat.

RATES: —for all floor coverings are to include for laying as described, for cleaning down backing surfaces before laying and or all square and raking cutting and waste and fitting, fair cutting at edges where no skirting occurs, protecting from injury, and for cleaning down, etc. as described, at completion.

Rates for all wall linings are to include for laying as described, cleaning down backing surfaces before laying, sizing backing surfaces if necessary to ensure proper adhesion, all square and raking cutting and waste and fitting, fair cutting at exposed edges, bending at angles and for all narrow widths and protecting from injury and cleaning down, etc. as described, at completion. Wall linings in widths not exceeding 300mm to returns, reveals and the like have not been measured separately, but have been included in the area of the general items of wall linings and rates must include or this.

Rates for skirting, stair nosing, edging strips, etc. is to include for fixing as described, cutting to lengths and fitting at intersections, mitres, ends, etc. and for cleaning down at completion.

9. IRONMONGERY

Ironmongery is to be to the approval of the Department and rates are to include for fixing screws of corresponding metal and finish and for oiling and easing as required at completion.

Where catalogue references are given, the articles are to be of the brand specified or other approved.

No two-lever mortise locks are to be used.

Mortise locks, cylinder locks, cupboard locks, etc. are to differ so that no key will pass a second lock, unless otherwise specified. Where mortise locks, cylinders, locks, etc. are specified to be "en-suite" they are to be made "en-suite" in the specified number of "suites". The "suites" are to be controlled by differing sub-master keys with a grand master key controlling all "suites", and no sub-master is to pass any lock of another "suite".

All locks are to be fitted with two keys and the locks are to be stamped with consecutive numbers and the keys to each are to be stamped to correspond with the lock.

Items of ironmongery specified as chrome plated or satin chrome finish are, unless otherwise specified, to be chromium plated or satin chrome finish on solid brass.

Items of ironmongery specified aluminium are to be natural anodised.

Where items of ironmongery are specified as fixed to pressed steel door frames, the Contractor is to ensure that the suppliers of the steel frames prepare the frames for all keeps and do all mortising and drilling required and receive all information necessary regarding ironmongery. Preparation of steel doorframes for ironmongery has been measured elsewhere.

Where tests of ironmongery are described as "plugged and screwed" these are to be screwed to patent fixing plugs of approved manufacture, and this shall include for plugging and screwing to brickwork or concrete.